



Tucson Electric Power Company



2017 Integrated Resource Plan



April 3, 2017

Acknowledgements

Tucson Electric Power Company IRP Team

Jeff Yockey, Manager, Environmental and Long-Term Planning
Victor Aguirre, Manager, Resource Planning
Kevin Battaglia, Lead Resource Planner
Luc Thiltges, Lead Resource Planner
Lee Alter, Senior Resource Planner
Ernesto Blanco Jr, Fuels, Senior Portfolio Analyst
Henry Cattan, Fuels and Resource Planning
Greg Strang, Lead Forecasting Analyst
Stephanie Browne-Schlack, Senior Forecasting Analyst
Debbie Lindeman, Supervisor, Energy Efficiency Planning Analysis & Reporting
Ron Belval, Manager, Regional Transmission Planning
Gary Trent, Manager, Transmission Planning
Christopher Lindsey, Manager, Distribution Engineering & Technical Energy Services
Richard Bachmeier, Principal Rate Designer, Rates & Revenue Requirements
Lauren Briggs, Manager, Balancing Authority Function
Sam Rugel, Director, System Control & Reliability
Michael Bowling, Director, Wholesale Marketing
Nicole Bell, Renewable Forecasting and Trading Analyst
Michael Baruch Supervisor, Residential Energy Efficiency Programs & Services
Jeff Krauss, Manager, Renewable Energy
Ted Burhans, Manager, Renewable Energy
Joe Barrios, Supervisor, Media Relations & Regulatory Communications
Carmine Tilghman, Senior Director, Energy Supply & Renewable Energy
Erik Bakken, Senior Director, Transmission and Environmental Services
Mike Sheehan, Senior Director, Fuels and Resource Planning

IRP Consultants and Forecasting Services

Pace Global

<http://www.paceglobal.com/>

Gary W. Vicinus, Executive Vice President - Consulting Services

Melissa Haugh - Consulting Services

Anant Kumar - Consulting Services

Brian Kwak – Consulting Service

Chuck Fan – Consulting Services

Wood Mackenzie - Consulting Services

<http://public.woodmac.com/public/home>

EPIS - AuroraXMP Software Consulting Services

<http://epis.com/>

Table of Contents

ACKNOWLEDGEMENTS	3
Tucson Electric Power Company IRP Team.....	3
IRP Consultants and Forecasting Services.....	3
ACRONYMS	13
FORWARD.....	17
CHAPTER 1	19
EXECUTIVE SUMMARY.....	19
Introduction	19
Coal Plant Retirements.....	20
Renewable Energy Integration and Diversification	21
Grid Balancing Resources	22
Smart Grid Operations.....	22
Regional Infrastructure Projects.....	23
Transformation of Desert Southwest Wholesale Power Markets.....	23
Regional Transmission Organizations.....	24
Market Fundamentals.....	24
Energy Efficiency	25
A New Integration Approach to Resource Planning.....	26
Summary of the 2017 IRP Reference Case Plan	27
Planned Coal Plant Retirements.....	27
Planned Renewable Resource Additions	27
Planned Grid Balancing Resources	27
Planned Energy Efficiency Commitments.....	27
TEP’s 2017 IRP Reference Case Plan	28
CHAPTER 2	31
ENERGY DEMAND AND USE PATTERNS.....	31
Load Forecast	31
Geographical Location and Customer Base.....	32
Customer Growth.....	33
Retail Sales by Rate Class	34
Reference Case Forecast.....	35
Methodology	35
Reference Case Retail Energy Forecast.....	36
Reference Case Retail Energy Forecast by Rate Class	37
Reference Case Peak Demand Forecast.....	38
Data Sources Used in Forecasting Process.....	39
Risks to Reference Case Forecast and Risk Modeling.....	39
Firm Wholesale Energy Forecast.....	40
Summary of Reference Case Load Forecast.....	41
Future Drivers that May Influence the Long-Term Load Forecast.....	42
Electric Vehicles	43
Future Adoption Rate Influencers.....	45

Policy.....45

Battery Technology.....45

Grid Impacts.....46

Smart Grid.....47

The Future of the Distribution Grid.....47

CHAPTER 3 49

OPERATIONAL REQUIREMENTS AND RELIABILITY..... 49

Load and Resource Adequacy49

Future Load Obligations51

System Resource Capacity.....52

Typical Dispatch Profiles.....53

Balancing Authority Operations.....55

Control Performance Standard (CPS)58

Balancing Authority ACE Limit (BAAL).....58

Disturbance Control Standard (DCS)58

Frequency Response Measure (FRM)58

 Reserves.....59

 Load Following59

 Adjustments to Operating Reserve.....61

 Frequency Response61

 Inertia.....62

 Voltage Support.....62

 Power Quality.....63

DISTRIBUTION SYSTEM ENHANCEMENTS 64

Distribution Capacity Expansion64

New 138kV Substations.....64

Benefits Realized from New Substations.....64

Existing Substation Upgrades.....65

4kV System Conversion.....65

4KV System Conversion Benefits65

CLEAN ENERGY STANDARDS..... 66

Renewable Energy Standard Compliance.....66

Energy Efficiency Standard Compliance.....66

Utility-Specific Standard Derived Through the IRP Process67

RENEWABLE ENERGY INTEGRATION..... 68

Operational Challenges68

Shifting Net Peak.....70

Weather Forecasting to Support System Dispatch71

ENVIRONMENTAL REGULATIONS..... 73

Overview.....73

Regional Haze.....73

Clean Power Plan.....74

CPP Overview75

Arizona76

<i>Navajo Nation</i>	76
<i>New Mexico</i>	76
<i>PACE Global Arizona CPP Analysis</i>	77
<i>National Ambient Air Quality Standards</i>	79
Power Generation and Water Resources.....	80
Power Generation and Water Impacts of Resource Diversification	81
CHAPTER 4	83
A NEW INTEGRATION APPROACH TO RESOURCE PLANNING	83
Load Modifying Resources.....	84
Renewable Load Serving Resources.....	84
Conventional Load Serving Resources.....	84
Grid Balancing Resources	84
Typical Summer Day Categorized by Resource Requirements.....	85
Typical Winter Day Categorized by Resource Requirements	86
RESOURCES MATRIX	87
Resource Benchmarking.....	87
Source Data.....	88
Lazard’s Levelized Cost of Energy Analysis	89
Overview on Conventional and Alternative Energy Technologies	89
Lazard’s Levelized Cost of Storage Analysis	90
Overview on Energy Storage Technologies	90
Cost Competitive Storage Technologies	90
Future Energy Storage Cost Decreases	91
2017 Integrated Resource Plan Levelized Cost Comparisons	92
LCOE Assumptions – All Resources	92
2017 Levelized Cost of All Resources	93
<i>Load Modifying Resources – Cost Assumptions</i>	94
<i>LCOE Assumptions for Load Modifying Resources</i>	95
<i>Renewable Load Serving Resources – Cost Assumptions</i>	96
<i>LCOE Assumptions for Load Serving Resources – Renewables</i>	97
<i>Conventional Load Serving Resources – Cost Assumptions</i>	98
LCOE Assumptions for Load Serving Resources – Conventional	99
<i>Grid Balancing Resources – Cost Assumptions</i>	100
<i>LCOE Assumptions for Grid Balancing Resources</i>	101
Renewable Electricity Production Tax Credit (PTC).....	102
Energy Investment Tax Credit (ITC)	103
<i>Solar Technologies</i>	103
<i>Impacts of Declining Tax Credits and Technology Installed Costs</i>	104
<i>Impacts of Declining PTC and Technology Installed Costs</i>	105
CHAPTER 5	107
LOAD MODIFYING RESOURCES	107
Energy Efficiency	107
<i>2017 Implementation Plan, Goals, and Objectives</i>	107
<i>Planning Process</i>	108

<i>Program Screening</i>	108
<i>Utility Resource Cost Test</i>	109
<i>Total Resource Cost</i>	109
<i>Participant Cost Test</i>	109
<i>Rate Impact Measure Test</i>	110
<i>Societal Cost Test</i>	110
Current Energy Efficiency and DSM Programs	110
RESOURCE PLANNING INTEGRATION	112
DSM Forecasting	112
Load Shape Results	114
Energy Efficiency Technology Summary	117
DISTRIBUTED ENERGY RESOURCES	118
Solar Photovoltaic DG Systems Overview	119
Typical System Components:	119
Configuration of Typical PV Systems	120
Solar Hot Water Heaters	121
Integral Collector Storage (ICS) Passive Direct System	122
Thermosiphon Passive Direct System	122
Typical Installations	123
Distributed Generation Technology Summary	123
CHAPTER 6	125
LOAD SERVING RESOURCES	125
Renewable Energy	125
<i>Solar PV Technology</i>	126
<i>Solar Resource Characteristics</i>	127
Photovoltaic Solar Power Technology	128
Flat-Plate PV Systems	129
Solar PV Technology Summary	131
<i>U.S. Solar Map</i>	132
<i>Arizona Solar Power Map</i>	133
Concentrating Photovoltaics (CPV)	135
CPV Technology Summary and Costs	135
Concentrating Solar Power Technology (CSP)	136
<i>Power Tower CSP Systems</i>	136
<i>CSP Technology Summary and Costs</i>	137
Ivanpah Solar Electric Generating Station	138
Stirling Engine Dish Technology	140
Parabolic Trough Power Plants (PTPP)	142
Parabolic Trough Power Plant Technology	144
<i>Mojave PTPP Project</i>	144
Hybridized Configuration with Natural Gas Co-Firing	145
Storage Configuration based on Two-Tank Molten Salt System	145
Solana Generating Station	146
Wind Power	148
<i>Resource Characteristics</i>	148

<i>U.S. Wind Resource Map</i>	148
Arizona Wind Resource Potential	151
New Mexico Wind Resource Map.....	152
New Mexico Wind Resource Potential	153
<i>Wind Technology Summary</i>	155
Bioenergy/Bio-Resources.....	156
<i>Arizona Biomass Map</i>	157
<i>New Mexico Biomass Map</i>	158
<i>Biomass Technology Overview</i>	159
<i>Biomass Technology Summary and Costs</i>	160
Natural Gas Resources.....	160
<i>NGCC Technology Summary</i>	161
Coal Resources.....	162
<i>Pulverized Coal Technology Summary and Costs</i>	163
<i>Integrated Gasification Combined-Cycle (IGCC)</i>	163
<i>Coal Market Prices</i>	164
Nuclear Resources.....	165
<i>Small Modular Nuclear Reactors</i>	165
Permitting and Time to Commercial Operation.....	167
<i>SMR Technology Summary</i>	167
CHAPTER 7	169
GRID BALANCING AND LOAD LEVELING RESOURCES.....	169
Energy Storage.....	169
<i>Pumped Hydro-Power</i>	169
<i>Compressed Air Energy Storage (CAES)</i>	170
<i>Batteries</i>	170
<i>Flywheels</i>	170
<i>Energy Storage Applicability</i>	171
<i>Energy Storage Technology Summary</i>	173
<i>Batteries</i>	173
<i>Pumped Hydro</i>	173
<i>Compressed Air Energy Storage</i>	173
Fast Response Thermal Generation	174
<i>Reciprocating Internal Combustion Engines</i>	174
<i>RICE Technology Summary</i>	176
<i>Large Frame Combustion Technology Summary</i>	176
<i>Aeroderivative Combustion Turbine Technology Summary</i>	177
Demand Response.....	177
<i>Demand Response Technology Summary</i>	178
Utility installed thermostats and switches at customer site used to control customer demand.....	178
Rate Design.....	178
Demand Rates	179
Time-Varying Rates	179
Distributed Generation	179
TEP Rate Design	180

Desert Southwest Wholesale Power Markets - Transformation	181
Wholesale Power Market Overview	181
Non-Dispatchable Renewable Must Run Resources	181
Impacts on Baseload Generation Resources.....	182
<i>Reduction in Overall Natural Gas Demand and Commodity Prices</i>	183
Arizona Gas Storage Project.....	184
Kinder Morgan 2017 Open Season	184
CHAPTER 8	185
REGIONAL TRANSMISSION PLANNING	185
Overview.....	185
<i>Ninth Biennial Transmission Assessment</i>	185
<i>Reliability Must Run (RMR) Assessment</i>	185
<i>Ten Year Snapshot Study</i>	185
<i>Extreme Contingency Study</i>	185
<i>Effects of Distributed Generation and Energy Efficiency Programs</i>	185
WestConnect.....	186
WECC.....	187
Multi-Regional & Interconnection-Wide Transmission Planning.....	188
Evolving Resource Mix Challenges.....	188
Key Issues:	189
Other Regional Transmission Projects.....	190
Nogales DC Intertie	190
Sunzia Southwest Transmission Project.....	191
The Southline Transmission Project.....	192
Western Spirit Clean Line	193
Energy Imbalance Markets.....	194
<i>CAISO – Energy Imbalance Market EIM</i>	194
Regional Transmission Organizations (RTOs)	197
CHAPTER 9	199
TEP EXISTING RESOURCES	199
TEP’s Existing Resource Portfolio	199
Coal Resources.....	201
Springerville Generating Station.....	202
San Juan Generating Station.....	203
Navajo Generating Station	204
Four Corners Power Plant	205
H. Wilson Sundt Generating Station	206
Luna Energy Facility.....	207
Gila River Generating Station	208
Combustion Turbines	209
Future Plan to Move to Cycling Operations	210
Existing Renewable Resources.....	211
EXISTING FIXED AXIS SOLAR PV PROJECTS.....	212
<i>Springerville Solar</i>	212

<i>Solon / TEP UASTP II</i>	213
<i>Gato Montes</i>	213
<i>Solon Prairie Fire</i>	214
<i>Ft. Huachuca – Phase I</i>	215
<i>Ft. Huachuca Phase-II</i>	215
EXISTING SINGLE AXIS TRACKING PROJECTS	216
<i>Cogenera</i>	216
<i>Solon UASTP I</i>	216
<i>E.ON UASTP</i>	217
<i>Picture Rocks</i>	217
<i>E.ON Valencia</i>	218
<i>Avalon Solar I and II</i>	218
<i>Red Horse Solar II</i>	219
<i>NRG Solar</i>	220
EXISTING CONCENTRATING PV PROJECTS.....	221
<i>Amonix UASTP II</i>	221
<i>White Mountain</i>	222
EXISTING CONCENTRATING SOLAR POWER PROJECTS.....	222
<i>Areva Solar</i>	223
EXISTING WIND RESOURCES.....	224
<i>Macho Springs</i>	224
<i>Red Horse 2 Wind Project</i>	225
EXISTING BIOMASS PROJECTS.....	226
<i>Sundt Biogas</i>	226
TEP’s Energy Storage Projects.....	227
Distributed Generation Resources.....	228
<i>Davis Monthan Air Force Base Distributed Generation Project</i>	229
TRANSMISSION	230
Overview.....	230
TEP’s Existing Transmission Resources.....	230
<i>Pinal Central to Tortolita 500 kV Transmission Upgrade</i>	231
<i>Pinal West to South Upgrade Project</i>	232
CHAPTER 10.....	233
FUTURE RESOURCE REQUIREMENTS.....	233
Future Energy Efficiency Assumptions.....	233
Future Renewable Energy Assumptions	234
<i>Technology Considerations</i>	236
<i>Diversity of Resources</i>	236
<i>Utility Scale Project Ownership</i>	236
Future Grid Balancing Resources	237
<i>Energy Storage</i>	237
<i>Fast Response Thermal Generation</i>	238
Demand Response.....	239
Future Transmission.....	240

<i>Ten-Year Transmission Plan</i>	240
<i>Transmission Substation Reconfiguration Projects</i>	240
<i>Conceptual Future Local Area 345 kV EHV Transmission Projects</i>	240
<i>Transmission Resources Needed for New Generating Resources</i>	241
CHAPTER 11	243
ALTERNATIVE FUTURE SCENARIOS AND FORECAST SENSITIVITIES	243
<i>PACE Alternative Future Scenarios</i>	243
Natural Gas Prices	245
Coal Prices.....	246
Capital Costs.....	247
Palo Verde (7x24) Market Prices.....	249
Load Growth Scenarios	250
<i>High Load Scenario</i>	251
<i>Low Load Scenario</i>	251
FUEL, MARKET AND DEMAND RISK ANALYSIS	252
<i>Permian Natural Gas Prices</i>	253
<i>Permian Natural Gas Price Distributions</i>	254
<i>Palo Verde (7x24) Wholesale Power Prices</i>	255
<i>Palo Verde (7x24) Market Price Distributions</i>	256
<i>Load Variability and Risk</i>	257
CHAPTER 12	259
REFERENCE CASE PLAN	259
<i>Resource Diversification</i>	259
<i>Loads and Resource Assessment</i>	260
<i>Addition of Resources to Meet System Requirements</i>	261
<i>Addition of Load Serving Resources</i>	261
<i>Addition of Grid Balancing and Load Leveling Resources</i>	261
<i>Reference Case Plan Summary and Timeline</i>	261
Reference Case Plan Attributes	264
<i>Existing Renewable Integration Requirements</i>	265
<i>Reference Case Plan Renewable Integration Requirements</i>	266
<i>Clean Power Plan Compliance</i>	267
Reference Case Plan Risk Dashboard.....	269
LOAD GROWTH SCENARIO ANALYSIS	271
<i>High Load Scenario</i>	271
<i>Low Load Scenario</i>	272
CHAPTER 13	273
ALTERNATIVE PORTFOLIOS	273
Overview of the Energy Storage Portfolio	274
Overview of the SMR - Full Coal Retirement Portfolio.....	276
Overview of Expanded Energy Efficiency	277
Overview of the Expanded Renewable Portfolio.....	279

Overview of Major IRP Assumptions by Portfolio	281
Summary of NPV Revenue Requirements by Scenario	282
Summary of NPV Revenue Requirements – Base Case Scenario	283
Summary of NPV Revenue Requirements – High Economy Scenario	284
Summary of NPV Revenue Requirements – High Technology Scenario	285
Distribution of NPV Revenue Requirements by Portfolio	286
Distribution of NPV Revenue Requirements by Portfolio	287
NPVRR Mean and Worst Case Risk	288
CHAPTER 14	289
FIVE-YEAR ACTION PLAN	289
PACE GLOBAL FUTURE STATES OF THE WORLD	APPENDIX A
2017 FLEXIBLE GENERATION TECHNOLOGY ASSESSMENT	APPENDIX B

List of Acronyms

ACRONYMS

ACC – Arizona Corporation Commission
 ACE – Area Control Error
 ANPR – Advanced Notice of Proposed Rulemaking
 APS – Arizona Public Service Company
 BA – Balancing Authority
 BART – Best Available Retrofit Technology
 Bcf – Billion Cubic Feet
 BES – Bulk Electric System
 BEV – Battery Electric Vehicles
 BTA – Biennial Transmission Assessment
 Btu – British Thermal Unit
 C&I – Commercial and Industrial
 CAES – Compressed Air Energy Storage
 CBM – Coal Bed Methane
 CC – Combined Cycle Plant Technology
 CCCT – Combined Cycle Combustion Turbine
 CCR – Coal Combustion Residuals
 CCS – Carbon Capture and Sequestration; Carbon Capture and Storage
 CFL – Compact Fluorescent Light Bulb
 CAISO - California Independent System Operator
 CO₂ – Carbon Dioxide
 CPP – Clean Power Plan
 CSP – Concentrating Solar Power
 CT – Combined Turbine
 DER – Distributed Energy Resources
 DG - Distributed Generation
 DOE – U.S. Department of Energy (Federal)
 DLC – Direct Load Control
 DMS – Distribution Management System
 DR – Demand Response
 DSM – Demand Side Management
 EAF – Equivalent Availability Factor
 EE – Energy Efficiency
 EIA - Energy Information Administration
 EIM – Energy Imbalance Market
 ELCC – Effective Load Carrying Capacity
 EMS – Energy Management System
 EPA - Environmental Protection Agency
 EPRI – Electric Power Research Institute
 EPS – Emission Performance Standard

ERC – Emission Rate Credit
ESS – Energy Storage System
EV – Electric Vehicles
FERC – Federal Energy Regulatory Commission
FIP – Federal Implementation Plan
GIS – Geographic Information System
GHG – Greenhouse Gas
GW – Gigawatt,
GWh – Gigawatt-Hour
HAPS – Hazardous Air Pollutants
HEV – Hybrid Electric Vehicle
HRSG – Heat Recovery Steam Generator
IGCC – Integrated Gasification Combined Cycle
IRP – Integrated Resource Plan
ISCC – Integrated Solar Combined Cycle
ITC – Investment Tax Credit
kW – Kilowatt
kWh – Kilowatt-Hour
kWyr – Kilowatt-Year
LCOE – Levelized Cost of Electricity
LNG – Liquefied Natural Gas
MACT – Maximum Available Control Technology
Mcf – Million Cubic Feet
MMBtu – Million British Thermal Units, also shown as MBtu
MBtu – Million British Thermal Units, also shown as MMBtu
MW – Megawatt
MWh – Megawatt-Hour
NAAQ – National Ambient Air Quality Standards
NaS – Sodium Sulphur
NASNRC – National Academies of Science National research Council
NEC – Navopache Electric Cooperative
NERC - North American Electric Reliability Corporation
NGCC – Natural Gas Combined Cycle
NGS – Navajo Generating Station
NMED – New Mexico Environmental Department
NNT – No-Notice Transportation
NO_x – Nitrogen Oxide(s)
NPV – Net Present Value
NPVRR – Net Present Value Revenue Requirement
NRC – Nuclear Regulatory Commission
NREL – National Renewable Energy Laboratory
NSPS – New Source Performance Standards
NTUA – Navajo Tribal Utility Authority
O&M – Operations and Maintenance
PEV – Plug-in Electric Vehicles
PM - Particulate matter
PNM – Public Service Company of New Mexico
PPA - Purchased Power Agreement

PTC – Production Tax Credit
PSD – Prevention of Significant Deterioration
R&D – Research and Development
RCRA – Resource Conservation and Recovery Act
REC – Renewable Energy Credit
RES – Renewable Energy Standard
RICE – Reciprocating Internal Combustion Engine
RFP – Request for Proposal
ROB – Replace on Burnout
ROD – Record of Decision
ROW – Right of Way
RTO - Regional Transmission Organization
RTP – Renewable Transmission Project
RUCO - Residential Utility Consumer Office
SAT – Single-Axis Tracking
SCADA – Supervisory Control and Data Acquisition
SCE – Southern California Edison
SCR – Selective Catalytic Reduction
SCT – Societal Cost Test
SCCT – Simple Cycle Combustion Turbine
SGS – Springerville Generating Station (aka Springerville)
SIP – State Implementation Plan
SJCC – San Juan Coal Company
SJGS – San Juan Generating Station
SMR – Small Modular (Nuclear) Reactor
SNCR – Selective Non-Catalytic Reduction
SRP – Salt River Project
SRSG – Southwest Reserve Sharing Group
SO₂ – Sulfur Dioxide
STG – Steam Turbine Generator
SWEEP – Southwest Energy Efficiency Project
TEP – Tucson Electric Power Company
TOU – Time-of-Use
TOUA - Tohono O’odham Utility Authority
TRICO – Trico Electric Cooperative
UES – UniSource Energy Services (Parent Company of UNS Electric)
UAMPS - Utah Associated Municipal Power System
VAR – Volt-Ampere Reactive; Reactive Power
WECC - Western Electricity Coordinating Council

Forward

As our community grows and changes, Tucson Electric Power (TEP) must evolve to continue satisfying the energy needs of our customers with a more flexible and responsive resource portfolio. Our 2017 Integrated Resource Plan (IRP) reflects our ongoing transformation from a traditional utility to a more technology and consumer-focused provider of energy products and services – a shift that must be accomplished without sacrificing reliability, convenience or affordability.

TEP will continue to diversify its generation portfolio and reduce its significant reliance on coal by expanding cost-effective renewable resources, particularly solar. Our goal is to serve at least 30 percent of our retail load from renewable resources by 2030 – twice the level TEP must achieve by 2025 under Arizona's Renewable Energy Standard. We also will continue to rely on energy efficiency measures while investing in cleaner burning natural gas resources.

We anticipate making significant progress toward that goal by adding approximately 800 megawatts (MW) of renewable energy capacity by 2030. We recently signed an agreement with NextEra Energy Resources LLC., to purchase power from a new 100 MW wind facility. We're also evaluating proposals for a new 100 MW-dc solar facility that would be built and owned by a project partner. Both projects are scheduled for completion in 2019.

Amid such change, we also must maintain access to and control of reliable, cost-effective conventional generating resources. To that end, TEP recently replaced a long-term lease with full ownership and control of Unit 1 at the Springerville Generating Station – Arizona's newest, most efficient coal plant. This will allow our resource portfolio to remain appropriately balanced during planned reductions of coal-fired resources at the San Juan and Navajo Generating Stations.

Our increasingly diverse, sustainable generation portfolio will create operational challenges that require new ways of managing the intermittency and variability of renewable resources. Through a partnership with the University of Arizona, we are using unique and highly customized forecasting models to predict our solar and wind systems' next-day production. These predictions help us make more informed decisions about real-time system dispatch.

We're also making greater use of energy storage systems, which can boost power output levels more quickly than conventional generating resources to maintain the required balance between energy demand and supply. Such systems are expected to rapidly decline in cost over the next several years. TEP recently completed three energy storage projects with a combined capacity of 22 MW that are designed to provide grid-balancing resources such as frequency response and regulation and voltage support. We also are planning investments in flexible, fast-responding reciprocating internal combustion engines that will provide capacity and assist in mitigating power fluctuations associated with renewable resources. Such systems can run efficiently at varying loads without regard to frequent starts and cycling operations.

Renewable resources, energy efficiency measures and demand response technologies will play increasingly prominent roles in our future resource plans. Renewable resource costs are becoming competitive with conventional generation, while energy efficiency remains the lowest-cost option. That said, building the most reliable and cost-effective portfolio requires us to consider the price, benefits and feasibility of each resource option in relation to existing infrastructure, environmental factors and other operating conditions unique to our company. That's why we believe utility-specific clean energy standards should be determined through the IRP process instead of mandatory, numeric-driven statewide standards.

This report also describes how new smart grid technologies identified in TEP's 10-year transmission and distribution plans would improve service reliability by providing increased system capacity and contingency support for the distribution network. These network upgrades will support the grid of the future with integration of technologies like remote switching that can help prevent and minimize service interruptions.

New technologies will continue to create new energy choices for consumers and new options for utilities. TEP must remain flexible and focused on managing resources in ways that adapt to such changes while maintaining progress toward achieving a sustainable portfolio that preserves safe, reliable and affordable service.

David G. Hutchens
President and CEO

CHAPTER 1**EXECUTIVE SUMMARY****Introduction**

For the last 50 years, Tucson Electric Power (TEP) has relied on a fleet of baseload coal plants to meet the majority of customers' energy needs. Customer usage and peak demand steadily and often rapidly increased as more and more people moved to Tucson for its favorable climate. Natural gas fired steam boilers and combustion turbines, as well as purchased power, provided the additional capacity needed to meet summer peak demand. During this time the primary resource planning challenge was to meet this ever increasing system peak economically given high volatility in natural gas and wholesale power prices.

Presently, many new factors have come into play, some competing, some complimentary, that necessitate varying from the status quo. Changing customer use patterns have resulted in lower load growth, yet there exists the potential for new opportunities that will require communication and coordination between customers and the grid. Operating requirements relating to reliability, grid security, clean energy standards, and environmental compliance are becoming continuously more stringent at the same time that we prepare for the operating challenges relating to integrating higher levels of renewable energy. Resource economics and environmental considerations have shifted the historically strong preference for coal, to a more balanced use of coal, natural gas, and renewable resources. Given all these changes, we need to view resources differently, to be better aligned with the role each resource plays in meeting the economical and reliable delivery of energy to our customers.


Furthermore, the traditional role of resource planning itself has changed. While we still must provide for reliable and safe power at affordable rates, our stakeholders expect us to achieve those objectives while improving environmental performance and mitigating risk. To meet these expanded objectives, TEP must be prepared to make significant changes while maintaining optionality to account for the uncertainty inherent in a long-term outlook.

TEP's 2017 Integrated Resource Plan identifies the current and anticipated changes facing the utility industry, and TEP specifically, and outlines a plan to meet our customers' energy needs in light of these changes. The IRP presents a snap shot of current loads and resources and projects future energy and capacity needs through 2032. TEP presents the 2017 Reference Case Plan that provides a reasonable path forward in terms of reliability, affordability, environmental performance and risk.

Coal Plant Retirements

As part of TEP’s longer-term portfolio diversification strategy, the Company is reducing its significant reliance on coal to approximately 38% of retail energy deliveries. Over the next five years, TEP will reduce its coal-fired capacity by 508 MW through planned retirements. TEP plans to exit San Juan Generating Station (“San Juan”) Unit 2 at the end of 2017, exit the Navajo Generating Station (“Navajo”) at the end of 2019, and exit San Juan Unit 1 at the end of June 2022¹. These planned coal retirements will enable TEP to take advantage of near-term opportunities to reduce costs and rebalance its resource portfolio over the longer-term. This reduction in coal resources will result in significant cost savings² for TEP customers and will result in meaningful reductions in air emissions and water consumption³. Finally, TEP’s long-term commitments to clean energy resources will help minimize the Company’s long-term environmental risk while locking in lower-cost sustainable sources of energy for decades to come.

Figure 1 - TEP 2017 IRP Reference Case Timeline for Coal Unit Retirements

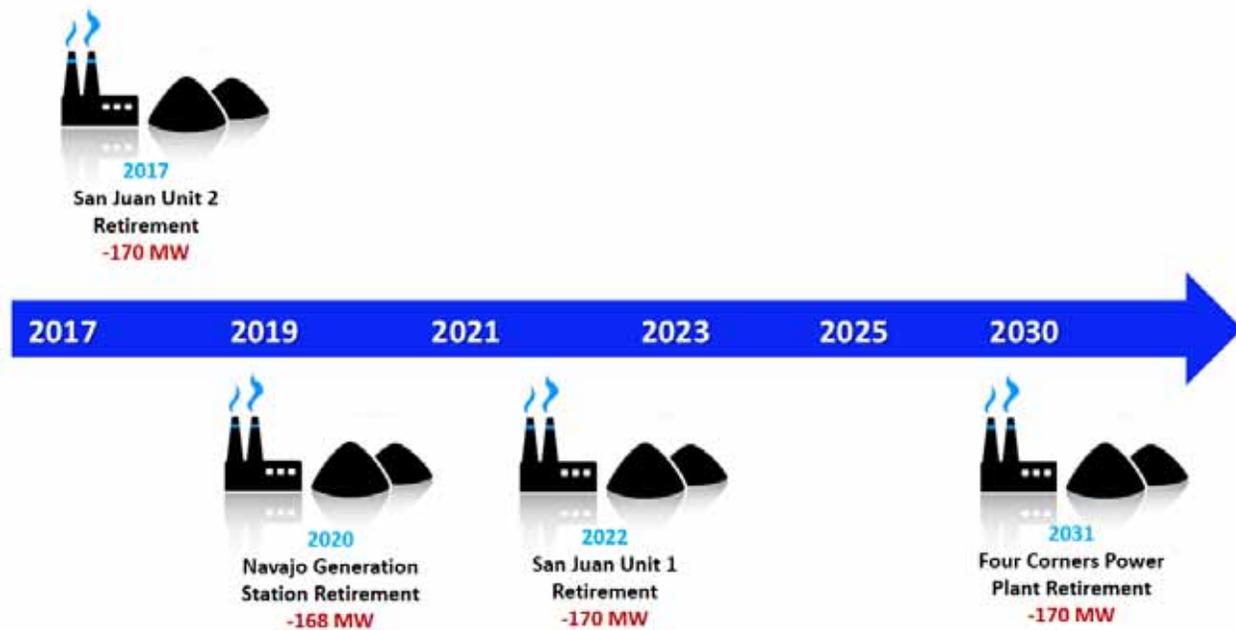

¹ On March 16, 2107, PNM announced that their current IRP analysis concluded that retiring the remaining two units at the San Juan Generating Station in the Farmington area in 2022 could provide long-term benefits for its customers: <https://www.pnm.com/031617-irp>


² As part of the 2014 IRP analysis, TEP avoided approximately \$165 in pollution controls with its commitment to retire San Juan Unit 2 at the end of 2017. In the 2017 IRP analysis, TEP’s customers will realize an additional net present value savings of approximately \$179 million related to the retirement of TEP’s ownership interest in Navajo at the end of 2019 and the retirement of TEP’s ownership interest in San Juan Unit 1 at the end of June 2022.

³ The retirement of both Navajo and San Juan Units 1 and 2 results in reductions in TEP’s total system emissions of 15.8% for carbon dioxide (CO₂), 29.8% for nitrous oxides (NO_x), and 9.8% for sulfur dioxide (SO₂). In addition, the retirement of the Navajo and San Juan units show water consumption is reduced by approximately 2,599 acre feet per year, an overall savings of 16.18%.

Renewable Energy Integration and Diversification

TEP will continue to expand its portfolio of renewable energy resources as a component of our overall resource diversification plan as well as our targeted goal of serving 30% of retail load with renewable energy by 2030. As TEP expands its renewable energy portfolio, the Company continues to evaluate the most cost-effective options available. The Company expects to have a higher percentage of solar resources, primarily due to favorable production curves, low costs, and lack of available transmission to import other resources. TEP's resource mix will also include large scale wind resources in eastern Arizona and New Mexico that are able to utilize existing transmission facilities, including expected available capacity from planned plant retirements, and new large regional transmission projects.

TEP's renewable energy target will come with its own set of challenges and will require TEP to transition to a more flexible and responsive generation portfolio. Utility-scale solar PV that is tied to the distribution grid has substantial benefits, and if properly planned and sited may contribute to reduced line losses, apportioned capacity reductions (generation and transmission), along with environmental benefits. However, a large accumulation of solar PV in TEP's portfolio introduces operational challenges at certain times of the year as illustrated in the figure below, showing a hypothetical 2030 winter day.

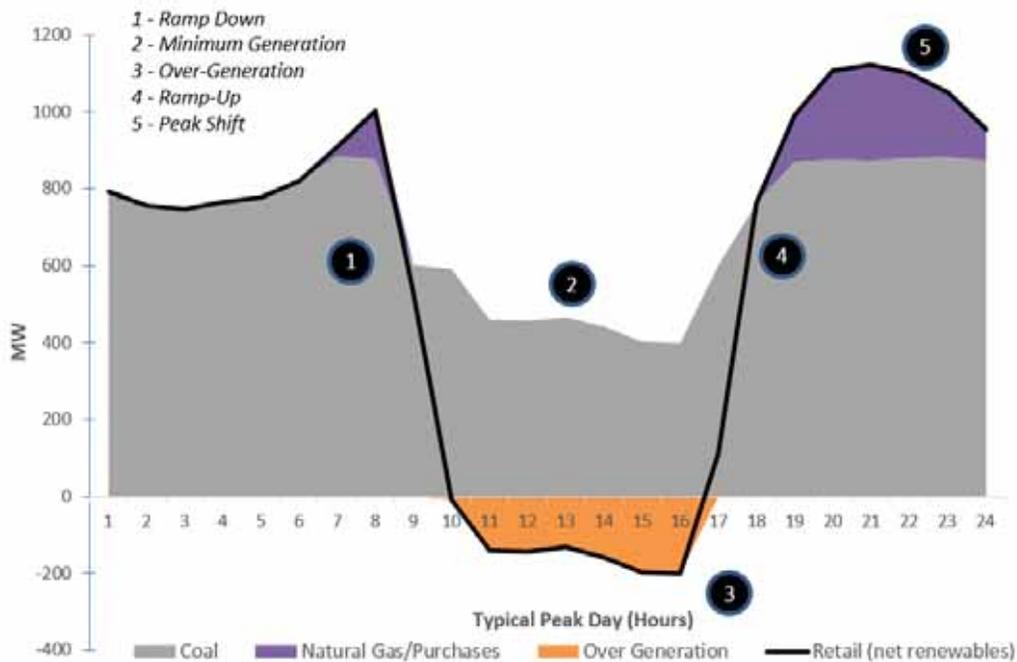

TEP's portfolio must have the capability to accommodate the rapid ramping requirements (up and down) that occur on certain days, and strategies are needed to take advantage of the over generation that may occur.

Initially, Arizona's clean energy standards relating to renewable energy and energy efficiency provided the catalyst for these dramatic changes. Going forward, future clean energy targets should be developed on a utility-by-utility basis. While these standards have produced real and tangible benefits, clean energy standards applied at a statewide level are inherently inflexible, and fail to take into account the unique circumstances of each utility. This inflexibility creates inefficiencies in resource acquisitions and system dispatch, which ultimately results in higher costs passed on to customers. TEP believes that the IRP is a better mechanism to develop utility-specific clean energy targets than a state-wide, "one size fits all" rulemaking. The IRP provides

the most holistic consideration of the very goals that clean energy standards aim to achieve, while balancing the cost of achieving those goals for our customers.

Grid Balancing Resources

As part of TEP's 2017 Reference Case Plan, planned energy storage systems will play a greater role in the integration of more renewable energy into TEP's resource portfolio. These energy storage systems will be readily available to provide ancillary power services such as frequency response, regulation and voltage support that are more challenging to maintain under the demands of a system with high levels of renewable energy penetration.

In addition, new fast start, fast ramping thermal resources with mechanical inertia will also have to be added in order to help balance grid operations. Reciprocating internal combustion engines (RICEs) are fast response resources designed to flexibly dispatch to meet changes in load and can provide 100% of their effective load carrying capability (ELCC) during peak periods. These units are not degraded by the number of start-ups, as are combustion turbines, and they are capable of running at an efficient heat rate even at 30% of their designed capacity. A 10 MW unit can idle down to 3 MWs under spin and stand ready to react to system disturbances or renewable intermittent variability as needed.⁴

Under today's Direct Load Control (DLC) programs, TEP is able to rely on approximately 12 MW of interruptible commercial and industrial loads to reduce summer peaking capacity requirements. As part of the 2017 IRP Reference Plan, TEP plans to evaluate the cost-effectiveness of future DLC programs. Future DLC programs will be proposed as part of the Company's annual EE implementation filings. In order to achieve higher levels of DLC, TEP would likely need to expand its DLC program design beyond the Commercial and Industrial sectors. Going forward, rather than focusing specifically on summer peaking requirements, TEP intends to transition from conventional peak shaving demand response (DR) programs to more advanced DR programs⁵ that are capable of cost-effectively addressing grid balancing needs such as short-run ramps and disturbances at timescales ranging from seconds up to an hour, throughout the year.

Smart Grid Operations

The adoption of new grid balancing resources will play a major role in providing TEP's Balancing Authority (BA) with the tools needed to maintain system reliability with higher levels of intermittent resources. In addition, as part of the 2017 Reference Case Plan, TEP is preparing its future grid operations to accommodate higher levels of distributed energy resources and other smart grid innovations through the use of smart digital networks. This strategy is much different than how the distribution system has been managed in the past. At the core of these smart network changes is the need for a digital communications network that will allow for intelligent electronic devices to be installed on the distribution system by both customers and the utility. This communication network will be managed through the use of a distribution management system (DMS) that will process the information from these devices and make decisions in a manner that optimizes grid operations for the benefit of the utility and its customers.

⁴ As part of this current resource planning cycle, TEP conducted a Flexible Generation Technology Assessment (See Appendix B). The results of this study indicate that the RICE technology is the preferred resource that will provide capacity and assist in mitigating renewable energy intermittency and variability. TEP plans to move forward with a generating resource modernization plan at Sundt over the next few years to integrate these fast start, fast resources in the 2020 and 2022 timeframes.

⁵ Lawrence Berkeley National Laboratory. California Demand Response Potential Study - Charting California's Demand Response Future, November 2016. <http://www.cpuc.ca.gov/WorkArea/DownloadAsset.aspx?id=6442451541>

Regional Infrastructure Projects

TEP is poised to take advantage of several large energy-related infrastructure projects that are developing in the southwestern United States. There are three large transmission projects proposed for interconnection in eastern and southeastern Arizona that may influence TEP's long-term resource planning decisions.

The SunZia Southwest Transmission Project ("SunZia") is a proposed double-circuit 500 kV line that will originate in central New Mexico at a proposed substation near Ancho, New Mexico and terminate at the proposed Pinal Central substation near Casa Grande, Arizona. Another proposed project, the Southline Transmission Project, has a new build portion and an upgrade portion. The new build section would involve the construction of approximately 240 miles of new 345kV double-circuit electric transmission lines in New Mexico and Arizona. The upgrade section is a double-circuit 230-kV lines connecting the Apache Substation to the existing Saguaro Substation northwest of Tucson, Arizona. Additionally, the proposed Western Spirit Clean Line will collect renewable power from east-central New Mexico and deliver it via an approximately 140-mile transmission line to the existing electric grid in northwestern New Mexico where it interconnects with the TEP transmission system at San Juan.

Each of these projects, should they be built, would offer TEP an opportunity to tap into high capacity wind sites in New Mexico as well as large solar facilities located along the route.

In addition, TEP and UNS Electric are involved in the development of the Nogales Interconnection Project, a proposed direct current interconnection, which will allow for an asynchronous interconnection between the electric grids in southern Arizona and the northwest region of Mexico. The project will support the reliability of the electric system, including providing bidirectional power flow and voltage support, as well as emergency assistance, as needed, for the electric systems both north and south of the border.

Transformation of Desert Southwest Wholesale Power Markets

Energy Imbalance Markets (EIMs) are designed to create a market opportunity for balancing loads and resources given the intermittent characteristics of wind and solar resources. An EIM can aggregate the variability of resources across much larger footprints than current balancing authorities and across multiple balancing authority areas. The sub hourly clearing, in some cases down to 5 minutes, potentially provides economic advantage to participants in the market.

In 2014, PacifiCorp joined the California Independent System Operator (CAISO) EIM, and since that time several other utilities including Arizona Public Service have joined or committed to join by a certain date. Participants in the EIM expect to realize at least three benefits:

- ▶ Produce economic savings to customers through lower production costs
- ▶ Improve visibility and situational awareness for system operations in the Western Interconnection
- ▶ Improve integration of renewable resources

TEP contracted with the energy consulting firm E3 to perform a study to evaluate the economic benefits of TEP participating in the energy imbalance market. The project analysis began in February 2016 and was completed in December, 2016. Based on the results of the E3 study TEP estimates an annual benefit of approximately \$2.5 million. However, it is expected that this benefit will diminish over time. TEP has started the process of determining the relevant costs associated with joining the CAISO EIM market as well as evaluating what other western EIM market options may be available.

Regional Transmission Organizations


Seeing a need for greater coordination, a “Working Group” consisting of investor owned utilities, cooperative power providers and public power entities was formed to consider and analyze potential alternatives to joining the CAISO EIM. The objectives of the Working Group are as follows:

- ▶ Determine economic benefits of potential alternatives and weigh opportunities for market participation
- ▶ Determine if the CAISO EIM and regulated markets in the Midwest and Mountain west offer certain economic benefits related to more efficient utilization of generating assets and transmission infrastructure
- ▶ Evaluate operational benefits especially as they relate to renewable resource integration and system regulation
- ▶ Establish if EIM/Regulated Markets and certain alternatives may offer reliability benefits related to the grid operations
- ▶ Consider governance structure and implications for resource control

The Working Group discussed various options with the CAISO, the Southwest Power Pool, and the Mountain West Transmission Group. Currently there is recognizable value to establishing a regional market. However, the cost of joining or establishing a regional market have yet to be determined or fully evaluated. TEP will continue to engage with market operators to determine the best path forward for its customers.

Market Fundamentals


With the rapid increase in renewable resource penetration throughout the region, a transformation of market fundamentals is currently underway and is changing how both load-serving entities and wholesale merchants transact. As shown in the figure below, surplus solar output is causing a downward shift in market prices from the hours of 8 AM to 4 PM.

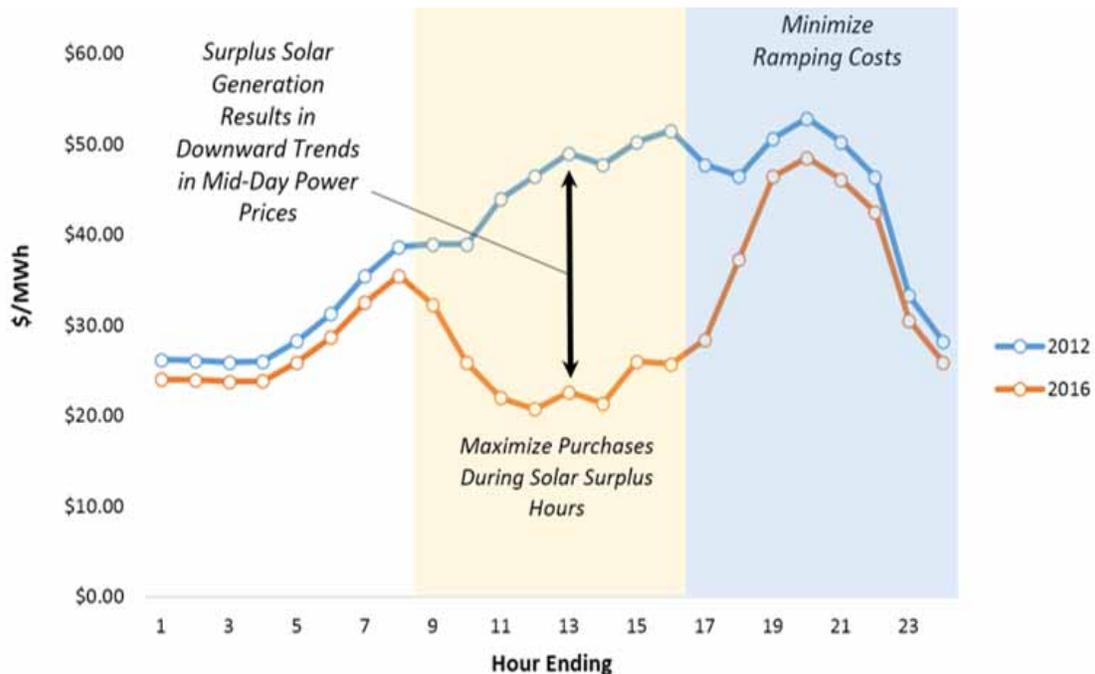

In addition to surplus renewable generation, low cost shale gas production has also played a significant role in transforming the supply and demand economics of natural gas. As we saw in 2015 and 2016, expanded natural gas production from shale formations is directly impacting the economic viability of many baseload coal and nuclear resources. Unlike renewables, most thermal plants like coal and nuclear, have higher operating costs that cannot be fully recovered in the wholesale market. Thus, the ultimate effect of high penetrations of renewables and low cost natural gas will likely be an accelerated retirement of older and higher cost coal and nuclear resources. Alternatively, resources like natural gas combined cycle (NGCC) units that have much lower capital and fixed costs are more competitive than coal and nuclear in today's wholesale power markets. This competitive advantage will likely result in NGCC units displacing many coal and nuclear as baseload resources since they are better positioned to maintain profitability in a market driven by low natural gas prices.

Energy Efficiency

TEP recognizes energy efficiency (EE) as a cost-effective way to reduce our reliance on fossil fuels. To evaluate EE in terms of TEP's overall resource portfolio, TEP determined the hourly savings of each individual EE measure using widely used and recognized third-party load shapes, and then aggregated them at the portfolio-level by customer rate class. From these composite program-level savings, TEP is able to analyze peak periods to determine coincident and non-coincident peak demand savings. The level of energy savings was based on compliance with the EE standard through 2020, excluding program credits, and an estimate of "achievable" EE developed by the Electric Power Research Institute (EPRI) for all years after 2020. Then, to evaluate EE as a resource for replacement of generation, the specific types of measures being implemented are modeled like other resources against the forecasted system load. The figure below provides a sample of how current EE measures interact with TEP's system loads during a typical summer day. Using these results, TEP can target measures that coincide with periods of high ramp rate, period dominated by high cost resources, or the system peaks, both daily and annually.

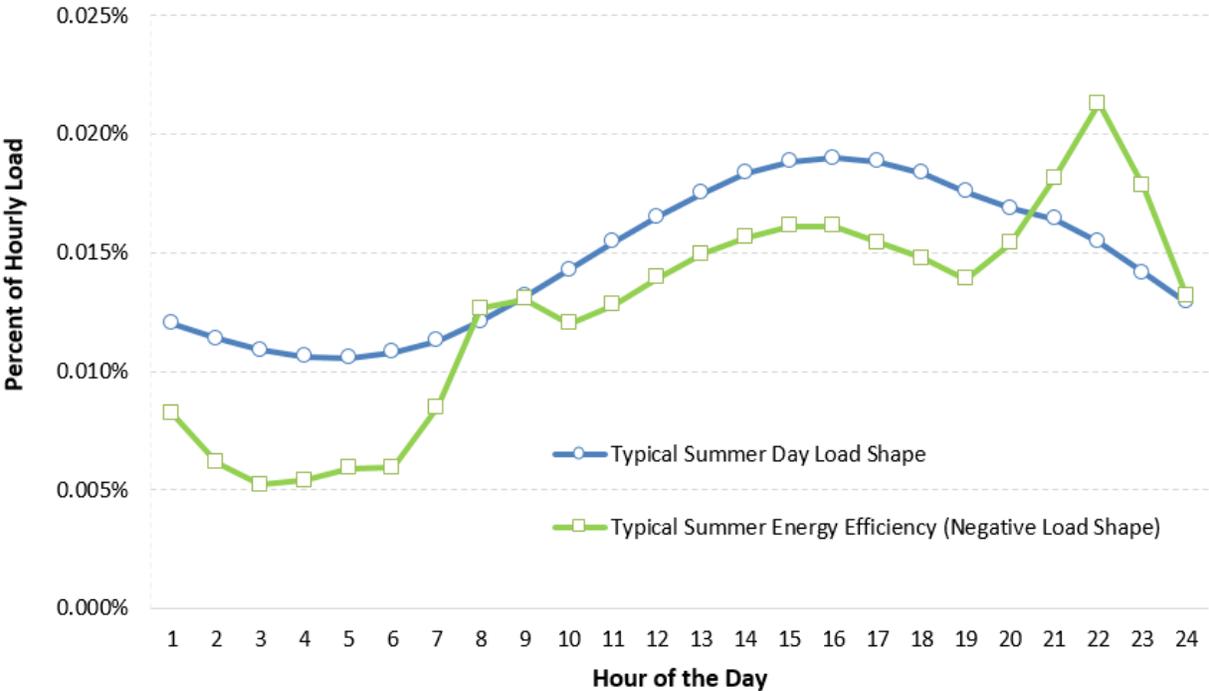

A New Integration Approach to Resource Planning

With the increasing cost-competitiveness of certain renewable resources, many resource planners are in the process of integrating higher levels of renewable technologies as a complement to their existing conventional generation fleet. Because of the unique challenges that high levels of renewable energy place on grid operations, the 2017 IRP takes a new approach in categorizing the capabilities for each type of resource in order to better reflect the role these resources will play as the Company transforms its resource portfolio over the next decade.

- **Load Modifying Resources** – includes EE, distributed generation, and time of use tariffs, whose effects are primarily “behind the meter” and are therefore, largely, if not entirely beyond the view and control of the balancing authority.
- **Renewable Load Serving Resources** – include both utility scale solar and wind technologies.
- **Conventional Load Serving Resources** – include coal, nuclear and natural gas technologies that are fully dispatchable and are used to supply the vast majority of the energy needed to meet load
- **Grid Balancing Resources** – include natural gas combustion turbines, demand response, natural gas reciprocating engines and storage technologies that are fast ramping and flexible, as needed to maintain grid reliability.

The table below provides a brief overview of the types of resources that will be included and evaluated in the resource planning process within the 2017 IRP.

Category	Type	Zero Carbon Production	State of Technology	Primary Use	Dispatchable by Balancing Authority
Load Modifying Resources	Energy Efficiency	Yes	Mature	Base Load Reduction	No
	Distributed Generation	Yes	Mature	Intermediate Load Reduction	No
	Rate Design	(1)	Mature	Targeted Load Usage / Reductions	No
Load Serving Renewable Resources	Wind	Yes	Mature	Intermediate Generation	No
	Solar	Yes	Mature	Intermediate Generation	No
Load Serving Conventional Resources	Natural Gas Combined Cycle	No	Mature	Base Load Generation	Yes
	Pulverized Coal	No	Mature	Base Load Generation	Yes
	Small Modular Nuclear (SMR)	Yes	Emerging	Base Load Generation	Yes
Grid Balancing Resources	Reciprocating Engines	No	Mature	5 - 10 Minute Ramping	Yes
	Combustion Turbines	No	Mature	10 - 15 Minute Ramping	Yes
	Pumped Hydro Storage	(1)	Mature	1 Minute Ramping	Yes
	Demand Response	Yes	Mature	1 Minute Ramping	Yes
	Battery Storage	(1)	Emerging	1 Second Ramping	Yes

(1) Carbon intensity is dependent upon the resources that would be displaced by this rate tariff or storage technology net of charging.

Summary of the 2017 IRP Reference Case Plan

TEP's 2017 IRP Reference Case Plan continues the Company's long-term strategy of resource diversification by taking advantage of near-term opportunities to reduce its coal capacity, expanding the deployment of renewable energy resources with a target of serving 30% of its retail load using renewable energy by 2030, continued development and implementation of cost-effective EE measures, and the addition of high-efficiency natural gas resources.

Planned Coal Plant Retirements

In September 2016, TEP acquired the remaining 50.5% share of Springerville Generating Station ("Springerville") Unit 1, bringing our total capacity at Springerville to 793 MW with full ownership and operational control of Units 1 and 2. By 2018, TEP anticipates that it will reduce its coal capacity at San Juan from 340 MW to 170 MW with the retirement of San Juan Unit 2. TEP will further reduce its overall coal capacity by 168 MW with the recently announced retirement of the Navajo at the end of 2019.⁶ Finally, TEP plans to exit San Juan entirely when the current coal supply agreement ends in June 2022.

Planned Renewable Resource Additions

The 2017 Reference Case Plan includes two renewable energy projects that are planned to come online in 2019. These projects consist of 100 MW of wind and 100 MW_{dc} of solar PV that are currently in procurement as 20-year Purchased Power Agreements (PPAs). An additional 800 MW of renewable capacity is planned to be added to the system between 2023 and 2030, consisting of a diversified mix of solar PV (fixed axis and single-axis tracking), and wind.

Planned Grid Balancing Resources


To support the system in light of this high penetration in intermittent renewable energy, and to provide replacement capacity for the retirement of older, less efficient natural gas steam units at Sundt (Units 1 and 2), it is assumed that TEP constructs approximately 192 MW of natural gas fired RICEs between 2020 and 2022. Moreover, a number energy storage projects are planned to come on line between 2019 and 2021 to provide additional renewable energy support and other ancillary services. These systems would likely be sized as 50 MW projects with a storage discharge capacity of 50 MWh.

Planned Energy Efficiency Commitments


TEP's EE programs will continue to comply with the Arizona Energy Efficiency Standard that targets a cumulative energy savings of 22 % by 2020. From 2021 through the end of the planning period, the estimated annual savings in the 2017 Reference Case Plan are based on an assessment of "achievable potential" in energy savings from EE programs conducted by the EPRI. By 2032, this offset to future retail load growth is expected to reduce TEP's annual energy requirements by approximately 1,894 GWh and reduce TEP's system peak demand by 318 MW. A timeline of TEP's Reference Case Plan is presented below.

⁶ The 2019 retirement date is dependent upon receiving an extension of the lease agreement to allow for plant decommissioning prior to expiration of the lease. Without an extension of the current lease, plant closure would need to take place as early as this year to allow for decommissioning by the end of 2019.


TEP's 2017 IRP Reference Case Plan
Milestone Timeline

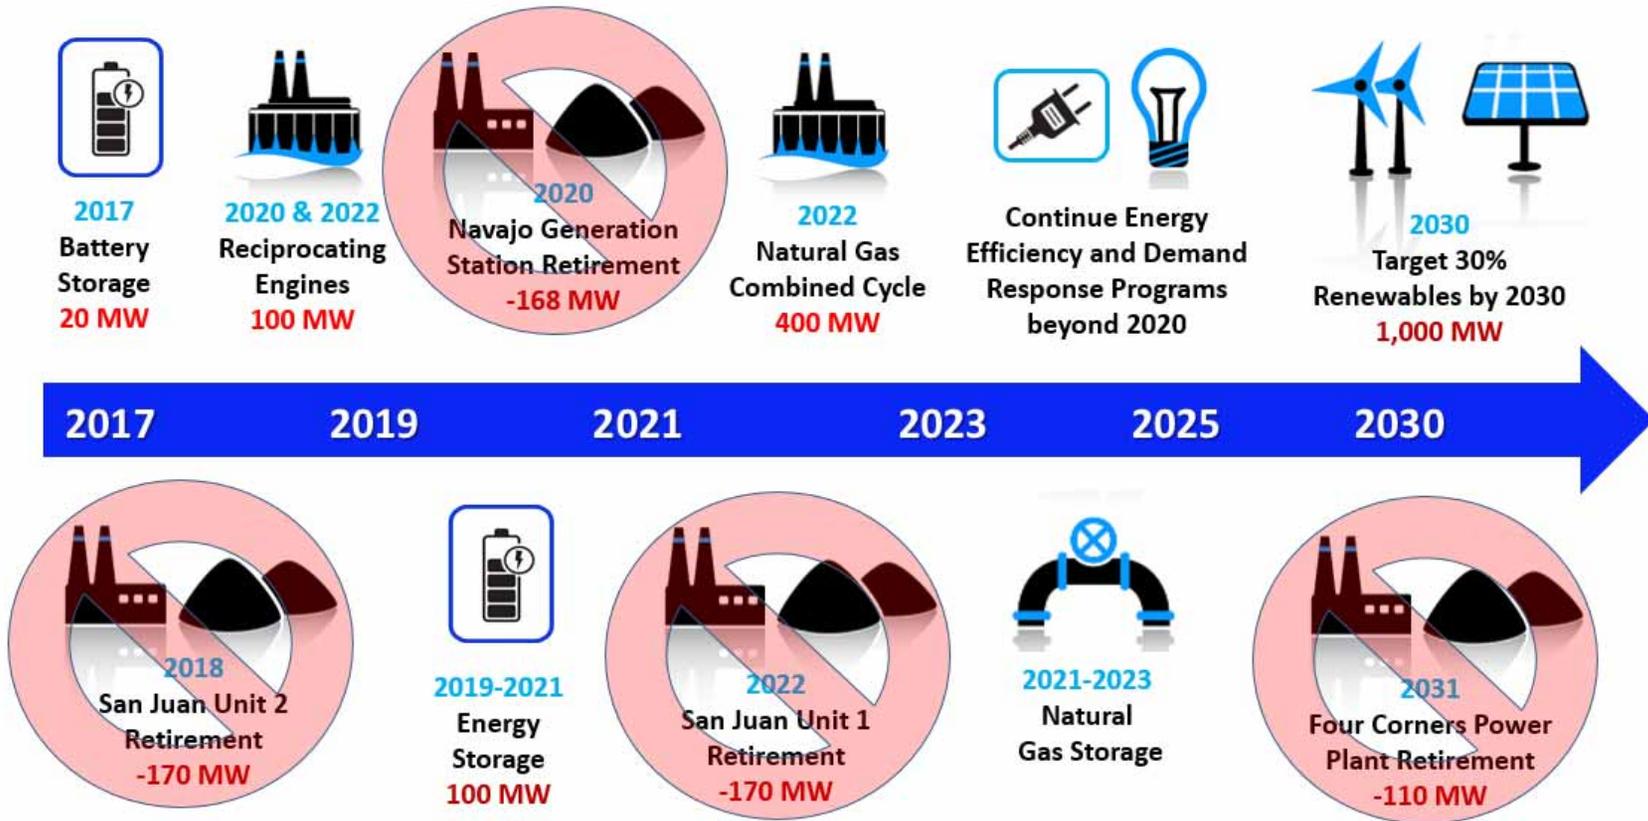

TEP's 2017 Reference Case Plan - Energy Mix by Year (GWh)

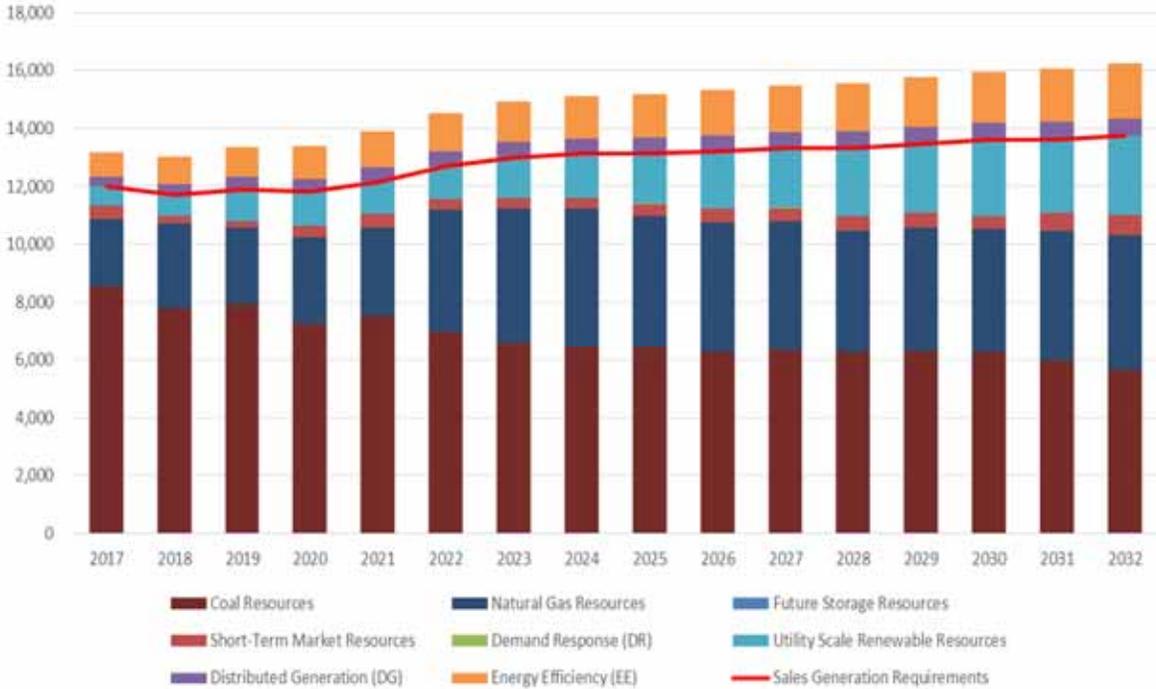


TEP's 2017 Reference Case Plan - Capacity Mix by Year (MW)

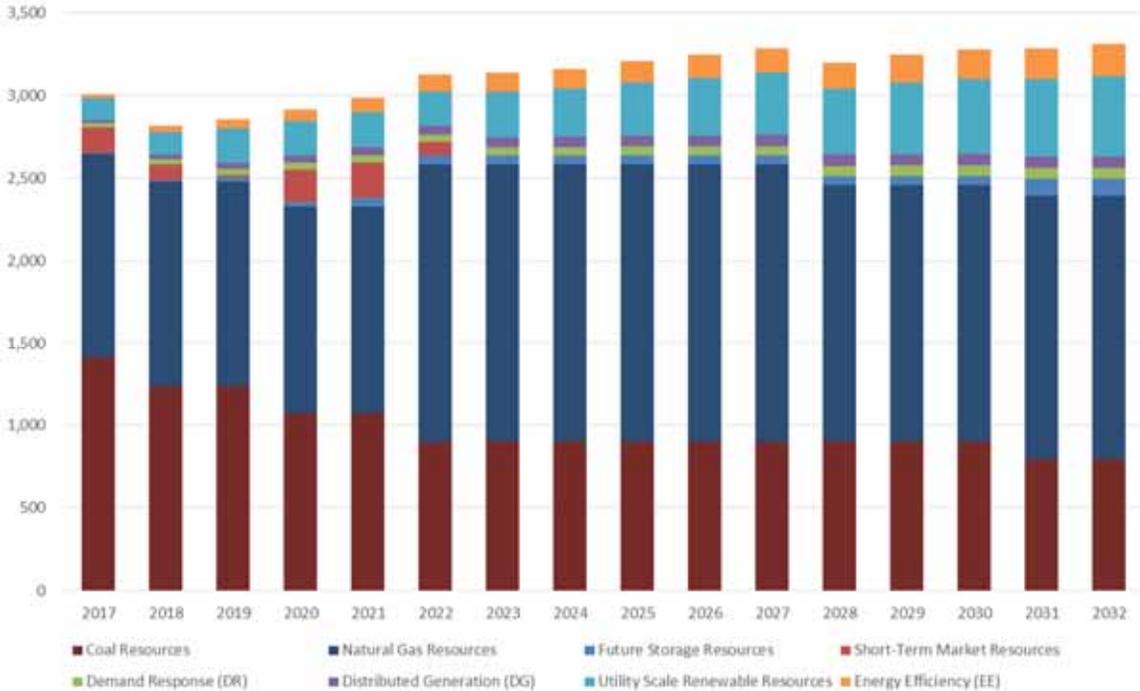


TEP's 2017 Reference Case Plan – Portfolio Energy Mix


2017 Portfolio Energy Mix

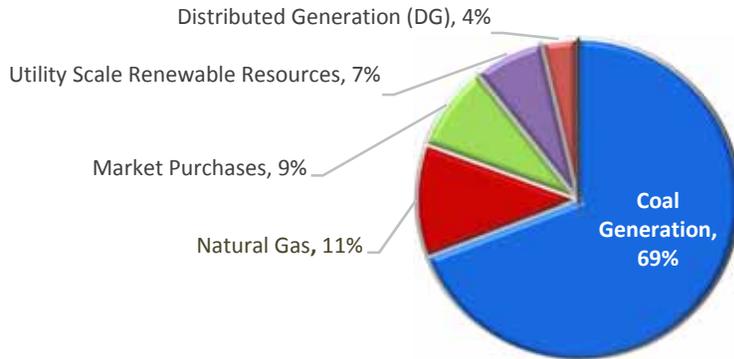

2023 Portfolio Energy Mix

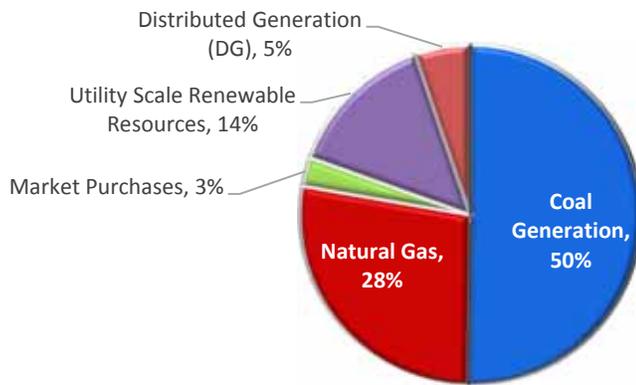

2032 Portfolio Energy Mix

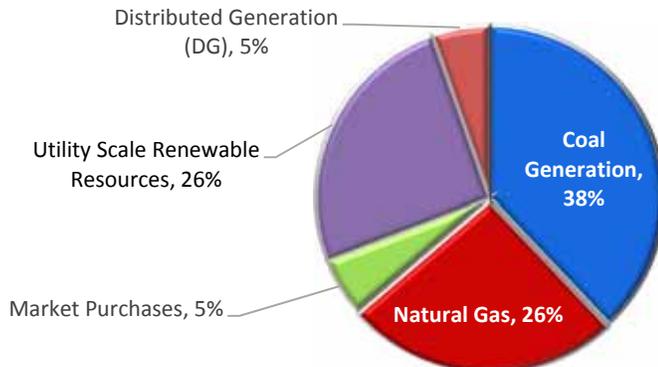

The portfolio energy charts shown above represents the energy resource mix to serve TEP's retail customers. Wholesale market sales are excluded from these results. By 2030, TEP's retail customers will be served from 30% renewables. This is based on a combination of utility-scale and distributed generation resources.

CHAPTER 2**ENERGY DEMAND AND USE PATTERNS****Load Forecast**

In the IRP process it is crucial to estimate the load obligations that existing and future resources will be required to meet for both short and long term planning horizons. As a first step in the development of the resource plan, a long term load forecast was produced. This chapter provides an overview of the anticipated long term load obligations at TEP, a discussion of the methodology and data sources used in the forecasting process, and a summary of the tools used to deal with the inherent uncertainty surrounding a number of key forecast inputs.


The sections in this chapter include:

- ▶ **Company Overview:** TEP geographical service territory, customer base, and energy consumption by rate class
- ▶ **Reference Case Forecast:** An overview of the Reference Case forecast of energy and peak demand used in the planning process
- ▶ **Wholesale Obligations:** An outline of the firm system requirements for wholesale electricity sales
- ▶ **Summary:** Compilation of results from this analysis

Geographical Location and Customer Base

TEP currently provides electricity to more than 420,000 customers in the Tucson metropolitan area (Pima County). Pima County has maintained positive growth over the last decade and is now estimated to have a population of approximately 1,000,000 people.


Map 1 - Service Area of Tucson Electric Power and UES Utilities

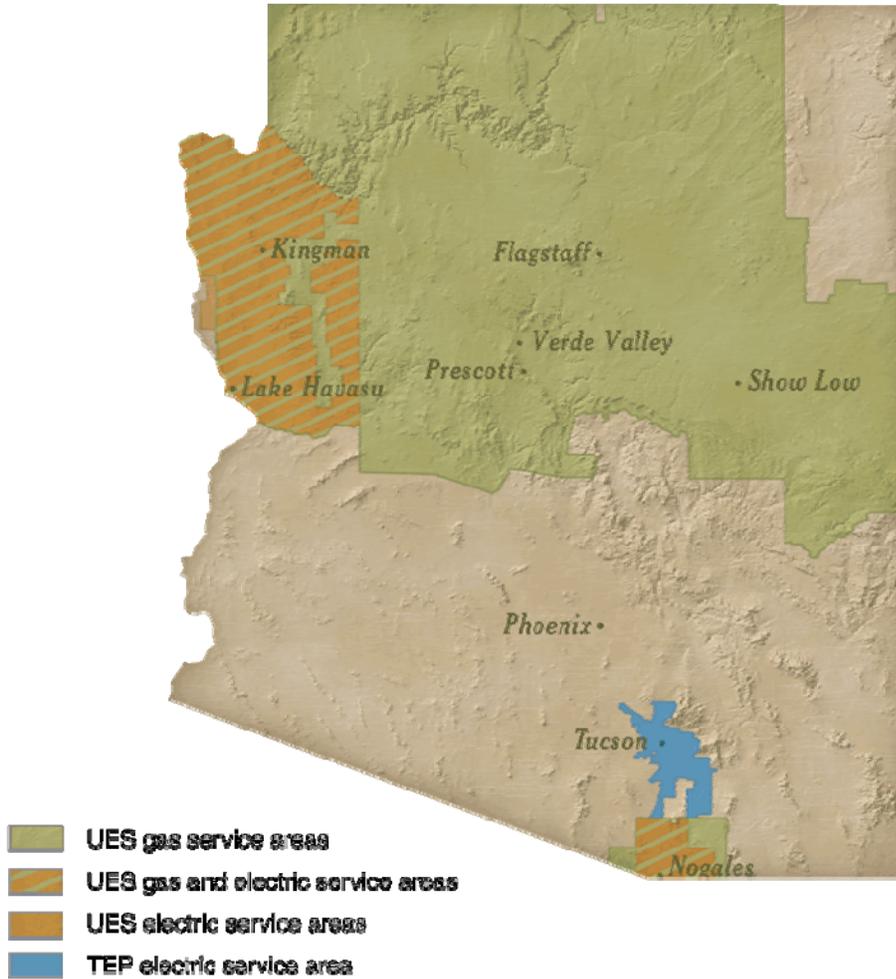

Customer Growth

In recent years population growth in Pima County and customer growth at TEP have slowed dramatically as a result of the severe recession and weak recovery. While customer growth is currently rebounding from its recessionary lows, it is not expected to return to its pre-recession level. Chart 1 outlines the historical (blue bars) and expected (green bars) customer count and corresponding growth in the residential rate class from 2000-2032. As customer growth is the largest factor behind growth in TEP’s load, the continuing customer growth will necessitate additional resources to serve the increased load in the medium term.


Chart 1 - Estimated TEP Customer Growth 2000-2032

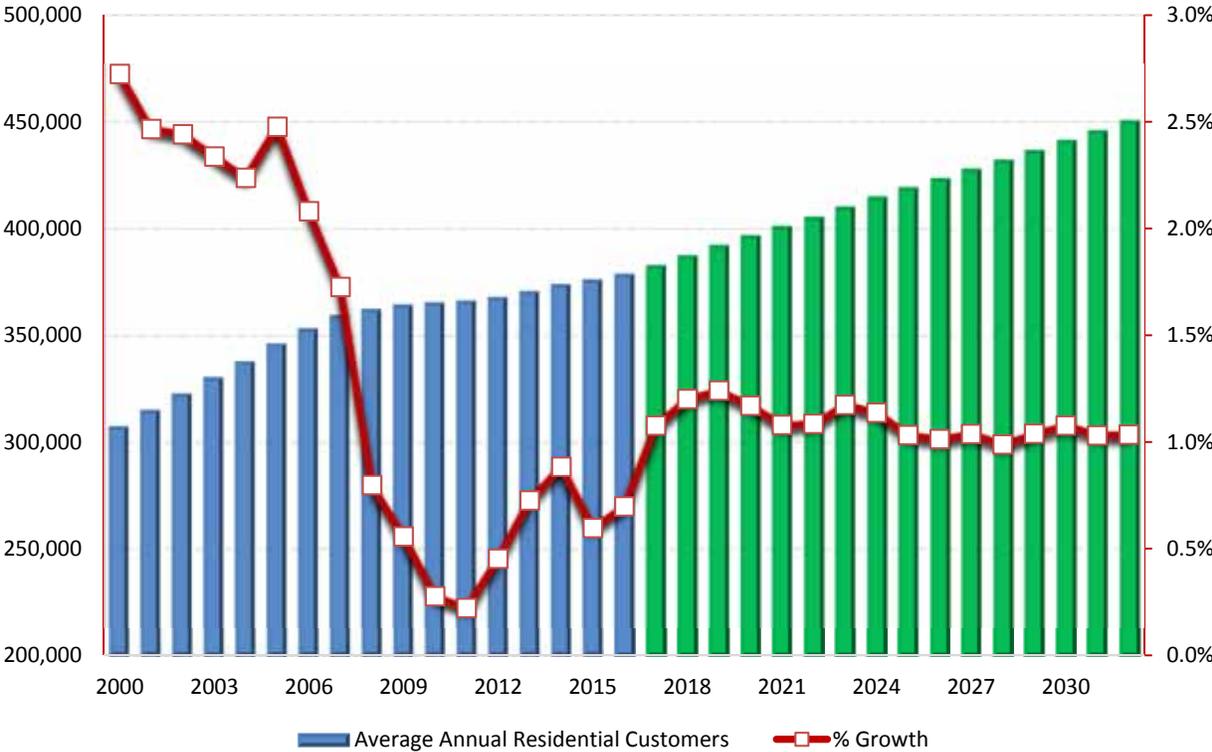

Retail Sales by Rate Class

In 2016, TEP experienced a peak demand of approximately 2,278 MW, with approximately 8,900 GWh of retail sales. Approximately 66% of 2016 retail energy was sold to the residential and commercial rate classes, with approximately 34% sold to the industrial and mining rate classes. Customer classes such as municipal street lighting, etc. accounted for the remaining sales. Chart 2 gives a detailed breakdown of the estimated 2017 retail sales by rate class.

Chart 2 - Estimated 2017 Retail Sales (GWh) % by Rate Class

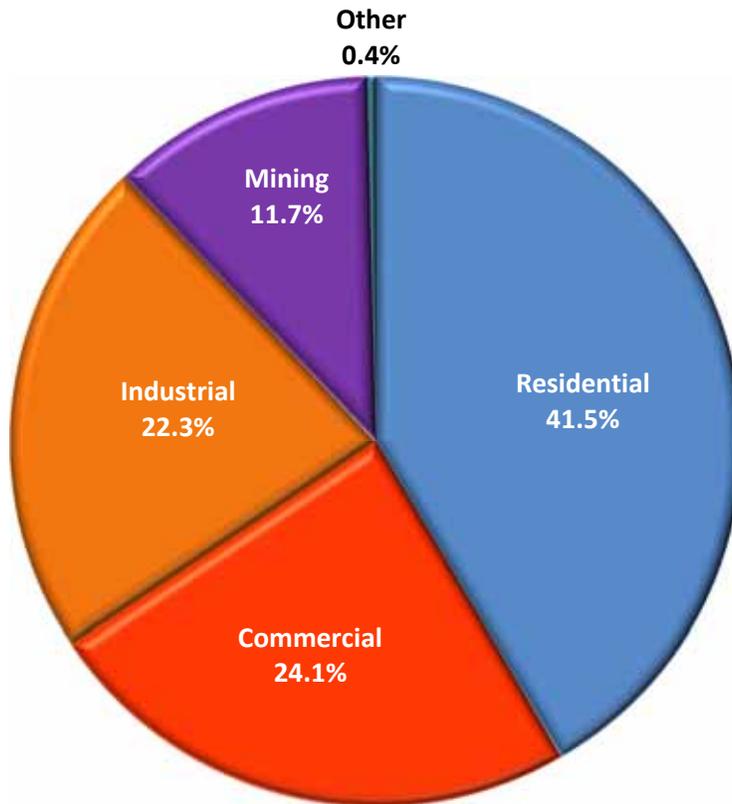

Reference Case Forecast

Methodology

The load forecast used in the TEP IRP process was produced using a “bottom up” approach. A separate monthly energy forecast was prepared for each of the major rate classes (residential, commercial, industrial, and mining). As the factors impacting usage in each of the rate classes vary significantly, the methodology used to produce the individual rate class forecasts also varies. However, the individual methodologies fall into two broad categories:

- 1) For the residential and commercial classes, forecasts were produced using statistical models. Inputs include factors such as historical usage, weather (e.g. average temperature and dew point), demographic forecasts (e.g. population growth), and economic conditions (e.g. Gross County Product and disposable income).
- 2) For the industrial and mining classes, forecasts were produced for each individual customer. Inputs include historical usage patterns, information from the customers themselves (e.g. timing and scope of expanded operations), and information from internal company resources working closely with the mining and industrial customers.


After the individual monthly forecasts were produced, they were aggregated (along with any remaining miscellaneous consumption falling outside the major categories) to produce a monthly energy forecast for the company.

After the monthly energy forecast for the company was produced, the anticipated monthly energy consumption was used as an input for another statistical model used to estimate the peak demand. The peak demand model is based on historical relationship between hourly load and weather, calendar effects, and sales growth. Once these relationships are estimated, 60+ years of historical weather scenarios are simulated to generate a probabilistic peak forecast.

Reference Case Retail Energy Forecast

As illustrated in Chart 3, after a period of relatively rapid growth from 2005 – 2008, TEP’s weather-normalized retail energy sales fell significantly from 2008 – 2016. As commodity prices remain weak, retail sales are expected to continue to decline through 2017. As commodity prices begin to return to historical averages in 2020, mining load is expected to return to historical values and expand with the Rosemont mine project. After 2024 the growth in sales is dominated by residential and commercial sales growth at a level that is far slower than the pre-great recession historical average.


Chart 3 - Reference Case Retail Energy Sales, Weather Normalized Historical

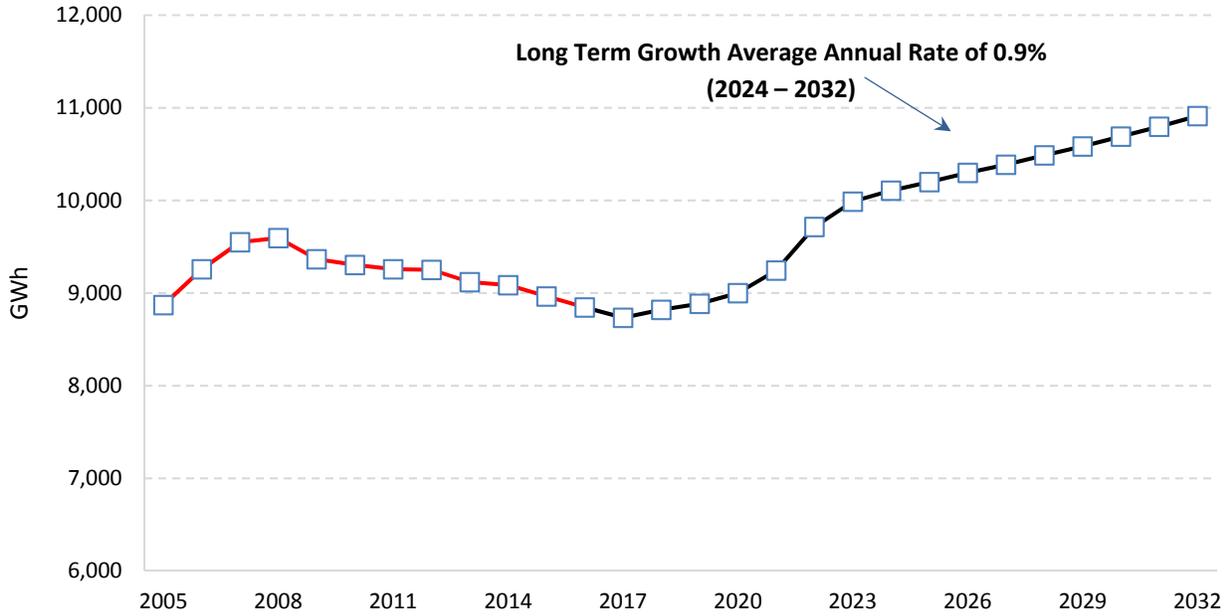

Reference Case Retail Energy Forecast by Rate Class

As illustrated in Chart 4, the Reference Case forecast assumes significant short term changes for the next few years followed by slow, steady growth starting in 2024. However, the growth rates vary significantly by rate class. The energy sales trends for each major rate class are detailed in Chart 4.

Chart 4 - Reference Case Retail Energy Sales by Rate Class (GWh)

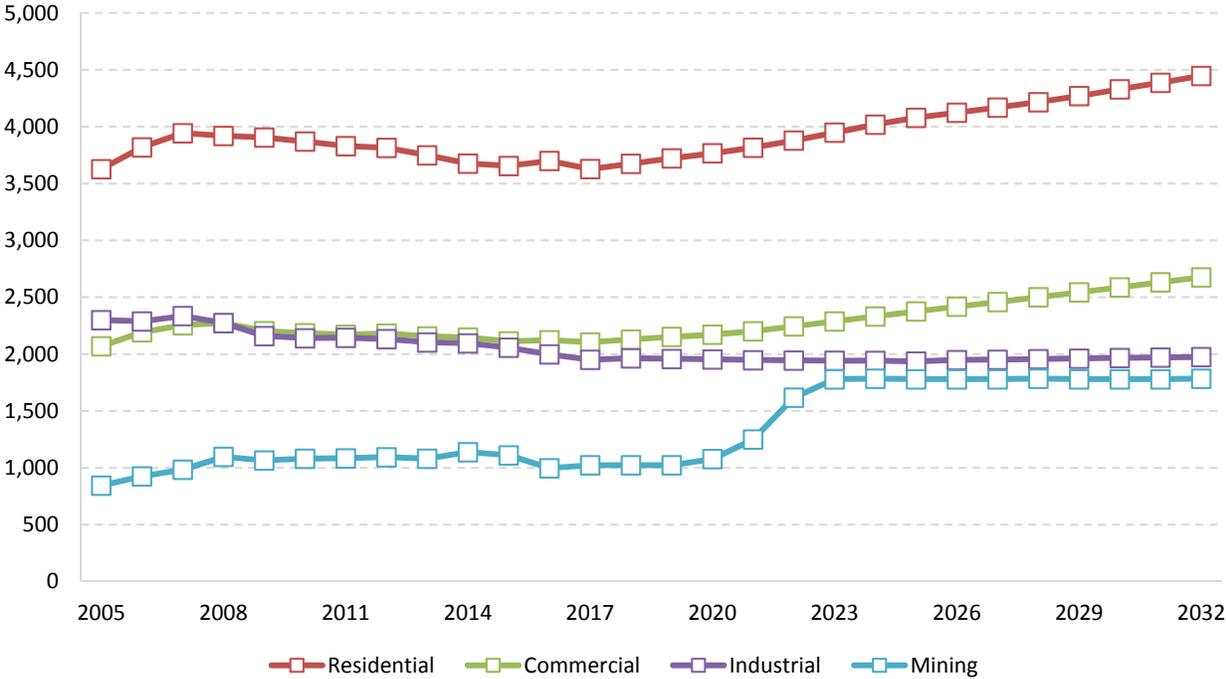


After experiencing consistent year over year growth throughout the past, both residential and commercial energy sales fell or remained flat from 2008-2016. Both are assumed in the Reference Case to increase steadily after 2017. However, industrial energy sales are assumed to increase much more slowly than those in either the residential or commercial classes. In addition, mining sales are assumed to significantly fall in the coming years due to low commodity prices. As these prices return to more historical averages, the current mining customers are forecast to return to normal operations, as well as expand due to the Rosemont mine project.

Reference Case Peak Demand Forecast

As show in Chart 5 below, demand is expected to drop in 2017. This is largely caused by the mining class curtailing load and an expected return of more normal peak weather. As the mining class rebounds and the residential and commercial classes grow slowly and steadily, the retail peak demand is expected to grow. The red and blue dashed lines represent extreme weather cases and are set at a one-in-ten year weather anomaly.

Chart 5 - Reference Case Peak Demand (MW)

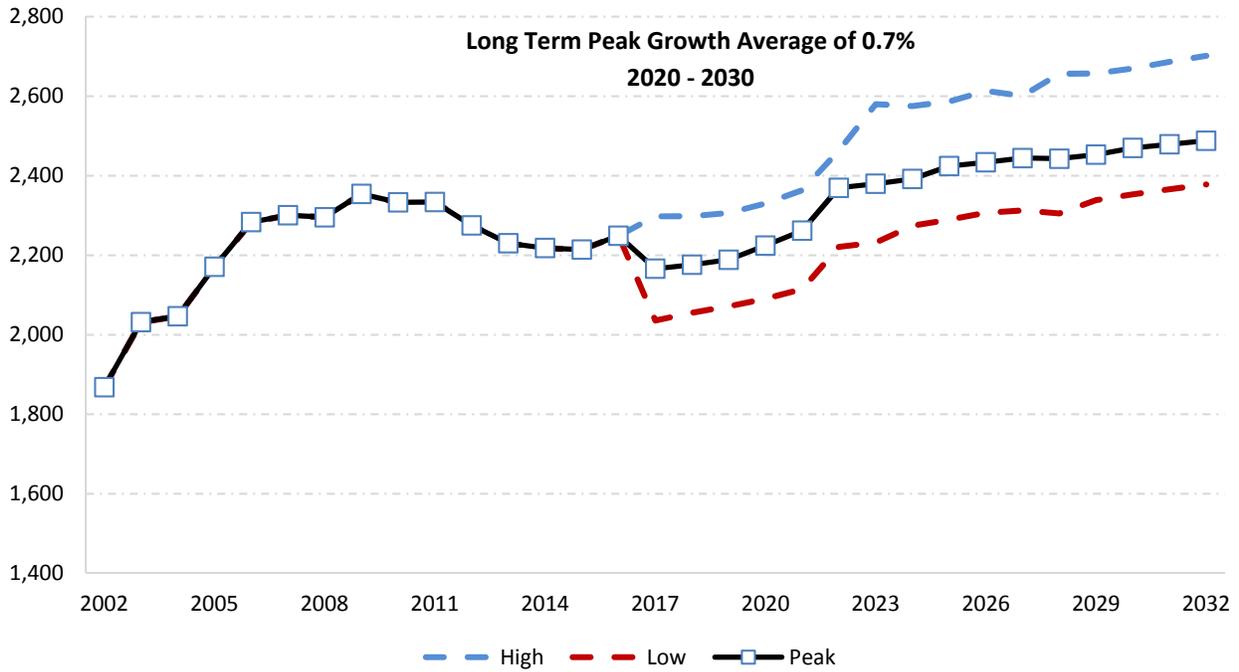

Data Sources Used in Forecasting Process

As outlined above, the Reference Case forecast requires a broad range of inputs (demographic, economic, weather, etc.) For internal forecasting processes, TEP utilizes a number of sources for these data:

- ▶ IHS Global Insight
- ▶ The University of Arizona Forecasting Project
- ▶ Arizona Department of Commerce
- ▶ U.S. Census Bureau
- ▶ National Oceanic and Atmospheric Administration
- ▶ Weather Underground Forecasting Service

Risks to Reference Case Forecast and Risk Modeling

As always, there is a large amount of uncertainty with regard to projected load growth. Some, but certainly not all, of the key risks to the current forecast include:

- ▶ Strength and timing of the economic recovery
- ▶ Possible structural changes to customer behavior (i.e. do post-recession customers have consumption patterns different from those seen pre-recession?)
- ▶ Volatility in industrial metal prices and associated shifts in mining consumption
- ▶ Efficacy of EE programs (i.e. what percentage of load growth can be offset by demand side management?)
- ▶ Technological innovations (e.g. plug in hybrid vehicle penetration)
- ▶ Volatility in demographic assumptions (e.g. much higher or lower population growth than currently assumed)

Because of the large amount of uncertainty underlying the load forecast, it is crucial to consider the implications to resource planning if TEP experiences significantly lower or higher load growth than projected. For this reason, load growth is one of the fundamental factors considered in the risk analysis process undertaken as part of the 2017 IRP. Specifically, the performance of each potential resource portfolio is analyzed through 100 simulations of potential load growth (along with correlated natural gas and wholesale power prices). A more in depth discussion of this risk analysis process is provided in Chapter 11. In addition to the simulation analysis, a more specific discussion of how resource decisions and timing would be affected in the case of sustained higher or lower loads is provided in the Load Growth Scenarios discussed in Chapter 12.

Firm Wholesale Energy Forecast

TEP is currently under contract to provide firm wholesale energy and capacity to five utility customers. These firm obligations are in addition to TEP's commitment to serve its retail customers. The contracts stipulate energy services to the four entities below:

- ▶ Navajo Tribal Utility Authority (NTUA) through December 2022
- ▶ TRICO Electric Cooperative (TRICO) through December 2024
- ▶ Navopache Electric Cooperative (NEC) through December 2041
- ▶ Tohono O’odham Utility Authority (TOUA) through December 2019
- ▶ Shell Energy North America L.P. (“Shell”) through December 2017

TEP expected firm wholesale obligations are shown in Table 1 below. The contract with Salt River Project (SRP) expired in the spring of 2016; it was not renewed. TEP signed a firm wholesale agreement with NEC in the fall of 2015. Delivery services for NEC began in January 2017. A short-term contract with Shell expires at the end of 2017. It is important to note contract extensions have not been assumed. However, there is a possibility that any or all agreements could be extended. This would obviously require current resource plans to be revised to account for the additional energy sales and peak summer load requirements.

Table 1 - Firm Wholesale Requirements

Firm Wholesale, GWh	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
NTUA	106	110	115	120	125	125	0	0	0	0
TRICO	30	74	75	136	187	229	254	284	0	0
NEC	315	401	401	402	401	401	401	402	401	401
Shell	112	0	0	0	0	0	0	0	0	0
TOUA	26	26	17	0	0	0	0	0	0	0
Total Firm Wholesale	589	611	608	658	713	755	655	686	401	401

Peak Demand, MW	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026
NTUA	25	25	25	25	25	25	0	0	0	0
TRICO	50	85	85	85	85	85	85	85	0	0
NEC	44	44	44	44	44	44	44	44	44	44
Shell	100	0	0	0	0	0	0	0	0	0
TOUA	4	4	4	0	0	0	0	0	0	0
Total Firm Demand	223	158	158	154	154	154	129	129	44	44

Summary of Reference Case Load Forecast

Table 2 below excludes the effects of distributed generation (DG) and EE.

Table 2 - TEP Reference Case Forecast Summary

Retail Sales, GWh	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
Residential	3,627	3,673	3,722	3,766	3,816	3,877	3,947	4,018	4,078	4,122	4,168	4,215	4,269	4,329	4,386	4,444
Commercial	2,103	2,128	2,151	2,171	2,201	2,243	2,287	2,331	2,375	2,417	2,458	2,500	2,544	2,586	2,631	2,677
Industrial	1,949	1,962	1,957	1,953	1,946	1,943	1,941	1,941	1,935	1,948	1,950	1,956	1,960	1,965	1,970	1,976
Mining	1,022	1,022	1,022	1,077	1,249	1,617	1,778	1,783	1,778	1,778	1,778	1,783	1,778	1,778	1,778	1,777
Other	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33
Total Retail	8,734	8,818	8,885	9,000	9,245	9,713	9,986	10,106	10,199	10,298	10,387	10,487	10,584	10,691	10,798	10,907
Residential Sales Growth %	-2.1%	1.3%	1.3%	1.2%	1.3%	1.6%	1.8%	1.8%	1.5%	1.1%	1.1%	1.1%	1.3%	1.4%	1.3%	1.3%
Commercial Sales Growth %	-0.6%	1.2%	1.1%	0.9%	1.4%	1.9%	2.0%	1.9%	1.9%	1.8%	1.7%	1.7%	1.8%	1.7%	1.7%	1.7%
Industrial Sales Growth %	-2.5%	0.7%	-0.3%	-0.2%	-0.4%	-0.2%	-0.1%	0.0%	-0.3%	0.7%	0.1%	0.3%	0.2%	0.3%	0.3%	0.3%
Mining Sales Growth %	2.2%	0.0%	0.0%	5.4%	16.0%	29.5%	10.0%	0.3%	-0.3%	0.0%	0.0%	0.3%	-0.3%	0.0%	0.0%	-0.1%
Other Sales Growth %	6.5%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Total Retail Sales Growth %	-1.3%	1.0%	0.8%	1.3%	2.7%	5.1%	2.8%	1.2%	0.9%	1.0%	0.9%	1.0%	0.9%	1.0%	1.0%	1.0%
Customer Count, 000	424	429	434	439	444	448	453	458	463	467	472	477	481	486	491	496
Firm Wholesale, GWh	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
NTUA	106	110	115	120	125	125	0	0	0	0	0	0	0	0	0	0
TRICO	30	74	75	136	187	229	254	284	0	0	0	0	0	0	0	0
NEC	315	401	401	402	401	401	401	402	401	401	401	402	401	401	401	402
Shell	112	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOUA	26	26	17	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Firm Wholesale	589	611	608	658	713	755	655	686	401	401	401	402	401	401	401	402
Retail Peak Demand, MW	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
Retail Demand	2,220	2,230	2,243	2,280	2,319	2,429	2,440	2,452	2,485	2,495	2,506	2,504	2,515	2,531	2,549	2,565
Retail Demand Growth %	-2.8%	0.5%	0.6%	1.6%	1.7%	4.7%	0.5%	0.5%	1.3%	0.4%	0.4%	-0.1%	0.4%	0.6%	0.7%	0.6%
Firm Wholesale Peak Demand, MW	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
NTUA	25	25	25	25	25	25	0	0	0	0	0	0	0	0	0	0
TRICO	50	85	85	85	85	85	85	85	0	0	0	0	0	0	0	0
NEC	44	44	44	44	44	44	44	44	44	44	44	44	44	44	44	44
Shell	100	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOUA	4	4	4	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Firm Demand	223	158	158	154	154	154	129	129	44							
Total Retail & Firm Wholesale	2,443	2,388	2,401	2,434	2,473	2,583	2,569	2,581	2,529	2,539	2,550	2,548	2,559	2,575	2,593	2,609

Future Drivers that May Influence the Long-Term Load Forecast

In addition to the macro-economic factors that are inherent in long-term load forecasts, future load growth will be influenced by development of emerging technologies and the adoption of customer-driven technologies. One such technology is electric vehicles (EVs). EVs could play a significant role in future years as both a load requirement (charge mode) and a system energy resource (discharge mode). To achieve the most benefit from electric vehicles in terms of grid operations and emission reductions, incentives are needed for daytime workplace charging. A daytime charging incentive would enable customers to take advantage of low cost solar resources during the day while simultaneously providing system discharge benefits to help manage real-time grid requirements.

Furthermore, the utility of the future will be required to accommodate higher levels of distributed energy resources and other grid innovations as the company transitions to a smart digital network. This strategy is much different than how the distribution system has been managed in the past. At the core of these smart network changes is the need for a digital communications network that will allow for intelligent electronic devices to be installed on the distribution system by both customers and the utility. This communication network will be managed through the use of a DMS that will process the information from these devices and make decisions in a manner that optimizes grid operations for the benefit of the utility and its customers.

Finally, rate design will also need to evolve to offer customers more options and choices. Customers may want to have access to real-time pricing tariffs in order to minimize their energy usage during high cost periods. Other customers may want sign up for clean energy tariffs that incentive the use of zero-emission resources such as renewables, DR, and EE. Other customers may want a demand -and energy- based rate tariff that would enable them to take advantage of distributed energy resources and storage technologies. In any case, the ability to collect and manage real-time grid data will be a critical milestone for utilities to achieve in order to provide these types of services for customers in the future.

This next sections discusses some of these evolving technologies and discusses how the Company plans to integrate them over the next few years as part of the on-going IRP planning process.

Electric Vehicles

Nationwide, 2016 plug in electric vehicle sales were 159,139 units⁷ of 1.1 million light vehicles sold⁸ for a 14% market share. Plug in electric vehicles predominantly fall into two categories:

- ▶ Battery Electric Vehicles (BEV) fully electric, battery only vehicles that do not consume fossil fuel
- ▶ Plug-in Electric Vehicles (PEV) which have both an electric motor and an internal combustion engine that burns fossil fuel

Figure 2 – Tesla Model 3

Tesla Model 3:

Does it signal an Electric Car Revolution?

Cost - The base version of the Model 3 will be produced at \$35,000.

Performance - 0-60 in less than 6 seconds in the base version.

Range - The base model with a 50-60 kWh battery - 215 miles per charge.

Charging - Supercharging to near full capacity in 40 minutes compared to multiple hours with other EVs. Regular charging in 5-6 hours from a home charger.



Supercharger Charging Profile
Based on 90 kWh Model S



Note: Data based on Wood-MacKenzie Electric Vehicle Case Study and www.teslamotors.com


⁷ <http://insideevs.com/monthly-plug-in-sales-scorecard/>

⁸ http://online.wsj.com/mdc/public/page/2_3022-autosales.html

An additional class of vehicle, the Hybrid Electric Vehicle (HEV), incorporates electric battery technology similar to a PEV but notably receives its charge via regenerative braking and on-board charging via an internal combustion engine. HEVs represent the largest share of electrified vehicles operating in Arizona at 1.1%, but do not plug in to the electrical grid for charging and therefore are not considered a factor in future load growth scenarios.

Of active vehicles registered in the state of Arizona, just 0.09% (6,260 vehicles) are PEVs or BEVs. Based on the low adoption rate and total number of EVs in Arizona, it is reasonable to assume that EV adoption in the state will continue to lag national high, medium, and low market penetration projections. This IRP contemplates two scenarios, an aggressive growth scenario and moderate base case scenario. Under the base case scenario EV load projections remain below 1% through 2024 and reach 2.5% of load by 2030. The more aggressive scenario reaches 1% by 2021 and ramps up to 5% by 2030.

Figure 3- Electric Vehicle Demand Scenarios

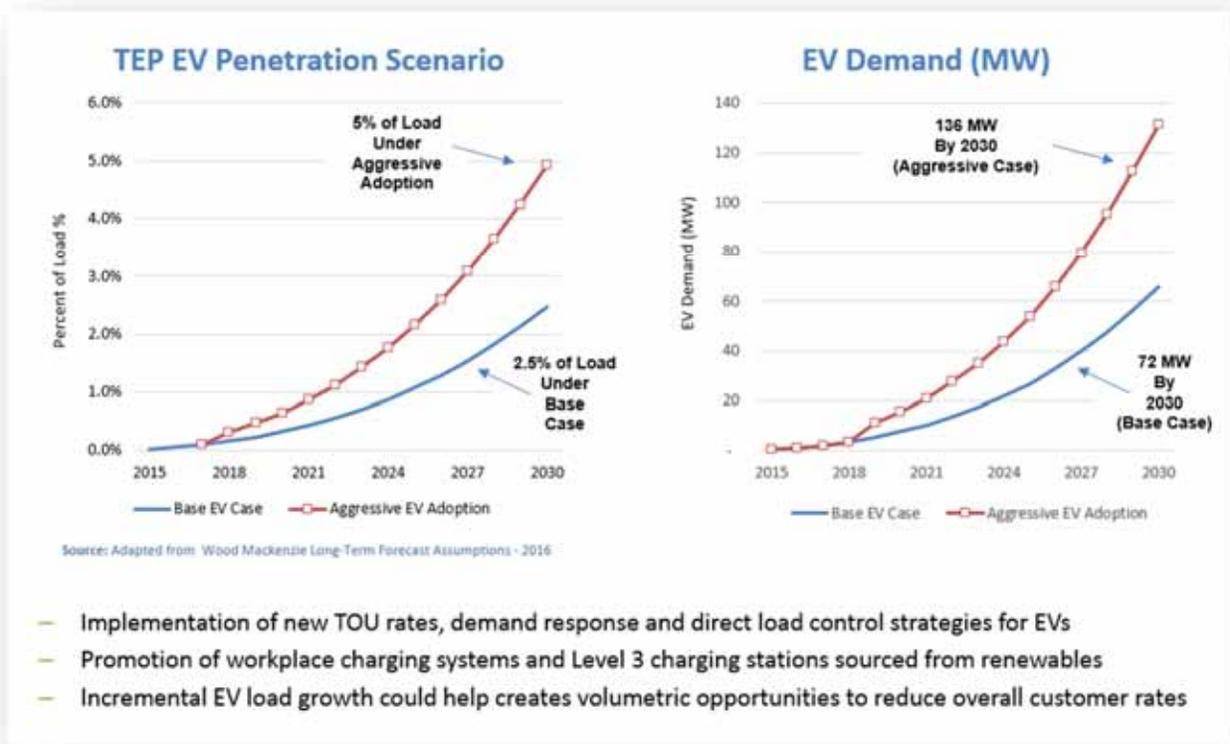

Future Adoption Rate Influencers

Much research around the country has gone into understanding the factors that underlie BEV and PEV adoption. While many innovative programs and initiatives have been launched to support EV adoption, the two most significant influencers of adoption rates are:

- ▶ Policy
- ▶ Future advances in battery technology

Policy

The most clearly demonstrable influencer of EV adoption to date has been federal and state policy creating incentives directly reducing the cost of EV purchases. States with highest incentives, such as California, Oregon and Georgia, have reached EV adoption rates 2 to 4 times above the national average. At the state level, incentive policies are dependent on public support and may be complimented by regulations such as California’s Zero Emission Vehicle program requiring automakers to achieve volumetric EV sales goals tied to their total fleet sales numbers.

Battery Technology

The opportunity that holds the greatest promise to increase future EV adoption rates is improvements to battery and manufacturing technology that reduce the cost of batteries measured, in \$/kWh. Industry analysis ties the price point at which EVs are on parity with contemporary internal combustion engine vehicles to a battery cost of \$100/kWh capacity. The current cost of batteries is around \$300/kWh capacity with claims the 2017 Tesla and Chevy Bolt will feature battery cells below \$200/kWh.

Figure 4 – Tesla Lithium-Ion Battery Production




Grid Impacts

Advancements in EV battery technology are dramatically increasing the range of these vehicles and driving charging patterns towards evening, at home charging, which can be accommodated through existing infrastructure via level 1 trickle charging using a standard 120v residential outlet. This pattern aligns with TEP’s current time of use based electric vehicle charging discount and creates a load pattern centered on late evening off-peak power.

A second charging profile option would center on workplace charging and presents a future opportunity to leverage power produced during low generation-cost daylight hours. This daytime workplace charging profile is not incented under the current rate structure but could be promoted through a future tariff design and a workplace charging station support program.

Figure 5 - EV Charging Profiles

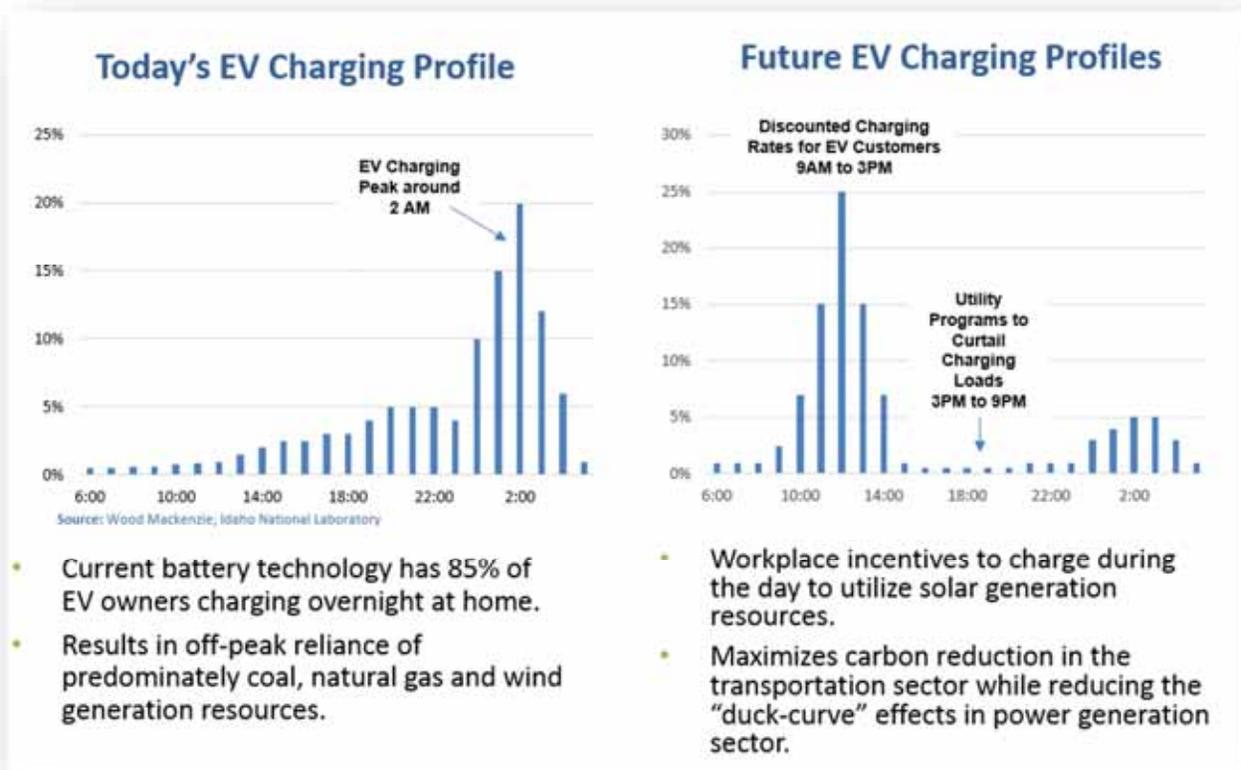

Smart Grid


The Future of the Distribution Grid

Changes in the supply, demand, and delivery of electricity are remodeling electric distribution systems at most North American utilities. Distributed Energy Resources (DERs) are leading many of these changes.

TEP is developing and analyzing strategies to enable these opportunities. The overarching strategy will help TEP adapt to the changing landscape for regulated electric utilities.

TEP envisions a future that will accommodate DERs and other innovations into the existing network while transitioning to a digital network. To accommodate DERs and other innovations, electric utilities need to do more than make their distribution systems bigger. Instead, utilities need to make their distribution systems smarter. Smart distribution systems provide flexibility, capability, speed, and resilience. These smart distribution systems include new types of software, networks, sensors, devices, equipment, and resources. To achieve new levels of economic value, these smart distribution systems operate according to new strategies and metrics. With more DG resources being deployed on TEP’s distribution system, higher demands and lower per capita energy consumption is occurring today. This puts demands on the transmission and distribution systems that were not contemplated in the original designs and requirements of the system. To meet these new demands, new methods of operation and technology need to be developed and implemented. TEP is investigating technology to add more sensing and measurement devices and new methods for managing and operating the distribution system. This approach turns a distribution feeder into an effective micro grid system.

Figure 6 – Smart Grid Systems

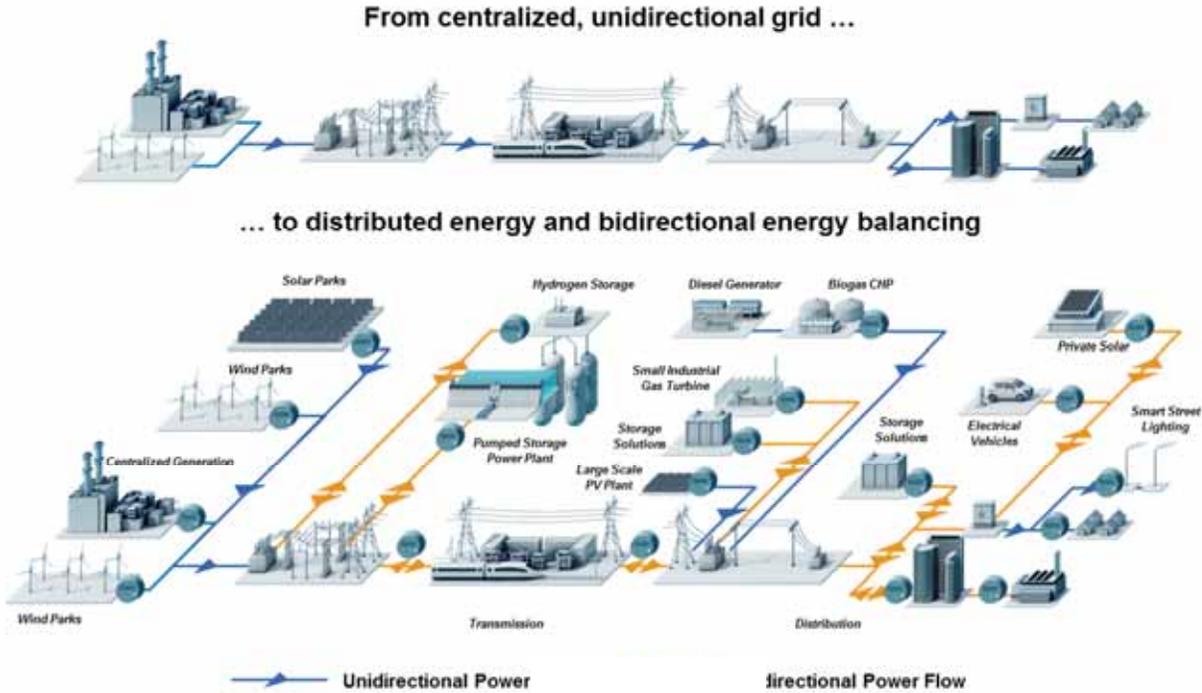

With increased demand and lower per capita energy consumption, new techniques and strategies need to be developed and implemented to effectively manage costs. By adding additional measurement and sensing capabilities, the situational awareness of the distribution system will be increased. The increased situational awareness allows for real time operations and planning opportunities for efficiency and productivity changes. To utilize the existing distribution system more efficiently, TEP is investigating the use of DERs, energy storage, EE, and targeted DR capabilities in conjunction with optimization software. These improvements may reduce the infrastructure additions required in the past as customer demand increased. This strategy is much different than how the distribution system has been managed in the past. It requires the use of a bottom up planning and design process that needs to be integrated with the IRP process. New tools and capabilities will be required as a result of the new opportunities envisioned.

At the core of these changes is the need for a communications network that allows for intelligent electronic devices to be installed on the distribution system. The communications network allows for the backhaul of information from the intelligent electronic devices to centralized software and control applications. Simply collecting and displaying more sensing and measurement information won't provide the needed benefits. An integrated approach to the installation of field devices, software applications, and historical data management will be needed. A DMS is the central software application that provides distribution Supervisory Control and Data Acquisition (SCADA), outage management, and geographical information into a single operations view. By combining the information from all three of these systems into a single view, an electrical distribution system model can be created for both real time applications and planning needs. The single view provides situational awareness of the distribution system that has not been possible in the past. It also creates a platform from which additional applications can be launched to continue to provide value and new opportunities. The historical information also creates a new opportunity to drive value and decisions based on system performance and dynamic simulations.

With the development of multiple distribution micro grid feeders and DER systems, the challenge of resource dispatching will become more complex. A solution to dispatch across a fleet of resources of existing centralized generation, purchased power from the market, and the intermittency of DER systems to customer demand will be required. The speed with which the resource pool will need to change and optimize for efficiency and cost will require the system to be automated. The distribution micro grid feeder concept is intended to help manage the distribution level intermittency but would need to be monitored and managed by the automated system for resource management. To manage such a large and dynamic system as outlined is a substantial challenge. This type of automated system is not currently available within the utility industry.

CHAPTER 3

OPERATIONAL REQUIREMENTS AND RELIABILITY

Load and Resource Adequacy

A critical component of the IRP planning process is the assessment of available firm resource capacity to meet firm load obligations and to maintain a planning margin above a utility’s forecasted load. As part of TEP’s long-term planning process, the Company targets a 15% planning reserve margin in order to cover for forecasting variances and any system contingencies related to unplanned outages on its generation and transmission system.

Chart 6 - TEP’s 2017 Loads and Resource Assessment – Existing Resources

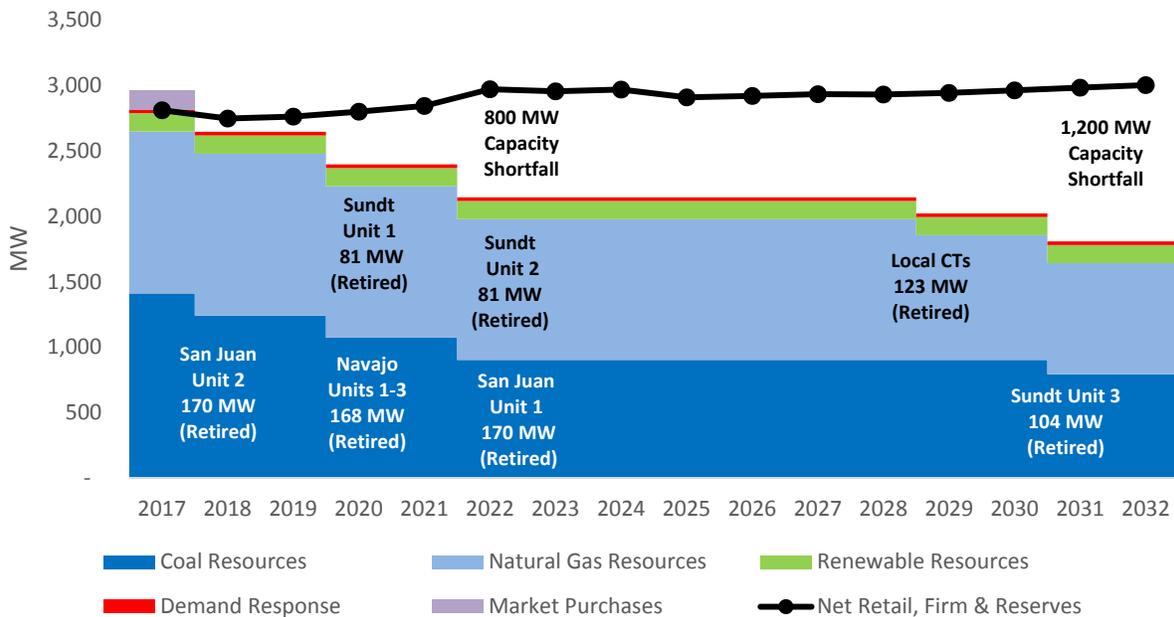


Chart 6 above illustrates TEP’s existing resource portfolio compared to a retail load forecast which includes firm wholesale and planning reserves. This loads and resource assessment includes significant coal and natural gas generating unit retirements. San Juan Unit 2 will cease operations by December 31, 2017. Preliminary studies performed by plant participants at Navajo Generating Station indicate that all 3 units could be retired as early as year-end 2019. TEP is weighing its options to completely exit and terminate its participation on San Juan Unit 1 by the end of June 2022. TEP is also committed to retiring and replacing its older and less efficient natural gas steam generators at Sundt Generating Station.

The capacity reduction of these aging and costly units will require TEP to diligently secure cost-effective replacement capacity in the near future. Within 5 years TEP may need 800 MWs of replacement capacity. That shortfall increases to approximately 1,200 MWs by the end of the 15-year planning horizon. The emergence of renewable resources, combined with evolving operational requirements, present challenges but also an opportunity to build a resource portfolio that is economically and environmentally sound. TEP is responsive to

its customers and dedicated to provide them safe, clean, and reliable power. This IRP presents a Reference Case Plan that achieves a target of 30% renewable generation by 2030. TEP is also committed to its EE programs and is supportive of DG. The renewables target and EE/DG projections will be complimented with proposed installations of Energy Storage Systems and RICEs. The reduction of generation anticipated from TEP's traditionally base-loaded coal units also necessitates the addition of natural gas combined cycle generation as a replacement.

Table 3 summarizes TEP gross retail peak demands by year based on its September 2016 load forecast projections. These demands are summarized by customer class and by the Company's assumptions on coincident peak load reductions from DG and EE. In addition, TEP includes a summary of projected firm wholesale customer demands along with demand associated with system losses. Table 3 also summarizes the Company's reserve margin positions based on the capacity resources shown in Table 4.

Table 4 summarizes TEP's firm resource capacity based on its current planning assumptions related to its coal and natural gas resources. Table 4 also reflects TEP's plan to source 30% of its retail energy needs from renewable generation resources by 2030. Additional resources such as DR programs, short-term market purchases, along with capacity sourced from its proposed battery storage project, are also shown in the TEP resource portfolio. The resource portfolio also includes the addition of NGCC resources to offset coal unit retirements and RICEs to help mitigate intra-hour intermittency and variability challenges introduced by renewable resources.

Future Load Obligations

The following two tables provide a data summary of TEP’s loads and resources. Table 3 shows TEP’s projected firm load obligations, which include retail, firm wholesale, system losses, and planning reserves.

Table 3 - Firm Load Obligations, System Peak Demand (MW)

Firm Load, Demand MW	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
Residential	1,284	1,304	1,326	1,356	1,379	1,411	1,425	1,439	1,464	1,474	1,487	1,492	1,503	1,519	1,534	1,550
Commercial	666	676	687	703	715	731	739	746	759	765	771	774	779	787	795	803
Industrial	357	363	369	377	384	393	397	401	408	411	414	415	419	423	427	431
Mining	131	131	131	138	157	229	228	228	228	228	228	228	228	228	228	228
Gross Retail Demand	2,438	2,474	2,513	2,574	2,635	2,764	2,789	2,814	2,859	2,878	2,900	2,909	2,929	2,957	2,984	3,012
Distributed Generation	-76	-85	-93	-99	-105	-110	-114	-118	-121	-122	-123	-125	-125	-126	-127	-128
Energy Efficiency	-142	-159	-177	-194	-211	-225	-235	-244	-253	-262	-271	-280	-289	-299	-308	-318
Net Retail Demand	2,220	2,230	2,243	2,281	2,319	2,429	2,440	2,452	2,485	2,494	2,506	2,504	2,515	2,532	2,549	2,566
Firm Wholesale Demand	223	158	158	154	154	154	129	129	44	44	44	44	44	44	44	44
Total Firm Load Obligations	2,443	2,388	2,401	2,435	2,473	2,583	2,569	2,581	2,529	2,538	2,550	2,548	2,559	2,576	2,593	2,610
Reserve Margin	522	361	362	365	374	388	395	395	481	499	519	547	448	453	435	434
Reserve Margin, %	21%	15%	15%	15%	15%	15%	15%	15%	19%	20%	20%	21%	18%	18%	17%	17%

System Resource Capacity

Table 4 shows TEP's Reference Case Plan schedule for firm resource capacity based on a resource's contribution to system peak.

Table 4 – Capacity Resources, System Peak Demand (MW)


Firm Resource Capacity (MW)	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
Four Corners	110	110	110	110	110	110	110	110	110	110	110	110	110	110	-	-
Navajo	168	168	168	-	-	-	-	-	-	-	-	-	-	-	-	-
San Juan	340	170	170	170	170	-	-	-	-	-	-	-	-	-	-	-
Springerville	793	793	793	793	793	793	793	793	793	793	793	793	793	793	793	793
Remote Coal Resources	1,411	1,241	1,241	1,073	1,073	903	903	903	903	903	903	903	903	903	793	793
Sundt 1-4	422	422	422	341	341	260	260	260	260	260	260	260	260	260	156	156
Luna Energy Facility	184	184	184	184	184	184	184	184	184	184	184	184	184	184	184	184
Gila River Power Station	412	412	412	412	412	412	412	412	412	412	412	412	412	412	412	412
Existing Combustion Turbines	219	219	219	219	219	219	219	219	219	219	219	219	96	96	96	96
Future Peaking Resources	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Future NGCC Resources	-	-	-	-	-	412	412	412	412	412	412	412	412	412	412	412
RICE Resources	-	-	-	96	96	192	192	192	192	192	192	192	192	192	192	336
Total Natural Gas Resources	1,237	1,237	1,237	1,252	1,252	1,679	1,679	1,679	1,679	1,679	1,679	1,679	1,556	1,556	1,596	1,596
Utility Scale Renewables	134	134	208	208	208	208	279	289	321	346	376	400	433	453	470	483
Demand Response	28	32	37	42	44	46	48	50	52	54	56	58	60	62	64	67
Total Renewables & DR Resources	162	166	245	250	252	254	327	339	373	400	432	458	493	515	534	550
Short-Term Market Resources	150	100	10	195	215	80	-	-	-	-	-	-	-	-	-	-
Future Storage Resources	5	5	30	30	55	55	55	55	55	55	55	55	55	55	105	105
Total Firm Resources	2,965	2,749	2,763	2,800	2,847	2,971	2,964	2,976	3,010	3,037	3,069	3,095	3,007	3,029	3,028	3,044

Typical Dispatch Profiles

The previous section described how the TEP Reference Case Plan will address peak hour demand. This IRP, more than previous ones, required additional analysis on the inter and intra-hour demand requirements and the response of the optimal resource mix. Chart 7 illustrates the manner in which existing resources were routinely dispatched to meet anticipated load requirements during a summer peak-type day in 2016. The figures do not represent the actual peak days; instead the demand profiles demonstrated in these figures are a typical day representative of each respective season for 2016. In Chart 7, it's clear that TEP's existing renewable resources have already had an impact on the dispatch of its coal and natural gas resources.

Both Chart 7 and Chart 8 below are derived from a sample of actual production data. The area shown above the 'Retail' line represents opportunity sales made to the spot market. Note that the current level of renewable resources is creating a greater opportunity to make sales from coal and natural gas resources. Of course, the depth of that opportunity may not always exist as renewables are creating this situation regionally and not just for the utility. This creates pressure on regional power prices, which have remained depressed over recent years, influenced by excess generation and low priced natural gas.


Chart 7 – 2016 Example Summer Day Dispatch

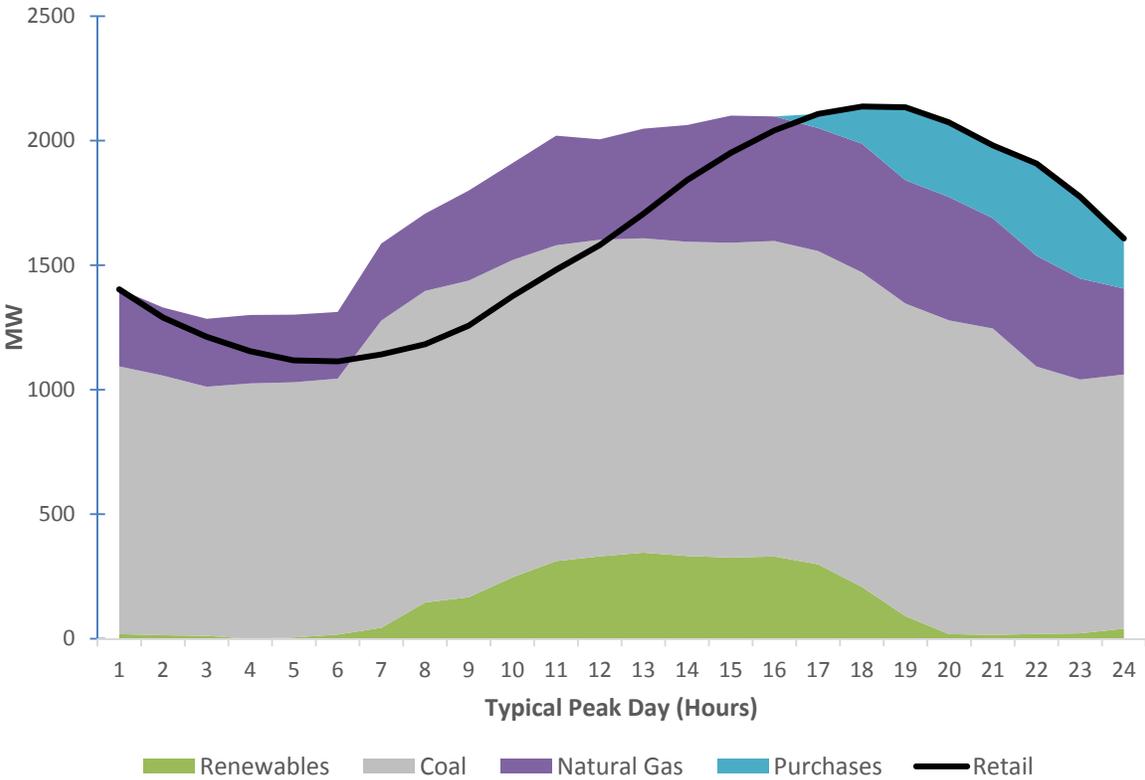

In Chart 7 above, we observe that the high peak demand experienced in the summer can be met with substantial market purchases and the utilization of existing peaking resources (gas turbines). The contribution from renewables, in green, is shifting these traditional peaks further to the right and into the evening hours. Increased solar generation is already creating a shift in gas and energy market forecasts.

With capacity available for purchase, the gas and energy market price forecasts dictate that a part of TEP’s gas resources would be displaced. The portion of the gas resources that are not dispatched have traditionally served as stand-by (reserve) capacity, thus serving a vital purpose in maintaining system reliability. This displacement is also cause to reevaluate how coal and gas resources should operate and in some cases if they’re able to operate with redefined parameters. As demonstrated in Chart 7, TEP experiences its peak demand at 4 to 5 PM in either July or August. Increased penetration of solar PV is having the net effect of shifting this peak to later hours, ultimately onto 7 to 8 PM as the sun sets. Meanwhile, system operators are deploying their fastest ramping units upward to respond to the ramp-down of solar resources.

Chart 8 - 2017 Example Winter Day Dispatch

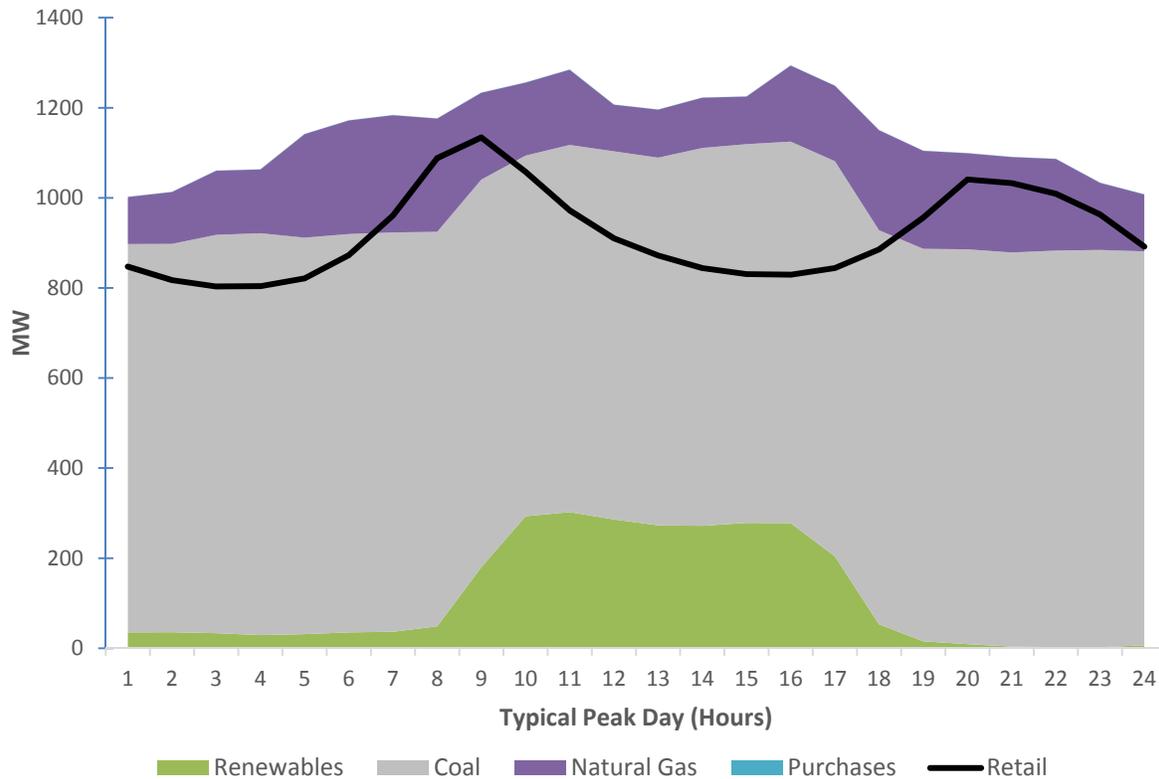

The TEP winter load profile, as seen in Chart 8 above, differs significantly from the summer profile. The peak demand experienced on weekdays in the winter is measurably lower than those seen in the summer. In the winter months, the load peaks in the early morning hours and then again in the late evening. The dispatch strategy in the winter differs significantly from the strategy in the summer. A different set of challenges emerges with increased solar generation during the winter. A more pronounced ‘duck curve’ creates ramp down and ramp up challenges, while also pushing the traditional base-load coal plants closer to their minimum generation (and ultimately below).

Balancing Authority Operations

To describe TEP’s utility operation with respect to the electric grid requires a review of electric grid fundamentals. There are several interconnections on the North American continent – the Eastern, Electric Reliability Council Of Texas, Quebec, and the Western. These are each part of the North American Electric Reliability Corporation (NERC), (see Figure 7). In addition Centro Nacional de Control de Energia (CENACE) operates the national grid of Mexico. Within the Western Interconnection, there are 38 BAs (see Figure 8). Each BA is responsible to balance loads and resources so that frequency remains at or near 60 Hz or 60 cycles per second. This resource balance is important for the safe and reliable operation of supply side resources and end use equipment. Simply put, a BA is the collection of loads and resources within a metered boundary, connected to other BAs through transmission ties for the purpose of maintaining frequency. TEP’s BA boundary (see Figure 9) has 44 ties to our 7 adjacent BAs.

Figure 7 - NERC Interconnections

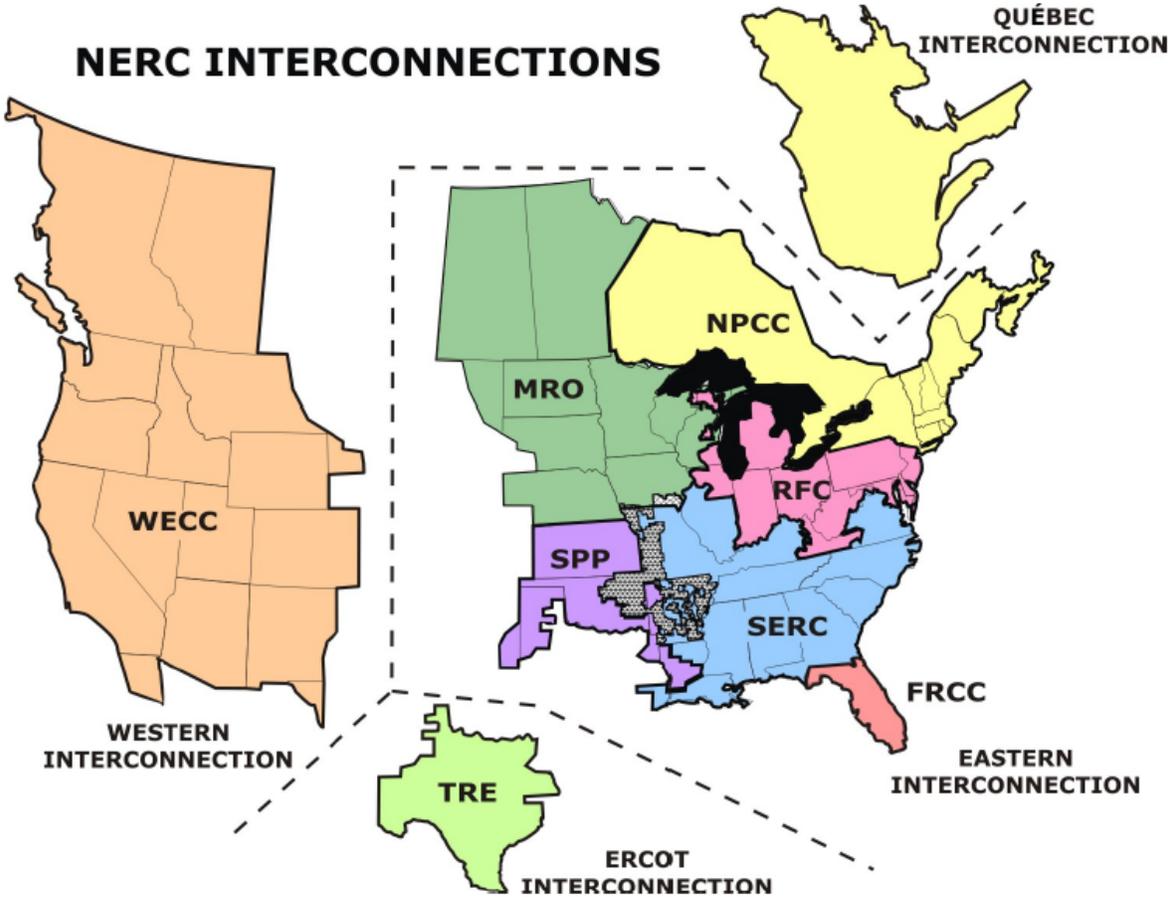


Figure 8 - Western Interconnection Balancing Authorities


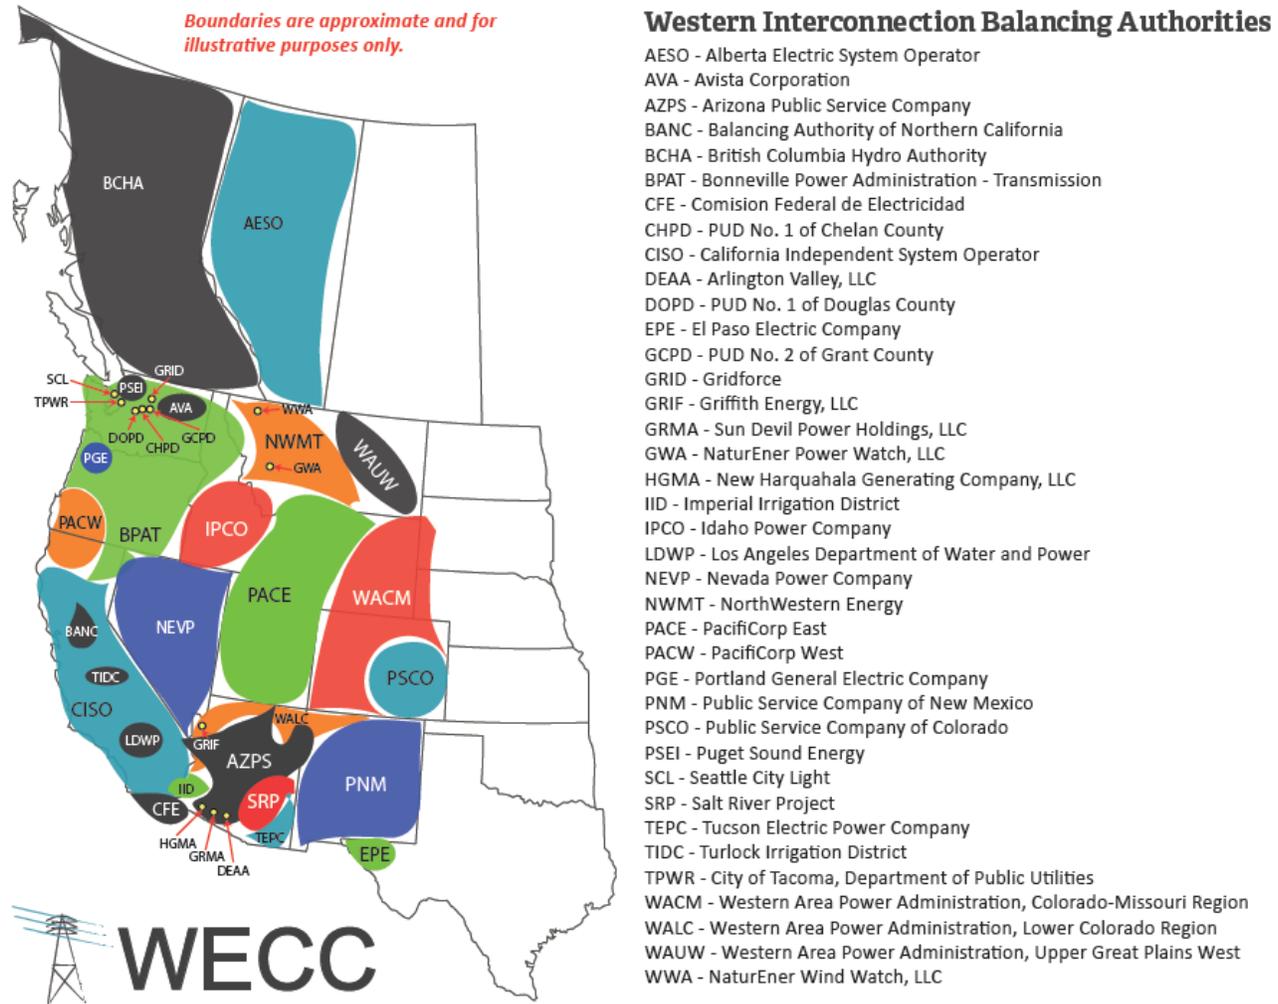


Figure 9 - TEP's Balancing Authority Area

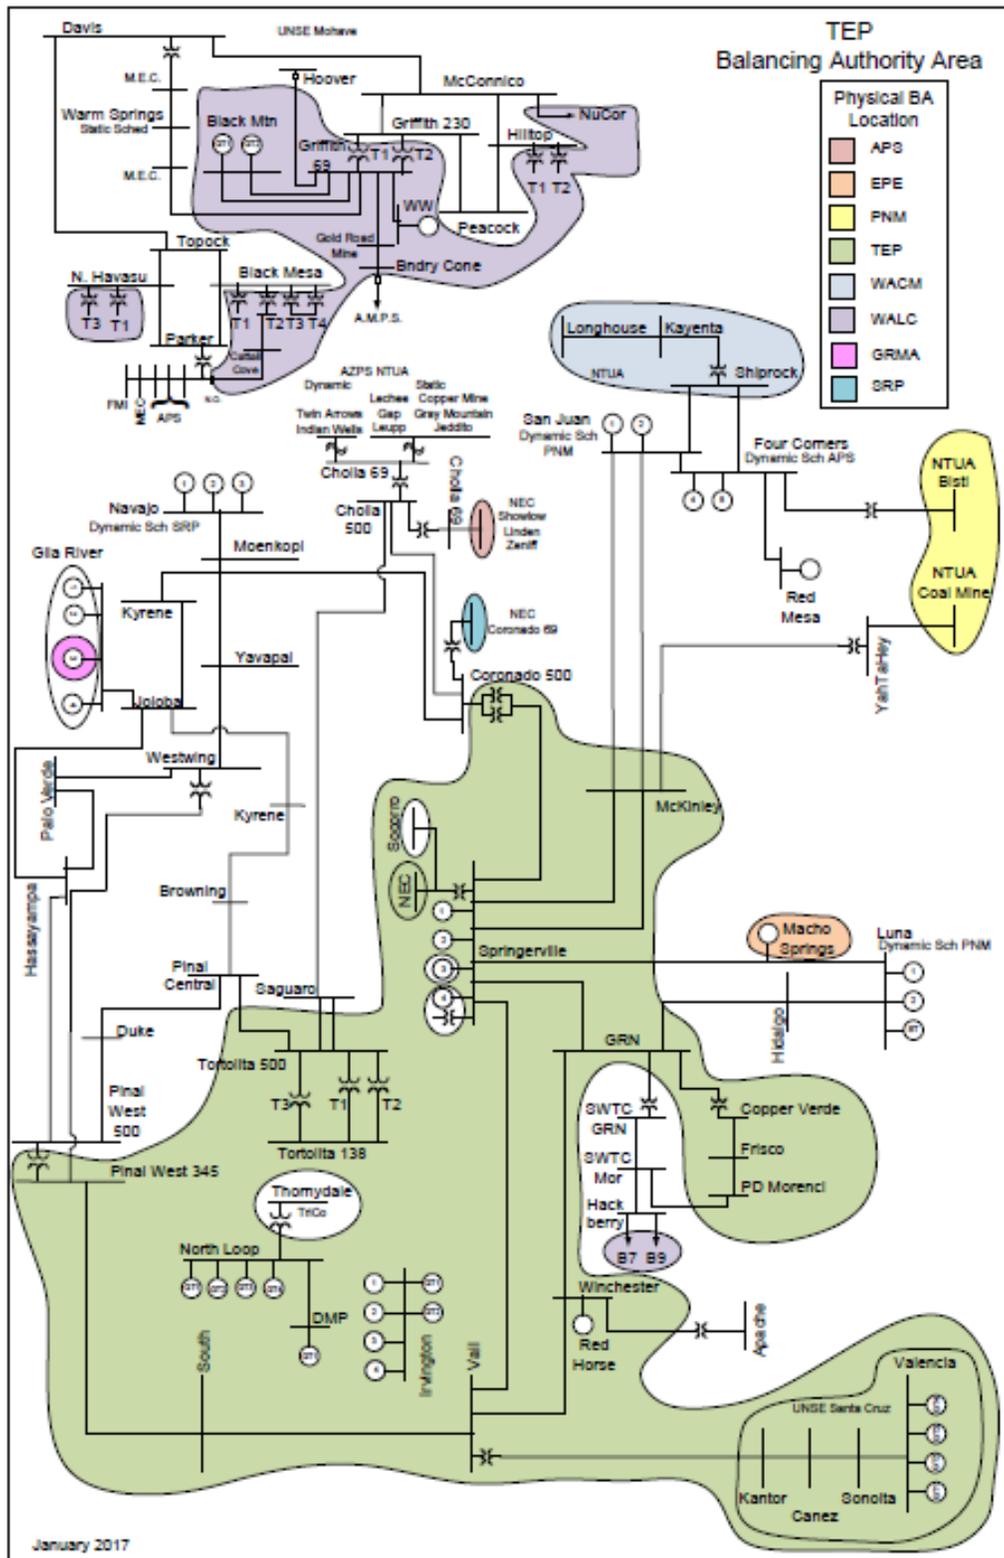

The primary quantity established by NERC for determining a BA’s reliability performance is Area Control Error (ACE). ACE is the instantaneous measure of a BA’s ability to manage its load obligations and support the interconnection frequency (see Figure 10). The following measures of ACE over time are the standards that each BA is expected to meet:

Control Performance Standard (CPS)

CPS is a measure of a BA’s ACE over time with respect to frequency. The BA helps frequency by over generating when frequency is low, and under generating when frequency is high. This is known as having ACE on the opposite side of frequency.

Balancing Authority ACE Limit (BAAL)

BAAL is a measure of how long a BA remains with an ACE that is hindering frequency. It is understood that no BA can always support frequency, but it is expected that a BA experiencing difficulties does not lean on the interconnection longer than it takes to resolve the issue.


Disturbance Control Standard (DCS)

DCS is a measure of a BA’s ability to replace their generating resources following the unplanned loss of a resource.

Frequency Response Measure (FRM)

FRM is a measure of a BA’s ability to provide frequency response during a disturbance. Frequency response typically comes from governor response on generators with capacity to increase output, inductive loads, and more recently inverter technology connected to batteries or renewable sources with capacity to respond.

Figure 10 - Balancing Area Function

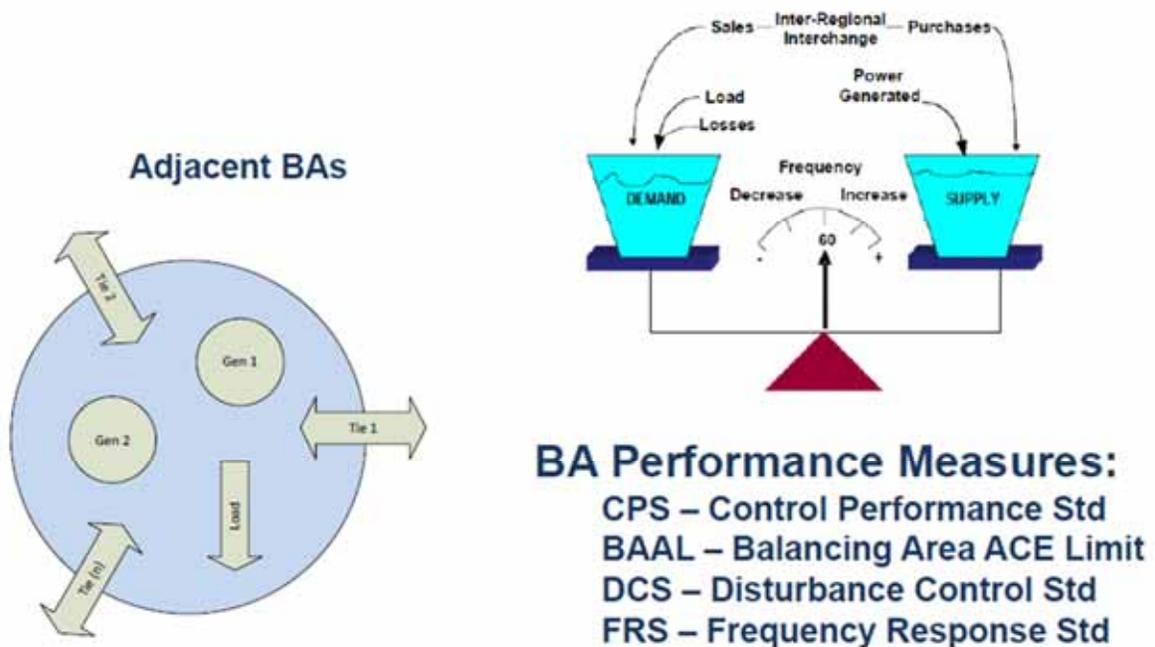

Reserves

Reserves are the key to providing a BA with the ability to respond to deviations in ACE and remain compliant with the measures above. Reserves are often labeled by the function they are performing such as regulating reserves for following load, contingency reserves for responding to a disturbance, frequency responsive reserves that immediately respond to frequency excursions. Collectively they are referred to as Operating Reserves. Reserves are also classified as spinning and non-spinning. Spin refers to generation that is online but unloaded so that it can immediately respond to an event. The reserve classification of non-spin or supplemental comes from generation that is not connected to the system but can be connected and generating power within 10 minutes, such as a quick start turbine. Interruptible load contracts also fall into this non-spin category. Non-spin is primarily used for disturbance recovery. With the proliferation of power electronics, many utilities, reserve sharing groups, and regulating bodies recognize the value of storage systems and head room on renewable systems which factor into the reserve calculation.

Load Following

Load following is generally characterized by a utility's ability to follow the load shape of its BA Area and regulate power output changes over a five to ten minute timeframe. Load following is required to respond to the changing conditions of electric supply and demand. Historically, utilities relied on a mix of conventional generation resources tied into a utilities' Energy Management System (EMS) that provided Automatic Generation Control (AGC) to manage their load following requirements. However, as renewable resources become a larger part of the resource portfolio, changes in supply and demand conditions will become more extreme and will happen more frequently. These changes require fast responding resources and demand side shaping to accommodate the fluctuating resources as renewable penetration increases.

Regulation is used to reconcile momentary differences caused by fluctuations in generation and loads. The primary reason for controlling regulation in the power system is to maintain grid frequency requirements that comply with the NERC's Real Power Balancing Control Performance and Disturbance Control Performance Standards. The benefit of regulation from storage technologies with a fast ramp rates are on the order of two to three times that of regulation provided by conventional generation. This is due to the fact that storage technologies have the ability to react to changes in system conditions in a matter of a minute or two rather than several minutes. The black load demand line in Chart 9 shows numerous fluctuations depicting the imbalance between generation and load without regulation. The thicker orange line in the plot shows a smoother system response after damping of those fluctuations with regulation.

One of the new challenges with high levels of renewable penetration is the low load levels seen in the off season belly of the duck curve (see Chart 10), as well as the large daily swings associated with the peak season load shape. With loads being supplied by both DG and utility scale renewables, the conventional resources must be backed down to make room for the renewables, but then must ramp up to cover the peak when the renewables are unavailable.

Chart 9 – Effects of Load Regulation


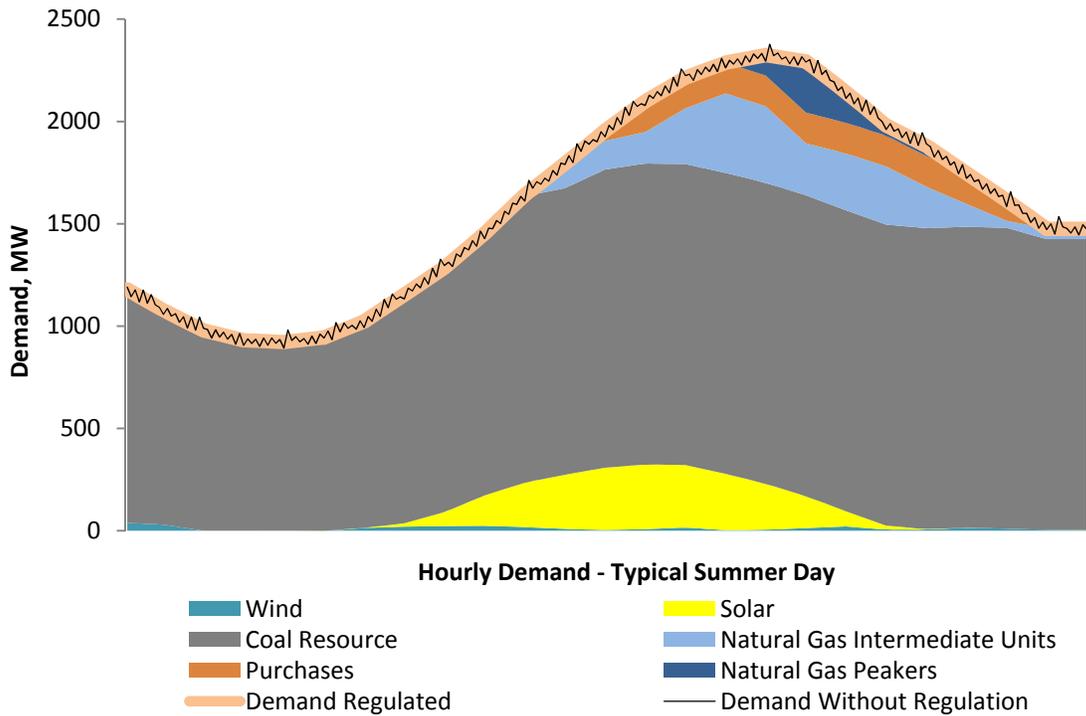


Chart 10 - Typical 2030 Winter/Spring Duck Curve

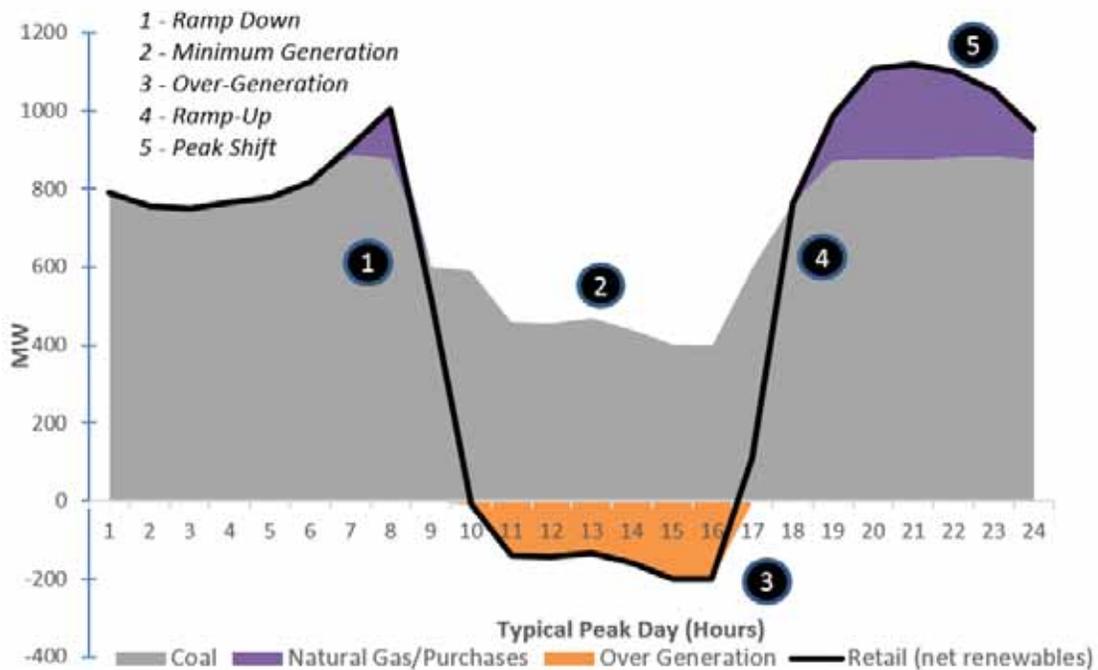

Another challenge to regulation with high levels of renewable penetration is intermittency. Moving cloud cover and variations in wind, among other weather patterns, can cause large amounts of renewable generation to drop out or return to service in mere minutes. These fast changes in renewable generation require resources that can ramp up and down quickly and repeatedly in order to regulate and maintain performance measures.

Many potential solutions to help mitigate this steep daily ramp up and down and inter-hour intermittency are being explored and include:

- ▶ Cycling coal plants
- ▶ Lowering the minimum operating levels of conventional plants
- ▶ Investing in fast response generating technology
- ▶ Investing in storage systems
- ▶ Changing the load shape through rate design

Adjustments to Operating Reserve

TEP maintains an amount of Operating Reserves greater than the minimum requirement, but had not quantified the excess. Difficulties with regulation due to renewable intermittency led TEP's System Control to study the intermittency and excess operating reserves. The result was a change to how TEP calculates and carries Operating Reserve.


The purpose of the adjustment to Operation Reserves is to ensure a defined amount of excess reserves are available at all times. The new calculation will require that additional Operating Reserves are carried in the On-Peak hours and Off-Peak Hours. Excess Reserves meeting the new criteria were already available during 85% of hours in the year, but implementing this new criteria is necessary to ensure sufficient reserves are available at all times.

TEP's Energy Management System takes the System Load, and depending on whether it is an On-Peak or Off-Peak hour, multiply it by a variability margin. This amount is added to the Spinning Reserve Requirement, which the System Operators monitor and maintain around-the-clock. They are also free to deploy this reserve as necessary to maintain performance measures.

Frequency Response

Frequency response is an ancillary service requirement that is similar to regulation except that frequency response automatically reacts to a system disturbance in seconds rather than minutes. Frequency disturbances occur when there is a sudden loss of a generating unit or a transmission line outage disrupting the load/resource balance. As a result, other generating resources that are online must respond to counteract this sudden imbalance between load and generation and to maintain the system frequency and stability of the grid. The first response within the initial seconds is called the primary frequency control. This response is the result of the governor action on the generating units as well as storage systems which automatically increase their power output as shown in the lower portion of Figure 11 below. This is followed by the longer duration of secondary frequency controls. These responses are initiated by AGC that spans a half a minute to several minutes shown by the dotted line in the lower portion of Figure 11. The combined effect of inertia and the governor actions of online generating units determines the rate of frequency decay and recovery shown in the arresting and rebound periods in the upper portion of Figure 11. This is also the window of time in which the fast-acting response of flywheel and battery storage systems excels in stabilizing the frequency. The presence of fast-acting storage assures a smoother transition to normal operation returning grid frequency back to its normal range.

Figure 11 – Sequential Actions of Frequency Controls

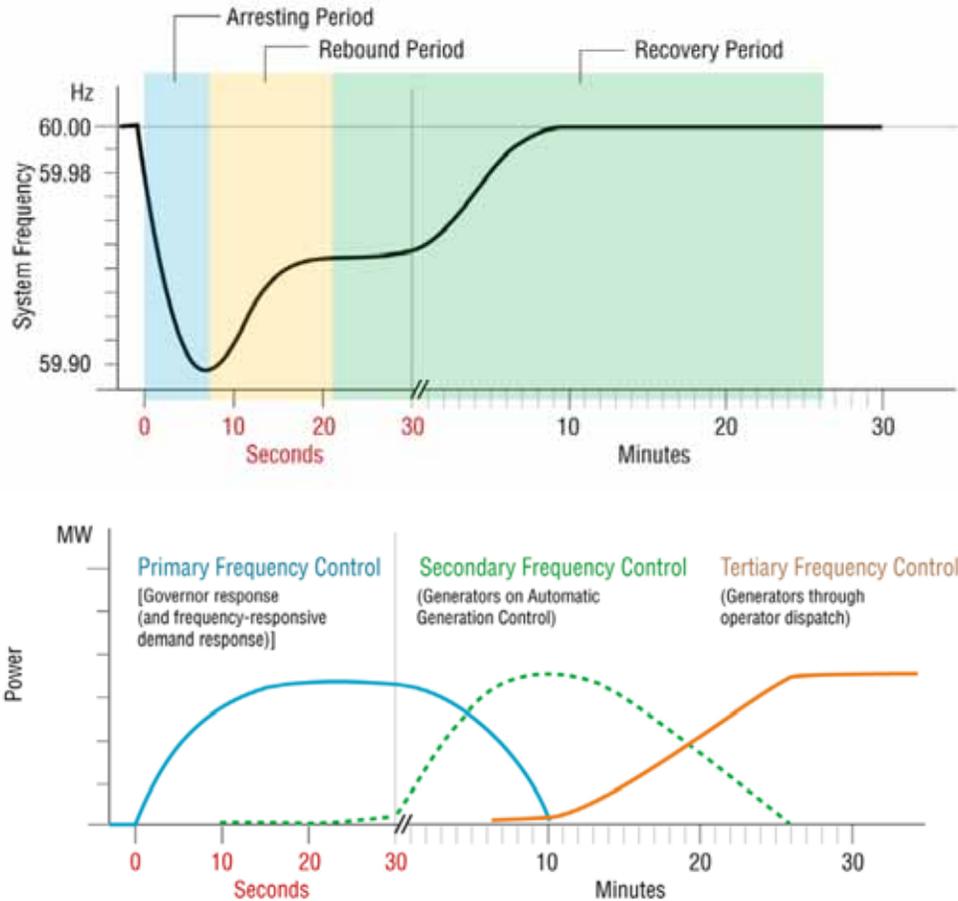

Inertia

Generators and motor load provide the inertia of a system. Inertia is the rotating mass of generators and their prime movers, as well as motors and their load which oppose changes in frequency. The magnitude of inertia in the system is changing as the industry moves from large centralized steam plants to more of a distributed network of gas turbines and renewable systems. As the inertia declines, the rate of change of frequency increases. The contribution to inertia from power electronics and their systems is still to be quantified and is sometimes referred to as pseudo inertia.

Voltage Support

Another reliability requirement for electric grid operation is to maintain grid voltage within specified limits. To manage reactance at the grid level, system operators need voltage support resources to offset reactive effects so that the transmission and distribution system networks can be operated in a stable manner. Normally, designated power plants are used to generate reactive power (volt-ampere reactive, VAR) to offset reactance in the grid. As power plants are displaced, VAR sources need to be strategically placed within the grid at central locations and by taking the distributed approach and placing multiple VAR-support storage systems near large loads.

Power Quality

The electric power quality service involves using storage to protect customer on-site loads downstream (from storage) against short-duration events that affect the quality of power delivered to the customer's loads. Some manifestations of poor power quality include the following:

- ▶ Variations in voltage magnitude (e.g., short-term spikes or dips, longer term surges, or sags)
- ▶ Variations in the primary 60-hertz (Hz) frequency at which power is delivered
- ▶ Low power factor (voltage and current excessively out of phase with each other)
- ▶ Harmonics (i.e., the presence of currents or voltages at frequencies other than the primary frequency)
- ▶ Interruptions in service, of any duration, ranging from a fraction of a second to several seconds

Typically, the discharge duration required for the power quality use ranges from a few seconds to a few minutes. Distributed storage systems can monitor grid power quality and discharge to smooth out disturbances so that it is transparent to customers.

Table 5 – Ancillary Services Technical Consideration for Storage Technologies

Ancillary Services	Storage System Size	Target Discharge Duration	Minimum Cycles/Year
Load Following / Ramping	1 – 100 MW	Range: 15 minutes to 60 minutes	Not Applicable
Regulation	Range: 10 – 40 MW	Range: 15 minutes to 60 minutes	250 – 10,000
Voltage Support	1 – 10 (MVAR)	Not Applicable	Not Applicable
Distribution Deferral	500 kilowatts (kW) – 10 MW	Range: 1 – 4 hours	50 - 100
Power Quality	100 kW – 10 MW	10 seconds – 15 minutes	10 - 200
Frequency Response	10 – 100 MW	5 seconds – 5 minutes	20 - 100

Distribution System Enhancements

Distribution Capacity Expansion

TEP's long term distribution system capacity requirements are being supported by strategically targeting areas where new substations can be built, increasing existing substation capacity, and the optimizing the replacement of ageing equipment.



New 138kV Substations

New 138kV substations have been identified in the Company's 10 year transmission plan. Historically, justification for new substations in the 10 year plan have been driven primarily from capacity needs on the distribution system. These new 138kV-sourced distribution substations will not only help support and increase system capacity, they will provide additional contingency support for the existing distribution network. The new 138kV substations also align with long range plans of further utilizing the 138kV system to directly source the distribution system. The 138kV transmission system is more reliable than the 46kV sub-transmission system that is used to source a significant portion of the distribution system. These new substations allow for more of the distribution system load to be sourced from a more reliable 138kV system.

Benefits Realized from New Substations

- ▶ Reduced peak loading on existing system
- ▶ Increased capacity for future commercial, residential and light industrial development
- ▶ Increased contingency support to improve system reliability and operational flexibility
- ▶ Additional capacity can be utilized to identify and evaluate improved service for critical customers
- ▶ Supports other technology integration such as remote switching control
- ▶ Supports long term plans for 4kV system conversion to 13.8kV
- ▶ Retirement of ageing substations where feasible
- ▶ Reduces distribution system losses

Existing Substation Upgrades

Continued focus on utilizing the Asset Management Group to analyze and monitor all of TEP's existing substation equipment will help identify which ageing substation transformers are in need of replacement throughout the system. Once the transformers have been identified for replacement, they are evaluated in relation to current system conditions to determine a proper replacement strategy. In many cases, increased transformer capacity and upgrades to a higher low-side voltage are required. Similar to what has been described above, increased transformer capacity will improve operational flexibility and system reliability. Additionally, installing new transformers with a 13.8kV low-side voltage aligns with long range plans for upgrading the 4kV distribution system to meet existing standards.

4kV System Conversion

Initially, the 4kV system emerged as the primary distribution voltage to serve all residential and commercial load within central Tucson. A majority of the 4kV system is sub-standard when compared to the Company's 13.8kV system, however, a full system conversion will be very labor and cost intensive.

Many of the existing components including cable, service transformers, poles, arms, and insulators must be replaced to fully convert the system to 13.8kV. Efforts are underway for identifying a long-range plan for system conversion and these plans will rely on projects identified above related to substation transformer replacements.

4KV System Conversion Benefits

- ▶ Opportunity for aligning system conversion with substation transformer change-outs
- ▶ Increased circuit capacity with voltage conversion
- ▶ Improved system reliability by creating stronger ties with the existing 13.8kV system
- ▶ Increased contingency support will improve outage restoration time
- ▶ Reduced system losses

Clean Energy Standards

Beginning in 1999, with the Environmental Portfolio Standard, the Arizona Corporation Commission (ACC or “Commission”) has adopted *clean energy standards*, which establish goals for all Arizona load serving entities regulated by the Commission, such as TEP to (1) utilize renewable energy resources to meet a portion of its retail load, and (2) design and implement EE programs to reduce some percentage of customer energy use. These standards were intended to, and in fact have, accrued certain benefits to customers, as well as broader society, including:

- ▶ Reduced emissions of greenhouse gases and other air pollutants through a reduction in fossil-fuel-generation
- ▶ Reduced renewable energy unit costs by contributing to a larger and more certain market for renewable energy manufacturers and installers
- ▶ Reduced overall customer bills, by promoting cost-effective EE measures

Renewable Energy Standard Compliance

The Renewable Energy Standard⁹ (RES) sets forth a requirement for all Arizona load serving entities to meet a percentage of their retail load using renewable energy resources. This percentage increases annually until it reaches 15% in 2025. In 2017 the RES target for TEP will be approximately 621 GWh based on 7.0% of 2016 retail sales. TEP anticipates exceeding the annual requirement in 2017 and each year thereafter as part of its goal to reach 30% of retail load using renewable energy by 2030.

Energy Efficiency Standard Compliance

The Arizona Energy Efficiency Standard (“EE Standard”) sets forth a requirement for all Arizona load serving entities to achieve energy savings based on a percentage of the prior year retail load, growing to a cumulative load reduction of 22% by 2020. Table 6 shows TEP’s progress towards meeting the standard annually. As of the end of 2016, TEP has achieved the required savings and is poised to continue through 2017. In 2017 TEP’s target for energy savings will be 204,341 MWh, based on 14.5% of 2016 retail sales. For resource planning purposes, TEP has assumed that it maintains compliance with Arizona EE Standard through 2020 when the program sunsets. Assumptions for EE savings after 2020 are addressed in Chapter 10.

⁹ Renewable Energy Standard and Tariff, A.C.C. R14-2-1801

Table 6 - Energy Efficiency Cumulative Annual Savings Progress towards the Standard

Year	Retail Energy Sales (MWh)	Incremental Annual Energy Savings (MWh)	Cumulative Annual Energy Savings (MWh)	Cumulative Annual Savings as a % of previous year Retail Sales	Cumulative EE Standard
2010	9,291,788				
2011	9,332,107	139,539	139,539	1.50%	1.25%
2012	9,264,818	105,655	245,194	2.63%	3.00%
2013	9,278,918	177,425	422,619	4.56%	5.00%
2014	8,520,347	221,215	643,834	6.94%	7.25%
2015	8,431,556	168,600	812,434	9.54%	9.50%
2016	8,387,868	197,466	1,011,900	12.00%	12.00%
2017		204,341	1,216,241	14.50%	14.50%

Utility-Specific Standard Derived Through the IRP Process

While the RES and EE standard have produced real and tangible benefits as noted above, clean energy standards applied at a statewide level are inherently inflexible and fail to take into account the unique circumstances of different utilities. This creates inefficiencies in resource acquisition and dispatch, which ultimately results in higher costs passed on to customers. In the early years of these programs, when the clean energy goals were modest, the impact of these inefficiencies was not significant. However, as these clean energy goals approach higher percentages of the total retail load, TEP anticipates that the negative impact of these inefficiencies will become more pronounced.

Proper consideration of cost and benefits of various resources is a fundamental function of integrated resource planning. In fact, the IRP provides the most holistic consideration of the very goals that clean energy standards aim to achieve, while balancing the cost of achieving those goals. Since integrated resource planning was reinstated in 2011, the goal of the IRP has shifted from focusing on the least-cost portfolio to the best case portfolio considering cost, environmental factors, and reducing long-term risk.

Addressing clean energy standards within the IRP would put the cost effectiveness of renewable energy, EE, and DR on a level playing field with conventional resources based on their role in creating a low-cost, low-risk resource portfolio. Adding to the logic of this approach is that many renewable energy technologies are at or approaching parity with conventional resources, and cost effective EE remains the lowest cost resource. Finally, IRP tools are continually being adapted to account for emerging hourly and sub-hourly operational issues that accompany certain renewable energy and DR products. Therefore, TEP believes that the IRP would be a better mechanism to develop utility-specific targets for clean energy standards than a state-wide, "one size fits all" rulemaking.


Renewable Energy Integration

TEP is targeting a renewable portfolio that will supply 30% of its retail load requirement by 2030. This aggressive target will come with its own set of challenges and it will require TEP to derive a balanced, responsive, and diverse generation portfolio. This section will point out and explain the operational challenges that TEP will face as it increases its use of renewable generation.

Operational Challenges

Historically, electric utilities with predominant air conditioning load set a peak demand between 4:00 PM to 5:00 PM on a summer day. The winter load requirements are lower than they are for the summer but, the challenges that emerge on a daily basis (with heavy solar penetration) are more pronounced. Chart 11 below illustrates a sample winter day for TEP. On a typical winter day retail load tends to peak at day-break and again after the sun sets and consumers turn on appliances and lighting.

Chart 11 – Sample Operational Challenges due to Solar Production

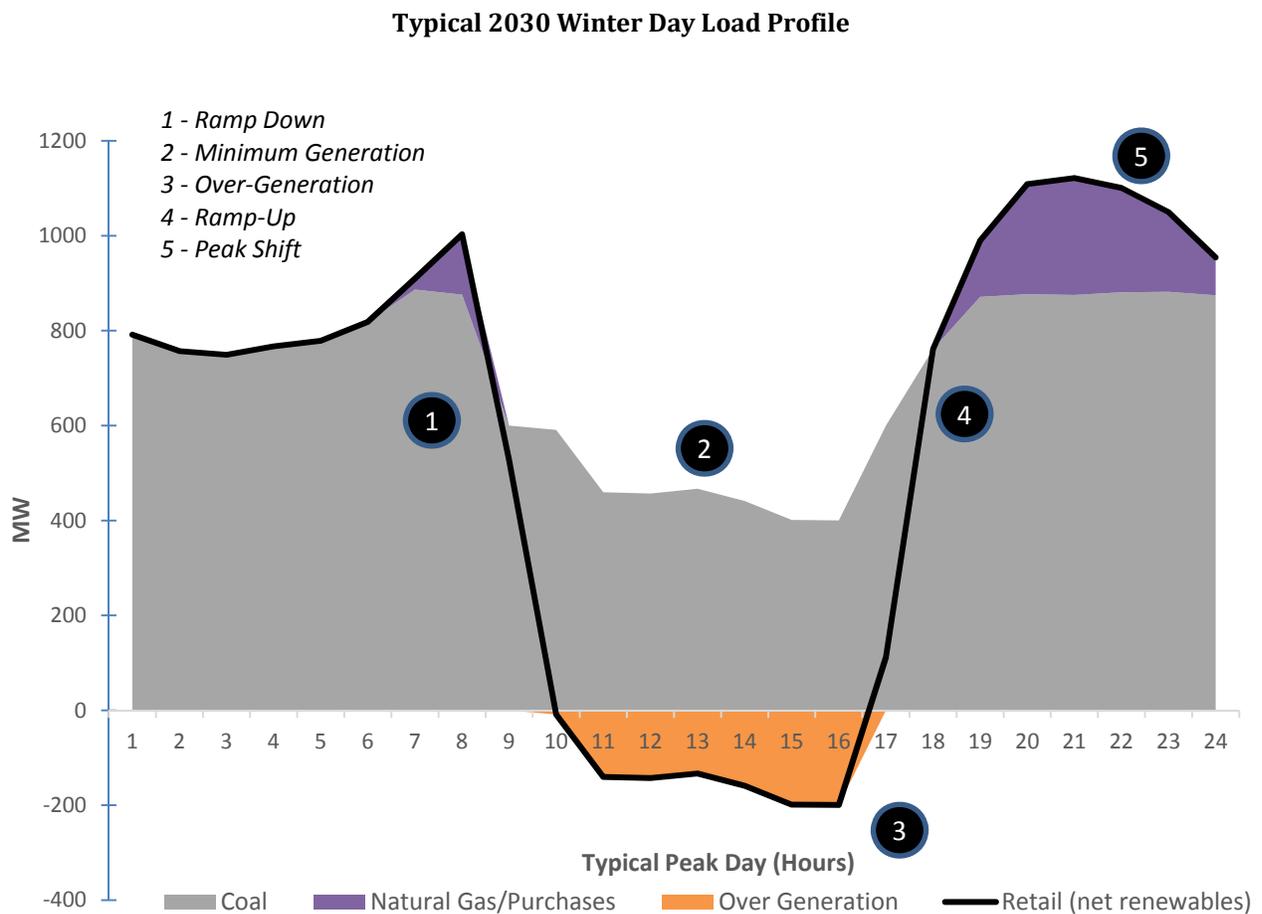

The accumulation of solar PV introduces operational challenges on a daily basis. As we review Chart 11 above showing the load shape of a typical winter day, we make the following observations;

1. **Ramp Down** – Absent solar PV, the demand profile on a typical winter day includes a peak in the morning and one in the evening. The morning peak occurs during the coldest hours as the sun rises and while consumers wake, homes and businesses are warmed and commuters head to work. The retail load, on its own, would trend downward modestly as the sun rises and tracks along the horizon. This ramp-down was typically managed with coal and natural gas resources. The net effect of addition solar PV will cause a more drastic ramp-down. Fast-response resources, such as RICEs, will be required to manage this steep reduction in net load. These units will likely be prescheduled to contribute to the morning peak and then utilized to ramp down to give way to the sun and solar PV.
2. **Minimum Generation** – As solar PV generation reaches its peak, and after ramp-down, generating units must have the capability to generate at reduced output levels during the midday hours. Modifications may be required on units to allow them to cycle off. If cycling is not an option for generators, TEP must rely on market demand for excess thermal generation off-take or develop strategies to dispatch below its minimum generation.
3. **Over-Generation** – The CAISO is already experiencing negative pricing for over-generation during peak PV generating hours. Adjacent utilities and entities have been the beneficiaries of this pricing. The opportunity to charge Energy Storage Systems (ESS), such as batteries or hydro pumped-storage, presents itself during these hours to take advantage of excess generation at low cost. Increased PV at TEP will contribute to over-generation and will require innovative ideas and infrastructure to secure the right mixture of resources.
4. **Ramp Up** – The sun begins to set, fast-responding resources must now ramp up to displace the demand that solar PV relinquishes. It's at this point that a utility must utilize flexible resources to equally offset the drop in solar generation. The ramp-up may be mitigated in the near term by combustion turbines and natural gas combined cycle generators. As the ramp-up steepens, it may necessitate the inclusion of ESS, RICE, and/or DR mechanisms.
5. **Peak Shift** – Solar PV will only reduce demand until the sun sets. This results in a narrowing and net shift of peak demand. CAISO has also demonstrated escalated pricing in these evening and night hours. While ESS charges during the 'over-generation' hours, this peak period may present an opportunity to discharge these systems, especially if we observe a transformation of hourly peak and off-peak pricing.

Solar PV has tremendous upside and arguably it may contribute to reduced losses, to apportioned capacity reductions (generation and transmission), and to carbon emission reductions, among other benefits. We recognize from the chart and discussion above that other challenges arise. As the sun is rising, electric load stabilizes and begins an ascent toward the peak. Increased penetration of solar creates a rapid net drop in load; TEP must have generators that are capable of ramping down at a fast rate. Most baseload units such as coal and natural gas-steam are challenged to respond to this ramp down and subsequent ramp up. In between we may be challenged with unit generation minimums and negative pricing.


The net reduction in load will create the need for rapid responding generators to regulate the initial steep decline in load followed by an immediate rise. In a resource planning context, with the increasing penetration of solar systems, we must take into consideration the right combination of resources to respond to the variability and intermittency of renewable systems. A portfolio with a high penetration of solar and other renewables may necessitate the installation of RICEs and/or storage in the form of batteries or natural gas.

Shifting Net Peak

Chart 12 below represents a projected 2030 typical summer peak day for retail demand and the net retail demand adjusted for varying levels of solar penetration as estimated in the Reference Case Plan. The chart illustrates how increased penetration of solar PV and solar DG will shift the net peak retail demand from approximately 4 PM to ultimately 8 PM. The net reduction in peak will not exceed the difference between the demand demonstrated at 4 PM and the demand at 8 PM when the sun has already set. In fact, TEP anticipates that approximately 350 MWs of PV and DG will be in service by year-end 2017. The impact of the current solar portfolio is demonstrated in the chart below; net peak demand has already been reduced by and the net peak is shifted to 7 PM.

The addition of 150 MWs prior to year-end 2020 will reduce the peak minimally but the time of peak will shift further to the right and to 8 PM. After 2020, we observe that solar generation from PV and DG will have negligible reduction to net peak at 8 PM. The contribution from solar generation toward demand reduction will be constrained within the mid-day hours. Solar generation at levels demonstrated for 2025 and 2030 in the chart, will only contribute toward energy production primarily while other resources must be deployed to meet net peak demand.

Chart 12 – Peak Demand Contribution from PV

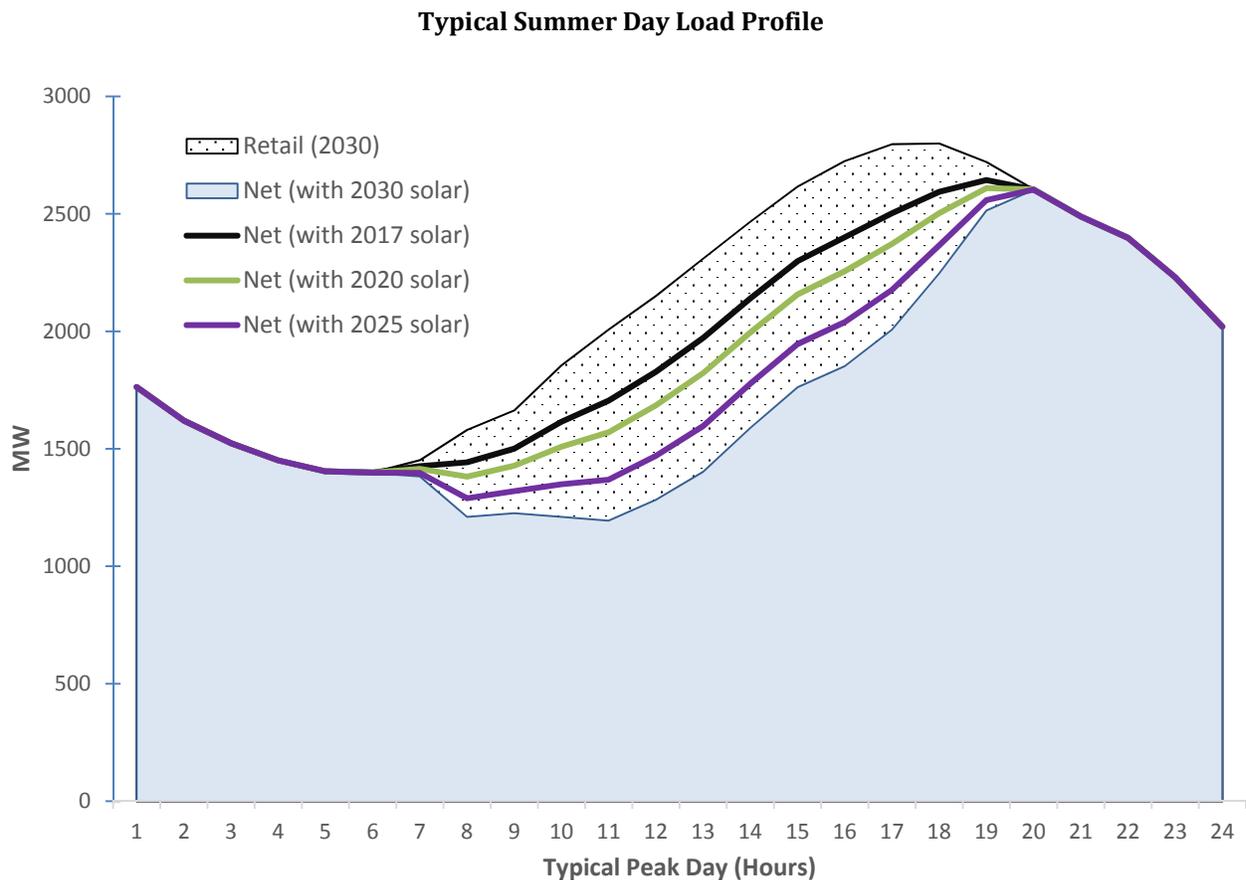

Weather Forecasting to Support System Dispatch

Weather forecasting is utilized to reduce operating costs at TEP. There are different products that are used to forecast the weather, but the main product TEP predicts the weather with is weather forecast models.

At TEP, we use a regional specific form of a Numerical Weather Prediction (NWP) model. A NWP model is a numerical representation of the different land and atmospheric processes that affect the weather. The specific version of the NWP model TEP uses is known as the Arizona Weather Research & Forecast (AZ WRF) model. This model was created by the University of Arizona (UA), which was done so in partnership with TEP and is maintained with continued support from TEP and a number of other utilities. This model is unique, because it is a “highly customized” model that is specific to the southwestern United States (US). This is important, because traditional weather forecast models do not take into account the terrain located throughout the southwestern US.

The modifications the UA made to the model has allowed it to produce better forecasts than other weather forecast models can. It is also run at a higher resolution than other weather forecast models are. This is done, so small scale weather phenomena can be captured, like the wind events, clouds, and monsoonal thunderstorms created by the surrounding mountains. If we were to use traditional weather models, weather events are commonly either over or under forecasted.

Power forecasts are created by the UA for TEP, so TEP can easily take the forecast information and implement it into its existing processes. This power forecast is an ensemble of multiple runs of the North American Model (NAM), the Global Forecast System model (GFS), and the Rapid Refresh model (RR). The power forecast also contains information that TEP gives the UA about the different utility and residential scale solar and wind sites in the service territory. This model provides forecasts that range from 48 hours up to 7 days. The model is run up to 8 times a day and is initialized with different data each time.

At this time, TEP’s Wholesale Marketing Department uses this power forecast to make decisions, regarding how much power to buy or sell at the real time and day ahead level.

Below are two examples of these forecasts. The first example is a forecast that covers all of TEP territory’s utility-scale solar and the second example is a forecast that covers all of TEP territory’s utility-scale wind.

Chart 13 – TEP Utility Scale Solar Forecast


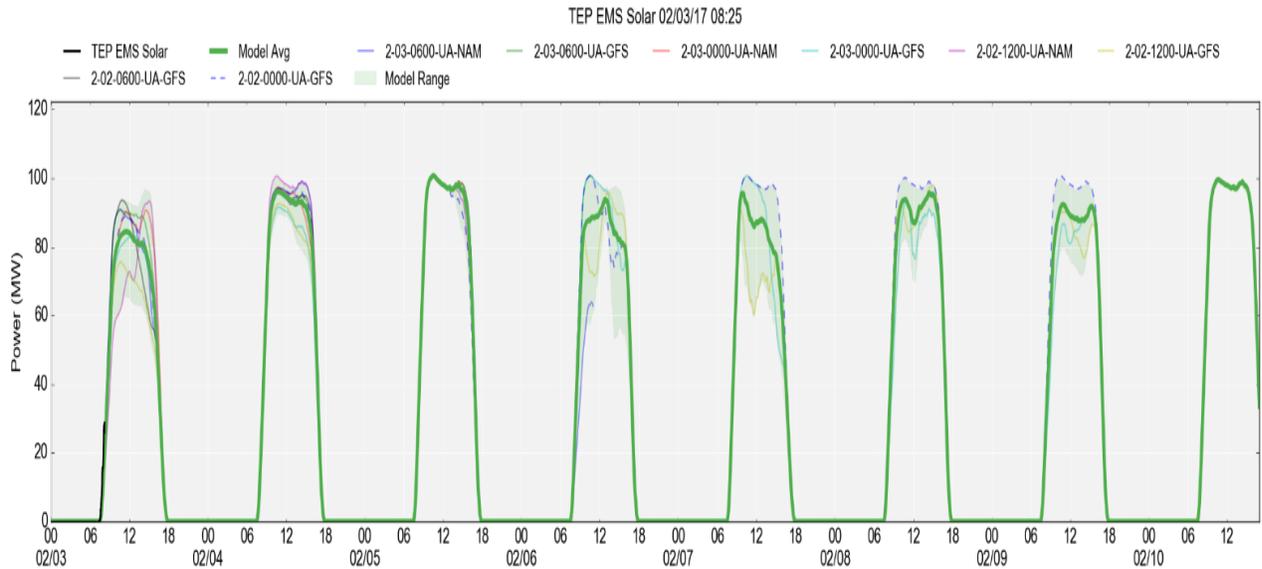


Chart 14 – TEP Utility Scale Wind Forecast

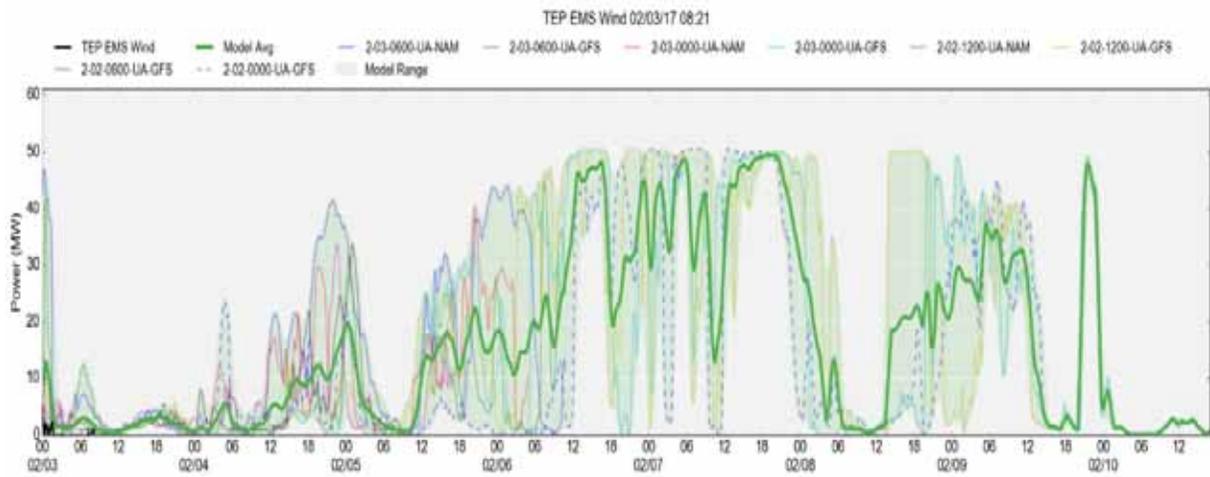

TEP can see how and if the models that go into the power forecast agree, by looking at the green shading seen on the above forecasts. The confidence intervals represented on the forecasts are reliable through three days. Past the three day mark, however, the forecast’s confidence intervals become less and less reliable. A large majority of the uncertainty apparent after three days comes from the uncertainty that is apparent in global weather conditions.

Environmental Regulations

Overview

The electric generating sector currently faces numerous regulations related to air quality, waste generation, protection of waterways, and climate change. Fossil fuel-fired power plants, particularly coal-fired power plants, are significant sources of sulfur dioxide (SO₂), nitrogen oxides (NO_x), particulate matter (PM), and carbon dioxide (CO₂) as well as mercury and other hazardous air pollutants. These power plant emissions are limited through several statutory and regulatory programs. As these regulatory programs have evolved, they have had, and will continue to have important implications for public health, for the mix of U.S. generating resources, and for economic growth by driving investment in new and cleaner technologies and contributing to the retirement of the more inefficient and higher polluting plants. The discussion below provides a snapshot of the major environmental regulatory programs facing the electric generating sector that may have an impact on TEP.

Regional Haze

The EPA's Regional Haze Rule establishes a goal to reduce visibility impairment in Class I areas (National Parks, Monuments, etc.) to natural conditions by 2064. Progress toward this long-term goal is measured in 10-year planning periods. For each planning period, states must develop plans that establish goals and emission reduction strategies for improving visibility by reducing emissions from sources located within their respective jurisdictions. Because Navajo and Four Corners are located on the Navajo Indian Reservation, they are not subject to state oversight; the EPA oversees regional haze planning for these power plants. These state plans must achieve "Reasonable Progress" toward the 2064 goal, and are reviewed by EPA in relation to that objective.

During the first planning period (2009-2018) the rule included an additional requirement referred to as Best Available Retrofit Technology (BART). BART applied to certain industrial facilities built between August 1962 and August 1977. In the western U.S., Regional Haze BART determinations have focused on controls for NO_x, often resulting in a requirement to install selective catalytic reduction (SCR). Several plant owners subject to BART determinations that called for SCR negotiated alternative to BART provisions in which equivalent or greater emission reductions were achieved through unit retirements combined with other measures in lieu of installing SCR. Final BART provisions applicable to plants owned by TEP are summarized in Table 7 below.

Table 7 - Final BART NO_x Provisions for TEP-Owned Plants

Plant TEP Ownership	BART Provisions	Alternative to BART Provisions
Four Corners 7% of Units 4 and 5 110 MW	SCR on all five units One Unit (Unit 4 or 5) by October 2016 The remaining four units by October 2017 Plant-wide emission rate of 0.11 lbs./MMBtu	Closure of Units 1-3 by January 2014 SCR on Units 4 and 5 by August 2018 Plant-wide emission rate of 0.098 lbs./MMBtu
San Juan 50% of Units 1 and 2 340 MW	SCR on all four units by September 2016 Emission rate of 0.11 lbs./MMBtu	Closure of Units 2 and 3 by January 2018 SNCR on Units 1 and 4 by February 2016 Emission rate of 0.23 lbs./MMBtu
Navajo 7.5% of Units 1-3 168 MW	SCR on all three units Emission rate of 0.055 lbs./MMBtu	Closure of one unit by January 2020 SCR on the remaining units by January 2031 Emission rate of 0.07 lbs./MMBtu
Sundt Unit 4 100% 120 MW	SNCR on Unit 4 Unit operates on coal or natural gas Emission rate of 0.36 lb./MMBtu	Unit eliminates coal as a fuel source Emission rate of 0.25 lb./MMBtu

Future planning periods will focus on a Reasonable Progress provisions. Reasonable Progress is an evaluation on the cost effectiveness of emission reductions for a source based on four factors¹⁰ and in relation to the visibility improvement goals established by the State for that planning period. The plants that have been subject to BART provisions are not likely to have further control requirements under Reasonable Progress.

Springerville Generating Station was not subject to BART, and therefore, will be evaluated for emission reductions under Reasonable Progress. According to the Arizona Department of Environmental Quality's Proposed Regional Haze 5-Year Progress Report¹¹, monitoring data from each of the 12 Class I areas in Arizona shows that visibility conditions are expected to exceed their respective 2018 Reasonable Progress goals for the 20% worst days. In addition, there are significant emission reductions expected over the next several years due to the BART determinations for plants in and near Arizona.

One of the key metrics for measuring "cost effectiveness" under a Reasonable Progress evaluation is the cost of the controls divided by amount of emission reductions achieved through implementation of those controls (i.e. \$/ton reduced). The higher the \$/ ton reduced value, the less likely that those controls will be determined to be "cost effective". Springerville is currently well controlled for SO₂, NO_x and PM emissions (see Chapter 9), meaning there is not a lot of room for further reductions, and lower tons reduced increases the \$/ton reduced value.

Based on the State's progress in improving visibility at Class I areas in the state, and the anticipated high cost of achieving further emission reductions at Springerville, for purposes of this IRP we assume no further emission reductions will be required at Springerville through a Reasonable Progress determination.

Clean Power Plan

On October 23, 2015, the EPA published a final rule regulating, for the first time, CO₂ emissions from existing power plants. In general, this final rule, referred to as the Clean Power Plan (CPP), aims to reduce CO₂ emissions from U.S. power plants by 32% from 2005 levels by 2030. More specifically, the rule establishes emission guidelines based on EPA's determination of the "best system of emission reductions", which states and tribes (hereto referred to as "states") must use to set standards applicable to the affected plants in their jurisdictions.

Arizona is one of 27 states challenging the EPA's rule making authority and Arizona has filed suit against the EPA. On February 9, 2016, the United States Supreme Court issued a stay of the CPP,¹² meaning that the rule has no legal effect pending the resolution of the state and industry challenge to the rule. That challenge is currently before the U.S. Court of Appeals for the D.C. Circuit, which heard oral arguments before an en banc court on September 27, 2016. Notwithstanding the status of the litigation, the current Administration has stated it plans to significantly modify, if not completely dismantle the rule.

While recognizing that the ultimate outcome of the CPP is highly uncertain, TEP believes it serves as an appropriate proxy for incorporating CO₂ emission constraints into long-term planning. The CPP is a final

¹⁰ Clean Air Act Sec. 169A(g)(1) "in determining reasonable progress there shall be taken into consideration the costs of compliance, the time necessary for compliance, and the energy and non-air quality environmental impacts of compliance and the remaining useful life of any existing source"

¹¹ ADEQ Air Quality Division, Proposed Arizona State Implementation Plan Revision - Regional Haze 5-Year Progress Report, September 2015

¹² http://www.supremecourt.gov/orders/courtorders/020916zr3_hf5m.pdf

agency action and was promulgated under rules pursuant to the Clean Air Act. In addition, the CPP establishes ambitious goals for emission reductions. Therefore, TEP will evaluate compliance with the CPP for all portfolios studied in this IRP.

CPP Overview

The CPP establishes emission goals for two subcategories of power plants in the form of an emission rate (lbs./MWh) that declines over the period from 2022 to 2030. Those subcategories are:

- ▶ Fossil-fired steam electric generating units (“Steam EGUs”) - includes coal plants and oil and natural gas-fired steam boilers
- ▶ Natural gas-fired combined-cycle plants (NGCC)

Then using these rates “Subcategory Rates” and the proportional generation from steam EGUs and NGCC plants in each state, the CPP derives state specific goals (“State Rates”). The CPP also converts these emission rate goals to total mass (i.e. short tons) goals for each state. Each state is required to develop a State Plan that will regulate the affected plants in their jurisdiction. TEP has effected plants in three separate jurisdictions, Arizona, New Mexico, and the Navajo Nation, and therefore, would be subject to three State Plans. Table 8 below shows the applicable rate goals.

Table 8 – CPP Rate Goals

CO ₂ Rate (lbs/MWh)	2022-2024	2025-2027	2028-2029	2030+
Subcategorized Rate - Steam EGUs	1,671	1,500	1,308	1,305
Subcategorized Rate - NGCC	877	817	784	771
State Rate - Arizona	1,263	1,149	1,074	1,031
State Rate - New Mexico	1,435	1,297	1,203	1,146
State Rate - Navajo Nation	1,671	1,500	1,380	1,305

There are three primary forms of the State Plan available to states (with sub-options):

Rate

Plants are required to meet an emission rate standard (lbs./MWh) equal to the plant’s emissions divided by the sum of its generation and the generation from qualifying renewable energy projects and/or verified EE savings. A rate plan could be administered through the use of emission rate credits (ERCs), where sources with emissions above the standard generate negative ERCs when they operate, and sources with emissions below the standard (or no emissions) generate positive ERCs. At the end of a compliance period, each affected plant must have at least a “zero” balance of ERCs.

Under the rate approach, states have the option of measuring compliance against the *State Rate* or the *Subcategory Rates*.

Mass

Plants are allocated (or otherwise acquire) allowances, the total of which equals the state’s mass goal, and each plant must surrender an allowance for each ton of CO₂ emitted during a compliance period. Owners of plants that do not have sufficient allowances can reduce emissions by curtailing production, re-dispatching to a lower

emission resource, or retiring the plant and re-distributing allowances to their remaining plants.

State Measures Instead of regulating power plants directly, a state could implement policies that will have the effect of reducing emissions in their state such as building codes, renewable energy mandates or EE standards. Compliance is measured based on emissions from the affected plants.

Arizona

The State of Arizona was proactively planning for CPP compliance; however, planning activities were put on hold after the presidential election. Much of the planning was done with the assistance of a Technical Working Group, formed to evaluate technical aspects of the plan.

The State of Arizona has previously stated it is committed to developing a State Plan, and in preparing for the initial plan submittal, ADEQ organized the options for the form of a State Plan into subsets of Rate or Mass, with the intent to focus on the most likely options.

Navajo Nation


In the proposed Federal Plan and Model Rules¹³, EPA asked for comments on whether it was “necessary or appropriate” to regulate EGUs on the Navajo Nation under the CPP. EPA has not taken action on its proposal and it is uncertain when or if it will take final action. If the EPA determines that it is inappropriate or unnecessary to regulate EGUs on the Navajo Nation, then TEP will be relieved of any CPP requirements for the Navajo Generating Station and the Four Corners Power Plant. If EPA elects to proceed with regulating these EGUs under the CPP, it is likely that the Navajo Nation would adopt a mass-based approach to CPP compliance. Under a mass-based approach, the excess allowances associated with TEP’s ownership share of the retirement of the Navajo at the end of 2019 would be sufficient to cover emissions associated with the remaining plant (Four Corners) through its planned retirement in 2031.

New Mexico

Rather than be subject to a Federal Plan, the State of New Mexico is likely to submit a State Plan SIP as well, believing that a New Mexico developed plan will provide the flexibility needed to minimize costs passed on to its residents. TEP assumes that New Mexico would also adopt a mass-based approach to CPP compliance. Under a mass-based approach, the excess allowances associated with TEP’s ownership share of the retirement of the San Juan Unit 2 at the end of 2017, and the exit from Unit 1 in 2022 would be sufficient to cover emissions associated with the remaining New Mexico plant (Luna) well beyond the planning period.

¹³ Federal Plan Requirements for Greenhouse Gas Emissions for Electric Utility Generating Units Constructed on or Before January 8, 2014; Model Trading Rules; Amendments to Frame Regulations; Proposed Rule [80 FR 64966] dated October 23, 2015.

Chart 15 – ADEQ Regulatory Framework Options¹⁴

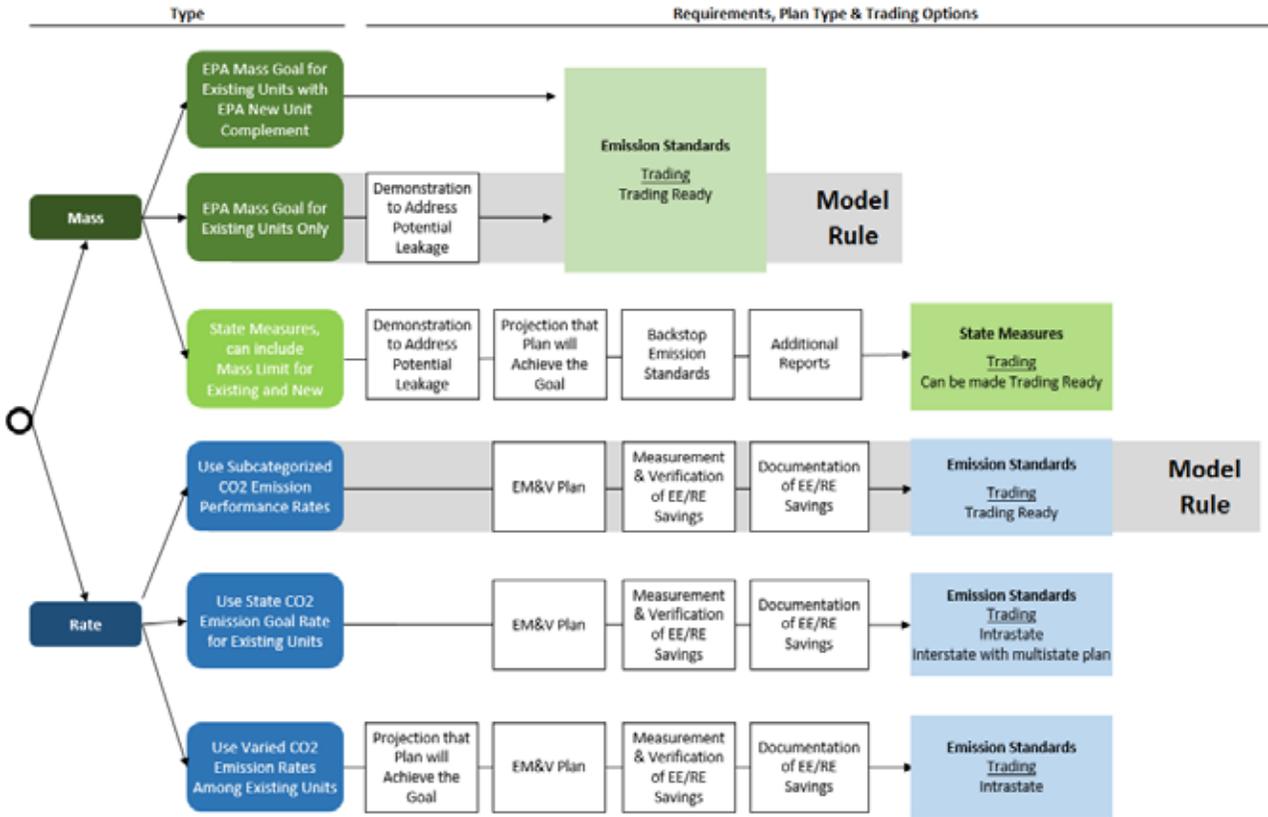


PACE Global Arizona CPP Analysis

To help evaluate the relative benefits of Rate versus Mass for Arizona, the Arizona utilities hired PACE Global (“PACE”) to conduct a modeling assessment of the relative compliance position compared to the State Rate and Mass goals based on a base case outlook. The results¹⁵ of that assessment indicate that Arizona would likely fall short of the allowances needed to cover emissions using a mass approach. However, Arizona was able to meet the rate goals for the vast majority of the compliance period studied. A rate-based plan, in general, better accommodates the need to meet future load growth with existing plants, and the subcategory rate approach is generally considered better for resource portfolios with a high percentage of coal-fired generation.

¹⁴ Ibid, ADEQ “EPA’s Final Clean Power Plan: Overview, Steve Burr, AQD, SIP Section, September 1, 2015.
¹⁵ More information can be found at ADEQ’s website <http://www.azdeq.gov/environ/air/phasethree.html#technical>

Figure 12 – PACE Global Arizona CPP Analysis

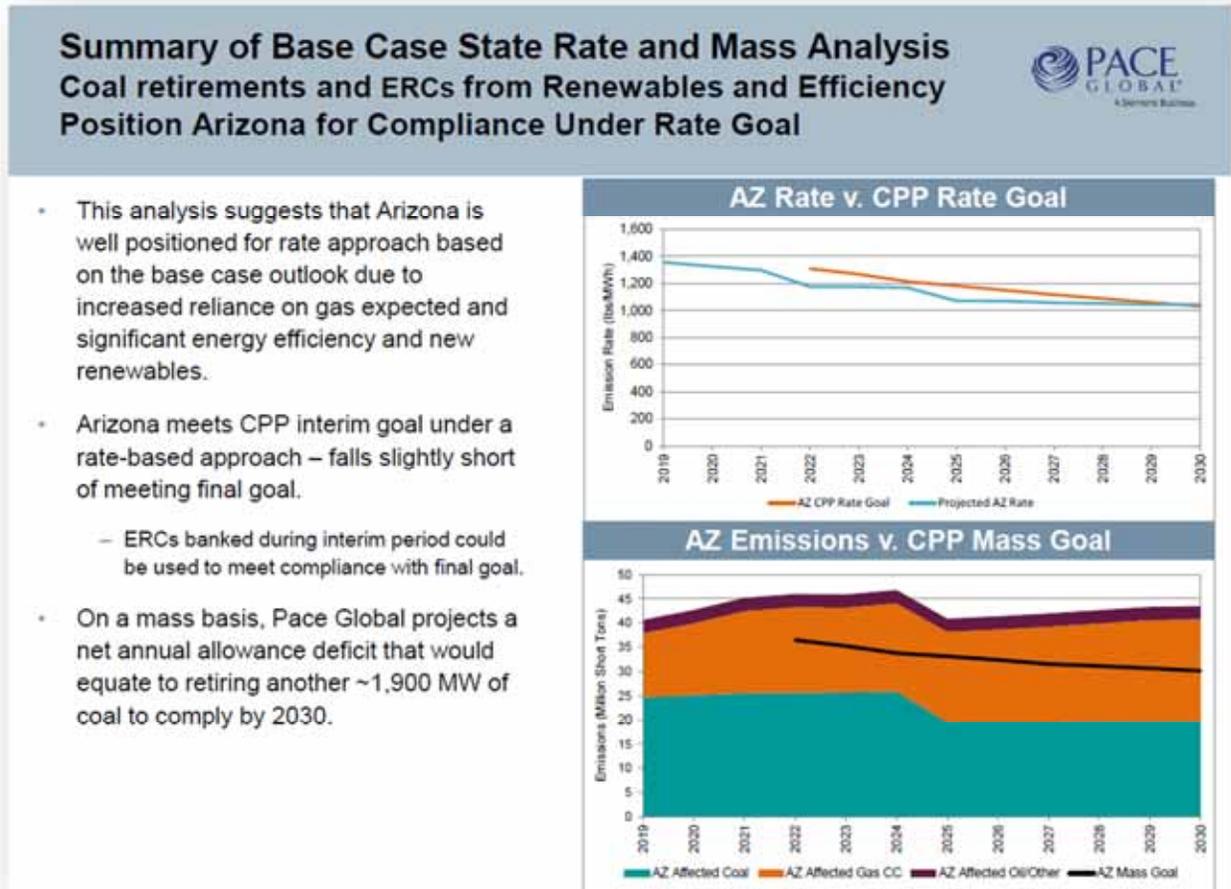

Based on the PACE work, TEP believes that Arizona is most likely to adopt a subcategorized rate approach for CPP compliance, therefore, planning portfolios studied in this IRP will be evaluated for CPP compliance under a subcategorized rate approach.


National Ambient Air Quality Standards

A core element of Clean Air Act is the establishment of National Ambient Air Quality Standards (NAAQS). NAAQS are levels of air pollution in the ambient air that are determined to be protective of the general public (including sensitive populations) with an adequate margin of safety. NAAQS have been established for six specific criteria pollutants (ozone, particulate matter, sulfur dioxides, nitrogen oxides, lead, and carbon monoxide). NAAQS have two components: primary standards to protect public health and secondary standards to protect public welfare and the environment. NAAQS are implemented through enforceable source specific emission limitations and other air quality regulations established by states via State Implementation Plans (SIPs). The SIPs detail each state’s strategy to “attain” or “maintain” the NAAQS.

The CAA requires EPA to review and, if appropriate, revise each NAAQS every five years. These revisions often result in more stringent standards, which may lead to further restrictions of emissions from power plants and other sources.

In 2015 EPA revised the primary NAAQSs for ozone, lowering the standard to 70 parts per billion (ppb). Within one year following promulgation of a standard, States and Tribes are required to submit to EPA recommended boundary designations for the attainment status (i.e. attainment, nonattainment, unclassifiable) of areas within their jurisdictions. Arizona submitted its recommended boundary designations in September 2016, recommending that two distinct areas be designated as nonattainment. TEP has no operation near the Yuma nonattainment area. The Maricopa-Pinal-Gila nonattainment area is delineated on Figure 13 below.

Figure 13 - Maricopa-Pinal-Gila Nonattainment Area Boundary

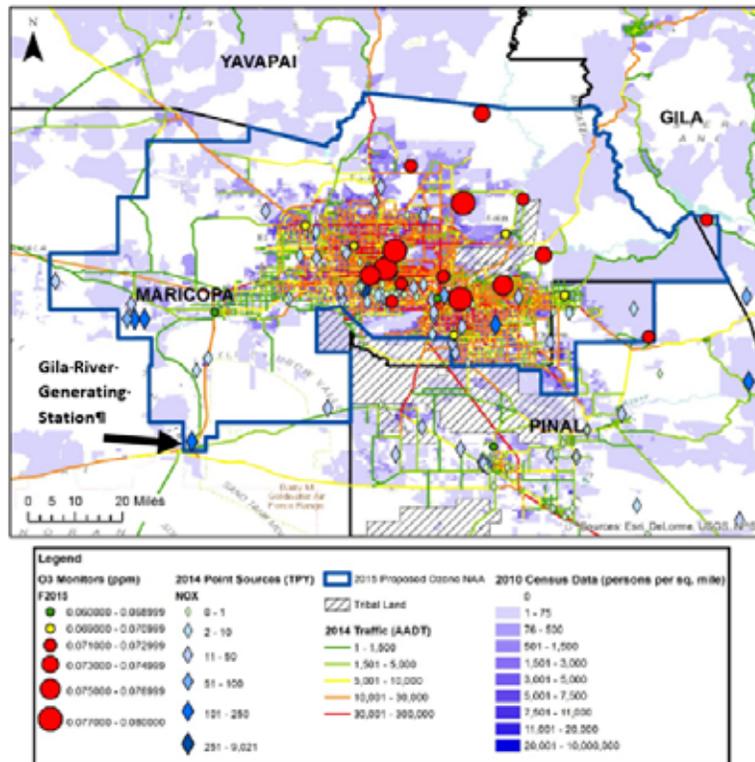

Source: Enclosure 1, ADEQ’s 2015 Ozone NAAQS Boundary Recommendations and Technical Support Document <https://www.epa.gov/sites/production/files/2016-11/documents/az-rec-enc-1.pdf>

The Gila River Generating Station is located just within the boundary of the Maricopa-Pinal-Gila nonattainment area and is, therefore, subject to nonattainment provisions of the Clean Air Act. Gila River Unit 3, partially owned by TEP, is equipped with SCR for control of NOx emissions, and therefore, is not expected to be subject to any further emission reductions due to the area’s nonattainment status. However, any expansion or significant modifications to the facility would trigger the requirement to upgrade to Lowest Available Emission Reductions (LAER) standards and offset any increase in emissions at a ratio greater than 1:1.


The Tucson metropolitan area was designated as in attainment per Arizona’s recommendation to EPA, with a maximum monitored ambient air quality concentration of 69 ppb. Therefore, new sources, and modifications of existing sources, will not currently be subject to nonattainment provisions. Attainment status is monitored on an annual basis. If future monitoring data indicates that ambient air quality in the Tucson metropolitan area exceeds the ozone standard, Arizona would be required to revise its nonattainment boundary designation.

Power Generation and Water Resources

Water availability is a major issue for utilities operating power plants, or planning new resources in the Desert Southwest. For facilities already in operation, utilities need to be cognizant of water use and supply trends in the area immediately surrounding those facilities. While existing facilities have likely secured the legal rights to the water needed for operation, there can be a disconnect between the legal right to water and its physical availability. For this reason technologies and strategies to decrease power plant water use can become an important planning goal within the integrated resource planning process. Reducing power plant water use can be accomplished either through shifting to a lower water use generating resource or through increasing power plant water use efficiency. This section provides an overview of TEP’s water use at its existing generating facilities and discusses our strategy to reduce overall water consumption.

Chart 16 presents the historical annual water use associated with TEP’s share of ownership for its steam electric and NGCC generating plants and the source of that water (i.e. surface water or groundwater).


Chart 16 – Average Annual Water Consumption by Station (TEP Share)

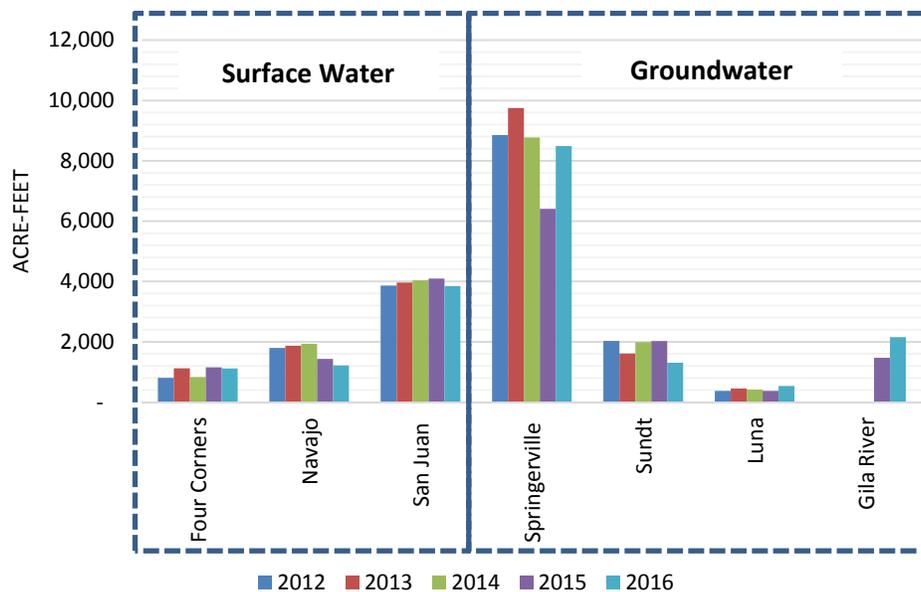

Power Generation and Water Impacts of Resource Diversification

TEP’s resource diversification strategy replaces generation from higher water use coal-fired resources with a corresponding amount of generation from lower water use NGCC plants and zero-water use renewable resources. See Chart 17 below for average water consumption rates for various electricity generation technologies. Based on these water consumption rates, TEP’s resource diversification will result in lower water consumption for power generation overall.

Chart 17 – Life Cycle Water Use for Power Generation¹⁶

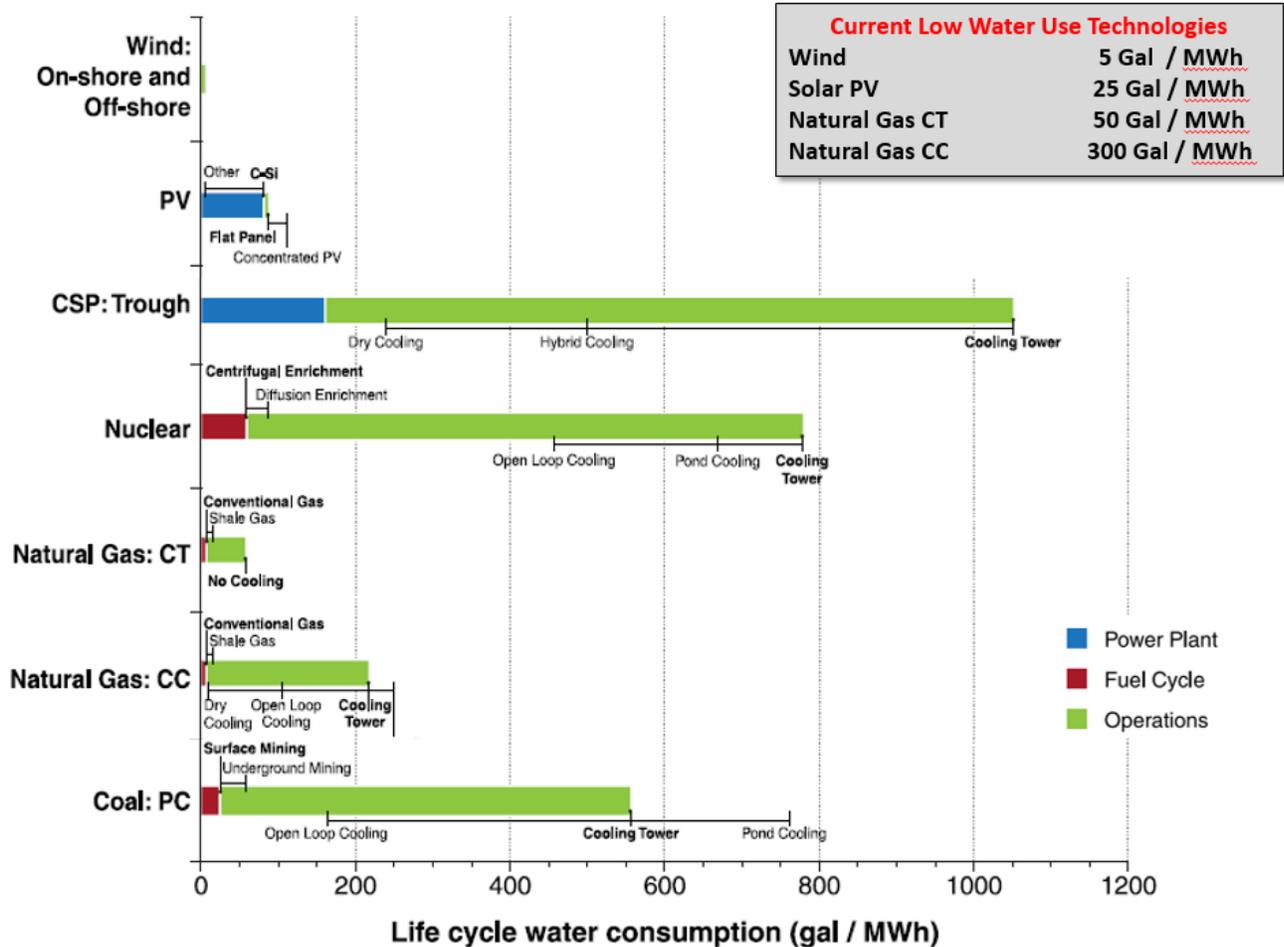

However, water consumption has a localized environmental impact as well. The availability of water that is withdrawn from surface waters, as in the case of the Navajo Generating Station (Lake Powell), the Four Corners Power Plant (Morgan Lake and the San Juan River), and the San Juan Generating Station (San Juan River), is highly dependent on precipitation and snow pack, as well as other uses. TEP’s reference case portfolio calls for retirement of or exit from each of these facilities within the planning period, with the

¹⁶ Adapted from Meldrum et. al. “Life cycle water use for electricity generation: a review and harmonization of literature estimates”, published March 3, 2013, <http://iopscience.iop.org/article/10.1088/1748-9326/8/1/015031>

majority occurring within the next six years, which significantly reduces and eventually eliminates any risk of water availability for power generation from surface waters.

The availability of water that is withdrawn from groundwater aquifers, as in the case of Springerville, Sundt, Gila River, and Luna power plants, is dependent on the recharge to and other withdrawals from the aquifer, but is also a function of the hydrogeological characteristics of the aquifer itself.

At Springerville, it is to TEP's advantage, by virtue of an agreement with a local Native American Tribe, to limit withdrawals of groundwater at the plant to 20,000 acre-feet annually. Therefore, there are water conservation measures in place at the plant, and TEP is exploring additional water conservation and reuse measures. The cooling towers for Units 1 and 2 operate at high cycles of concentration, up to 13 cycles before blowdown, which reduces the amount of water used per unit of energy generated. In addition, TEP recently hosted a pilot study at Springerville¹⁷ to demonstrate a new technology for reducing wastewater discharges through vapor recompression, which also produces a distillate that could be recirculated back to the plant. Additional technologies are being considered for demonstration projects.

Luna reduces groundwater withdrawals by supplementing the well water with treated municipal wastewater provided by the City of Deming, New Mexico. Luna is able to satisfy, on average, 12% of its total water demand from municipal wastewater.

Gila River Generating Station is located west of Phoenix, Arizona (in proximity to the Palo Verde Nuclear Generating Station). In this area there is over 6,000 MW of existing NGCC capacity that is likely to see a significant increase in generation as utilities like TEP replace coal-fired generation with generation from NGCC plants. These facilities are too far apart to have a direct impact on each other in terms of groundwater availability; however, the expected increased water use as a result of increased generation needs to be evaluated.

For the IRP, TEP will include for each portfolio the change in water consumption over the planning period. For the Reference Case Plan, the IRP will chart the annual amount of water consumed for power generation along with the source of the water (surface water or groundwater). Increasing water consumption within either of these source categories will be weighed as a risk factor for that portfolio.

¹⁷ Electric Power Research Institute (EPRI) in partnership with Tucson Electric Power, Salt River Project, and Tri-State Generation and Transmission, "AVARA Wastewater Treatment Demonstration at Springerville Generating Station", final results pending.

CHAPTER 4


A New Integration Approach to Resource Planning

With the increasing cost-competitiveness of certain renewable resources, many resource planners are in the process of integrating higher levels of renewable technologies as a complement to their existing conventional generation fleet. While some renewable technologies have achieved notional “grid parity” under certain conditions, such comparisons do not take into account the cost of system integration. As a result, today’s resource planning efforts are now focused on integrating new “grid balancing” technologies that will enable them to take advantage of higher levels of low cost, clean renewable energy.

Historically, utility planners classified traditional generation resources into four categories based on their duty-cycle and their ability to serve load. These categories were referred to as base load, intermittent, load following and peaking. As part of the 2017 IRP, TEP takes a slightly different approach to categorizing the capabilities for each type of resource in order to better describe how these resources will play a role as the Company transforms its resource portfolio over the next decade.

The four categories are described in more detail below:

Figure 14 – New Resource Categories to Meet Tomorrow Resource Needs

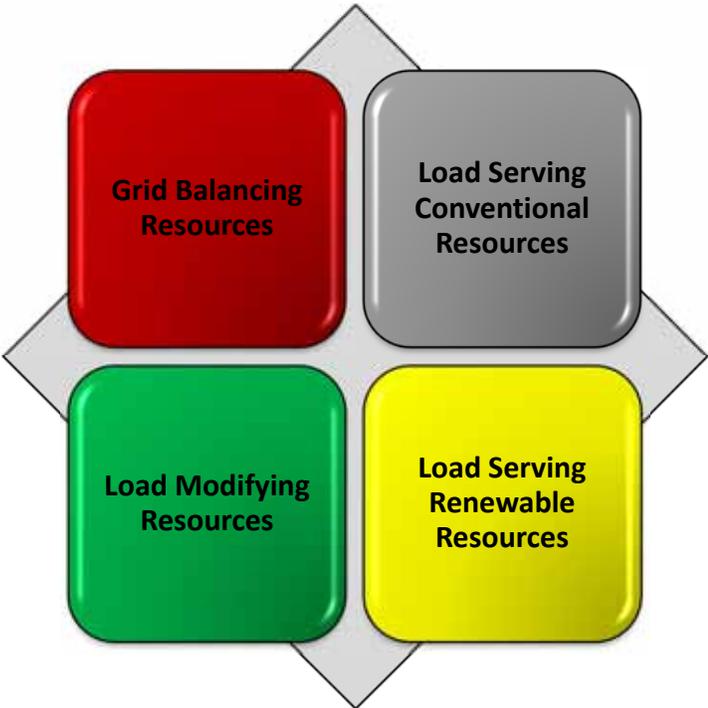

Load Modifying Resources

Load modifying resources includes EE, DG, and time of use tariffs, whose effects are primarily “behind the meter” and are therefore, largely, if not entirely beyond the view and control of the balancing authority. While both EE and DG resources reduce a customer’s net consumption, solar PV grid systems can over-generate during the day in hours when a customer’s usage is less than the solar production output.

Renewable Load Serving Resources

Renewable load serving resources are comprised of both utility scale solar and wind technologies. Both grid scale solar photovoltaics and wind are currently the lowest cost resources from an “energy only” basis. As part of the Company’s 2017 IRP, TEP plans to add approximately 800 MW of additional solar and wind resources to its generation portfolio over the next fifteen years. While utility scale solar and wind will give TEP the opportunity to develop a transformed portfolio of low-cost, zero-carbon resources, these technologies must be balanced within a portfolio of conventional load serving and grid balancing resources.

Conventional Load Serving Resources

Conventional load serving resources are comprised of coal, hydro, nuclear and natural gas technologies that are used to serve the vast majority of the energy dispatched to meet load.


Grid Balancing Resources

Grid balancing resources include natural gas combustion turbines, DR, natural gas reciprocating engines and storage technologies. These grid balancing resources will be used for peak shaving, energy arbitrage and can be used by the balancing authorities to maintain grid reliability.

Typical Summer Day Categorized by Resource Requirements

Chart 18 details how load modifying, load serving, grid balancing resources would be utilized on typical summer day.


Chart 18 - Resource Requirements on Typical Summer Day

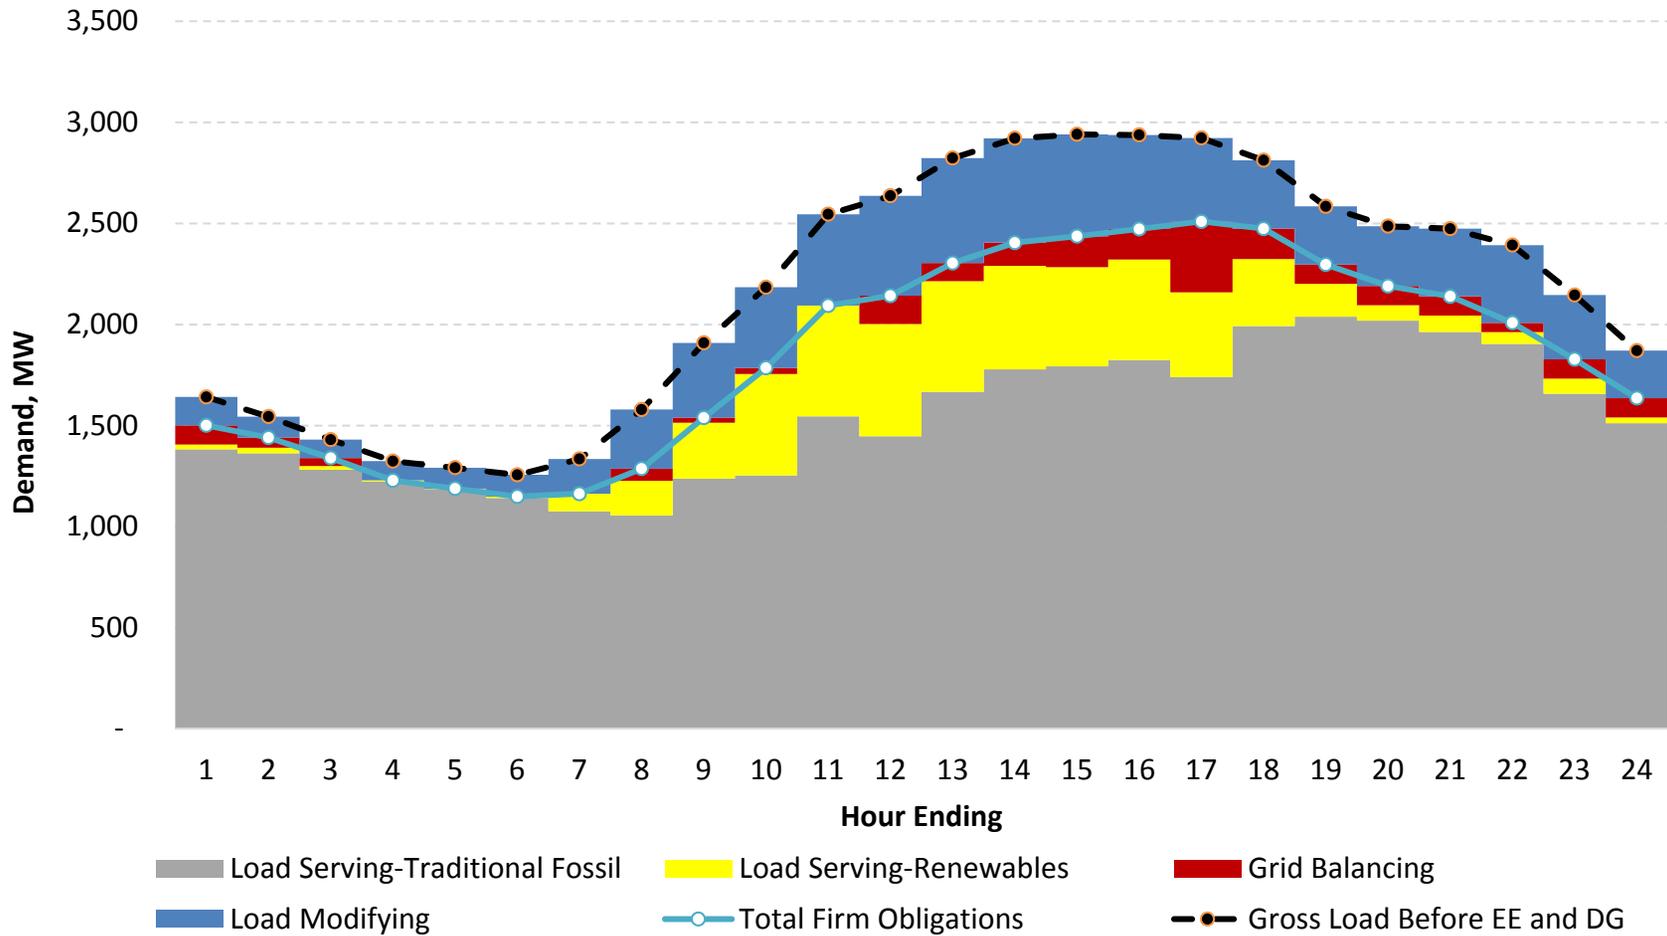

Typical Winter Day Categorized by Resource Requirements

Chart 19 details how load modifying, load serving, grid balancing resources would be utilized on typical winter day.

Chart 19 - Resource Requirements on Typical Winter Day

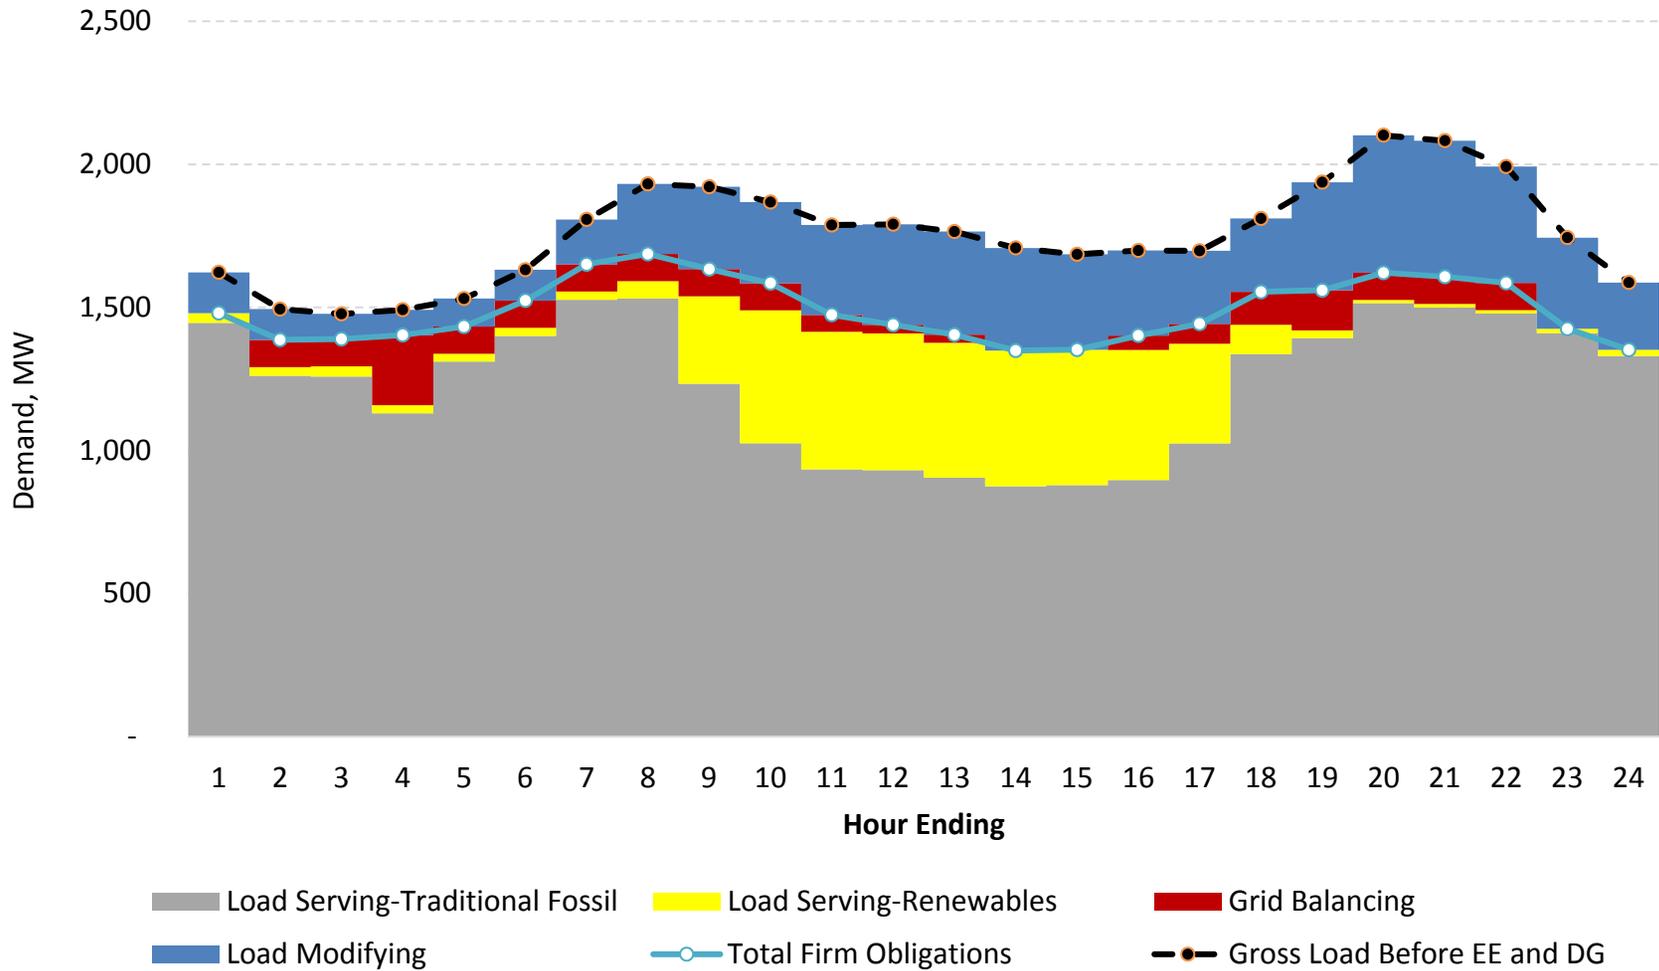

Resources Matrix

Table 9 provides a brief overview of the types of resources that were evaluated in the resource planning process within the 2017 IRP. Each technology is described by category, type, carbon profile, state of technology, primary use and whether it can be dispatched upon demand.

Table 9 - Resource Matrix

Category	Type	Zero Carbon Production	State of Technology	Primary Use	Dispatchable by Balancing Authority
Load Modifying Resources	Energy Efficiency	Yes	Mature	Base Load Reduction	No
	Distributed Generation	Yes	Mature	Intermediate Load Reduction	No
	Rate Design	(1)	Mature	Targeted Load Usage / Reductions	No
Load Serving Renewable Resources	Wind	Yes	Mature	Intermediate Generation	No
	Solar	Yes	Mature	Intermediate Generation	No
Load Serving Conventional Resources	Natural Gas Combined Cycle	No	Mature	Base Load Generation	Yes
	Pulverized Coal	No	Mature	Base Load Generation	Yes
	Small Modular Nuclear (SMR)	Yes	Emerging	Base Load Generation	Yes
Grid Balancing Resources	Reciprocating Engines	No	Mature	5 - 10 Minute Ramping	Yes
	Combustion Turbines	No	Mature	10 - 15 Minute Ramping	Yes
	Pumped Hydro Storage	(1)	Mature	1 Minute Ramping	Yes
	Demand Response	Yes	Mature	1 Minute Ramping	Yes
	Battery Storage	(1)	Emerging	1 Second Ramping	Yes

(1) Carbon intensity is dependent upon the resources that would be displaced by this rate tariff or storage technology net of charging.

Resource Benchmarking

Utility resource planning is performed using a wide spectrum of tools and methodologies. Prior to running any detailed simulation models, the resource planning team reviewed sources of information from third-parties and consultants to develop up-to-date cost parameters for the varying resource technologies. In addition, information gathered through our on-going competitive bidding processes and request for proposal solicitations was also used to derive cost estimates for new build resources and wholesale market alternatives.

Source Data

Below is a list of sources that TEP relied on to compile cost input assumptions for traditional supply-side, demand-side and renewable resources modeled in the 2017 IRP:

- ▶ **PACE Global**
Pace Global Future States of the World - Integrated Resource Planning Scenarios (December 2016)
See Appendix A

- ▶ **Burns and McDonnell**
2017 Flexible Generation Technology Assessment (March 2017)
See Appendix B

- ▶ **U.S. Energy Information Administration**
Annual Energy Outlook 2017 (August 2016)
https://www.eia.gov/forecasts/aeo/electricity_generation.cfm

- ▶ **National Renewable Energy Laboratory**
Renewable Electricity Futures Study (2016)
http://www.nrel.gov/analysis/re_futures/index.html

- ▶ **Sunshot Initiative**
<https://energy.gov/eere/sunshot/sunshot-initiative>

- ▶ **Lazard**
Levelized Cost of Energy Analysis 10.0 (December 2016)
<https://www.lazard.com/media/438038/levelized-cost-of-energy-v100.pdf>

- ▶ **Lazard and Enovation Partners**
Levelized Cost of Storage Analysis 2.0 (December 2016)
<https://www.lazard.com/media/438042/lazard-levelized-cost-of-storage-v20.pdf>

Lazard's Levelized Cost of Energy Analysis

Overview on Conventional and Alternative Energy Technologies

The following analysis was published as part of Lazard's Levelized Cost of Energy (LCOE) Analysis.¹⁸ This 2016 report compares the various conventional and alternative energy technologies.

Certain alternative energy technologies such as wind and utility-scale solar continue to become more cost-competitive with conventional generation technologies in some applications, despite large decreases in the cost of natural gas. Lazard's analysis does not take into account potential social and environmental externalities or reliability- or intermittency-related considerations.

Despite a sharp drop in the price of natural gas, the cost of all forms of utility-scale solar PV and utility-scale wind technologies continue to remain competitive with conventional generation technologies as illustrated by recent public announcements of bids submitted by renewable energy providers in open power procurement processes.

Currently, rooftop solar PV is not cost competitive without significant subsidies, due, in part, to the small-scale nature and added complexity of rooftop installations. However, the LCOE of rooftop solar PV is expected to decline in coming years, partially as a result of more efficient installation techniques, lower costs of capital and improved supply chains. Importantly, Lazard excludes from their analysis the value associated with certain uses of rooftop solar PV by sophisticated commercial and industrial users such as demand charge management, which appears increasingly compelling to certain large energy customers.

The pronounced cost decrease in certain renewable energy technologies, combined with the needs of an aging and changing power grid in the U.S., has significantly increased demand for energy storage technologies to fulfill a variety of electric system needs. Industry participants expect this increased demand to drive significant cost declines in energy storage technologies over the next five years. Increased availability of lower-cost energy storage will likely facilitate greater deployment of renewable energy technologies. Energy storage applications and costs are discussed below.

¹⁸ Lazard is a preeminent financial advisory and asset management firm. More information can be found at <https://www.lazard.com> Lazard's Levelized Cost Of Energy Analysis 10.0 can be found at <https://www.lazard.com/media/438038/levelized-cost-of-energy-v100.pdf>

Lazard's Levelized Cost of Storage Analysis

Overview on Energy Storage Technologies

The following analysis was published as part of Lazard's Levelized Cost of Storage (LCOS) Analysis.¹⁹ This 2016 report compares the various energy storage technologies by cost and use. Energy storage has a variety of uses with very different requirements, ranging from large-scale, power grid-oriented uses to small-scale, consumer-oriented uses. Lazard's analysis identifies a number of "use cases" and assigns detailed operational parameters to each. This approach enables meaningful comparisons of storage technologies across a number of use cases.

Cost Competitive Storage Technologies

Select energy storage technologies are cost-competitive with certain conventional alternatives in a number of specialized power grid uses, but none are cost-competitive yet for the transformational scenarios envisioned by renewable energy advocates.

Although energy storage technology has created a great deal of excitement regarding transformational scenarios such as consumers and businesses "going off the grid" or the conversion of renewable energy sources to baseload generation, it is not currently cost competitive in most applications. However, some uses of select energy storage technologies are currently attractive relative to conventional alternatives; these uses relate primarily to managing frequency regulation and transmission investment deferral.

Today, energy storage appears most economically viable compared to conventional alternatives in use cases that require relatively greater power capacity and flexibility as opposed to energy density or duration. These use cases include frequency regulation and—to a lesser degree—transmission and distribution investment deferral, demand charge management and micro grid applications. This finding illustrates the relative expense of incremental system duration as opposed to system power. Put simply, "battery life" is more difficult and costly to increase than "battery size." This is likely why the potentially transformational use cases such as full grid defection are not currently economically attractive—they require relatively greater energy density and duration, as opposed to power capacity.

The Lazard study finds a wide variation in energy storage costs, even within use cases. This dispersion of costs reflects the immaturity of the energy storage industry in the context of power grid applications. There is relatively limited competition and a mix of "experimental" and more commercially mature technologies competing at the use case level.

¹⁹ Lazard's Levelized Cost Of Storage Analysis 1.0 can be found at <https://www.lazard.com/media/2391/lazards-levelized-cost-of-storage-analysis-10.pdf> Lazard's Levelized Cost Of Storage Analysis 2.0 can be found at <https://www.lazard.com/media/438042/lazard-levelized-cost-of-storage-v20.pdf>

Future Energy Storage Cost Decreases

Industry participants expect costs to decrease significantly in the next five years, driven by the increasing use of renewable energy generation, government policies promoting energy storage and the needs of an aging and changing power grid.

Industry participants expect increased demand for energy storage to result in enhanced manufacturing scale and ability. The economies of scale created will drive cost declines and establish a production cost cycle in which energy storage cost declines facilitate wider deployment of renewable energy technology. The result will create more demand for storage and spurring further innovation in storage technology.

Cost declines projected by industry participants vary widely between storage technologies—lithium is expected to experience the greatest five year battery capital cost decline (~50%), while flow batteries and lead are expected to experience five year battery capital cost declines of ~40% and ~25%, respectively. Lead is expected to experience 5% five year cost decline, reflecting the fact that it is not currently commercially deployed.

The majority of near- to intermediate- cost declines are expected to occur as a result of manufacturing and engineering improvements in batteries, rather than in balance of system costs. Therefore, use case and technology combinations that are primarily battery-oriented and involve relatively smaller balance of system costs are likely to experience more rapid levelized cost declines. As a result, some of the most “expensive” use cases today are most “levered” to rapidly decreasing battery capital costs. If industry projections materialize, some energy storage technologies may be positioned to displace a significant portion of future gas-fired generation capacity, in particular as a replacement for peaking gas turbine facilities, enabling further integration of renewable generation.

2017 Integrated Resource Plan Levelized Cost Comparisons

The calculation of the levelized cost of energy provides a common measure to compare the cost of energy across different demand and supply-side technologies. The LCOE takes into account the installed system price and associated costs such as capital, operation and maintenance, fuel, transmission, tax incentives and converts them into a common cost metric of dollars per megawatt hour. The calculation for the LCOE is the net present value of total costs of the project divided by the quantity of energy produced over the system life.

Because intermittent technologies such as renewables do not provide the same contribution to system reliability as technologies that are operator controlled and dispatched, they require additional system investment for system regulation and backup capacity. As with any projection, there is uncertainty about all of these factors and their values can vary regionally and across time as technologies evolve and fuel prices change. Further resource utilization is dependent on many factors; the portfolio mix, regional market prices, customer demand and must-run requirements are some considerations outside of LCOE.


LCOE Assumptions – All Resources

- ▶ All LCOE costs are in 2017 dollars. Future year costs will be based on year project is installed which will incorporate inflation and technology innovation assumptions.
- ▶ Analysis excludes integration costs (e.g., grid and conventional generation investment to overcome system intermittency) for intermittent technologies.
- ▶ Analysis does not include any decommissioning costs.

2017 Levelized Cost of All Resources

Chart 20 below provides a comparison on the levelized costs of all resources used in the 2017 IRP. All costs reflect the 2017 LCOE \$/MWh.

Chart 20 - Levelized Costs of All Resources

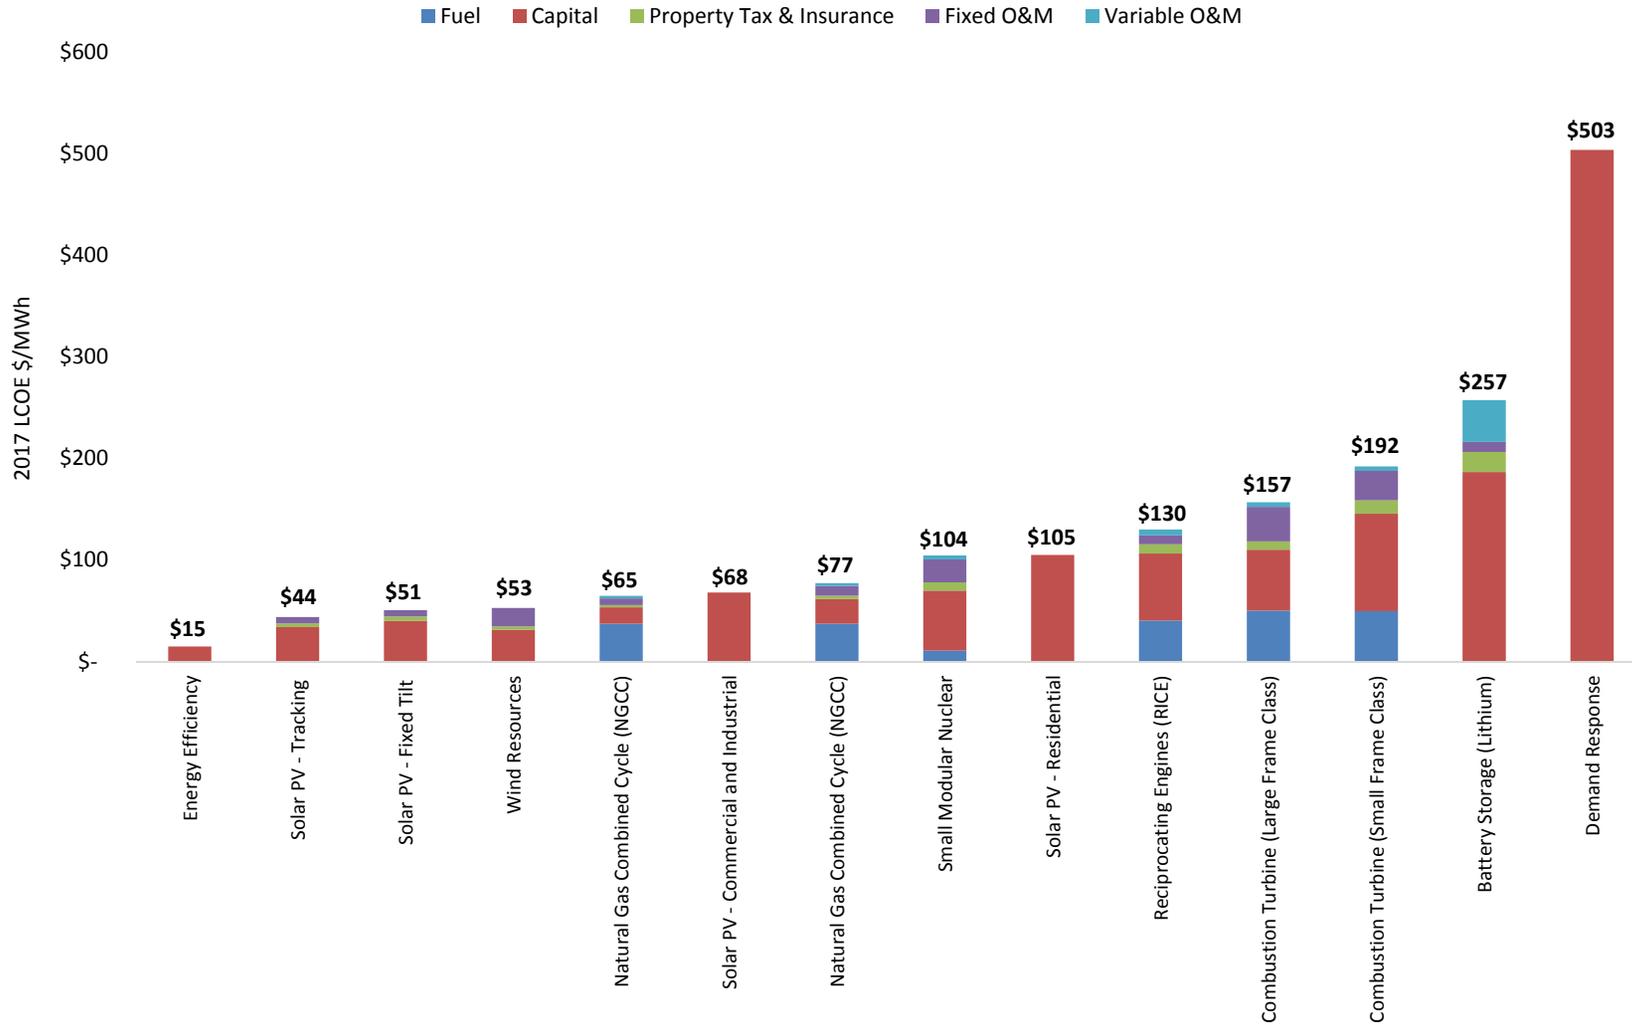


Load Modifying Resources – Cost Assumptions

Table 10 includes the load modifying resource costs for the 2017 Integrated Resource Plan.

Table 10 – Load Modifying Resources – Cost Assumptions

Energy Efficiency	Solar PV – Residential	Solar PV – Commercial and Industrial	Rate Design
Customer Efficiency Programs	Residential DG Programs	Commercial & Industrial DG Programs	Targeted Load Usage / Reductions By Time of Use
Energy Efficiency	Solar PV – Residential	Solar PV – Commercial and Industrial	Rate Design
Based on Various Customer Demand Side Programs	Based on Various Residential DG Programs	Based on Various Commercial & Industrial DG Programs	Based on Various Rate Tariff by Customer Class
\$15	\$105	\$68	Depends of Tariff

Chart 21 - Load Modifying Resources – Cost Assumptions

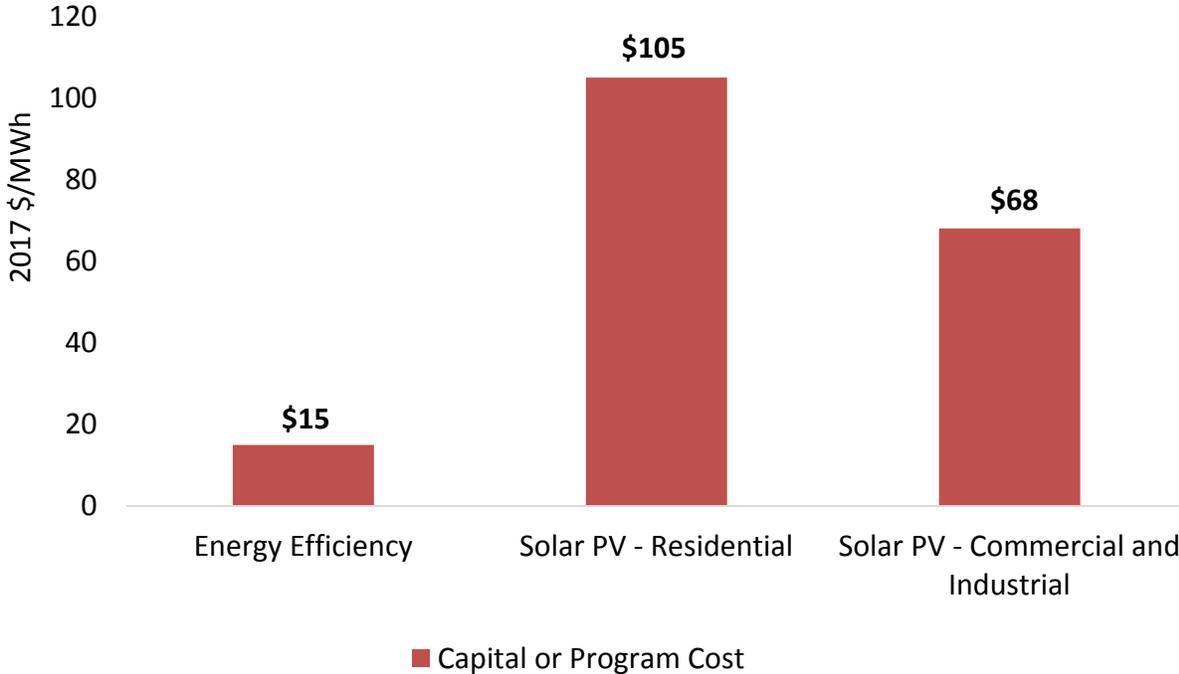

LCOE Assumptions for Load Modifying Resources

- ▶ Energy efficiency based on TEP’s projected program costs based on the average lifetime of the programs.
- ▶ Solar PV – Residential based on Lazard’s LCOE Analysis – Version 10.
- ▶ Solar PV – Commercial & Industrial based on Lazard’s LCOE Analysis – Version 10.

Renewable Load Serving Resources – Cost Assumptions

Table 11 includes the load serving renewable resource costs for the 2017 Integrated Resource Plan.


Table 11 – Renewable Load Serving Resources – Cost Assumptions

Plant Construction Costs	Units	Solar Thermal – No Storage	Solar Thermal – Ten Hour Storage	Solar PV – Fixed Tilt	Solar PV – Tracking	Wind Resources
Project Lead Time	Years	3	3	0.75	0.75	1
Installation Years	First Year	2020	2020	2018	2018	2018
Peak Capacity , MW	MW	100	110	50	50	50
Plant Construction Cost	2017 \$/kW	\$6,500	\$10,300	\$1,300	\$1,450	\$1,475
Resource Life	Years	25	35	25	25	20

Operating Characteristics	Units	Solar Thermal – No Storage	Solar Thermal – Ten Hour Storage	Solar PV – Fixed Tilt	Solar PV – Tracking	Wind Resources
Fixed O&M	2017 \$/kW	\$66.30	\$81.60	\$9.18	\$12.24	\$40.80
Variable O&M	2017 \$/MWh	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
ITC	Percent	30%	30%	30%	30%	-
PTC	\$/MWh	-	-	-	-	\$18.40
Annual Capacity Factor	Annual %	28%	52%	23%	30%	33%
Annual Output	GWh	245.3	501.1	100.7	132.7	144.5
Net Coincident Peak	NCP%	100%	34%	34%	65%	23%
Water Usage	Gal/MWh	800	-	-	-	-

Levelized Cost of Energy	\$/MWh	\$228	\$179	\$51	\$44	\$53
--------------------------	--------	-------	-------	------	------	------

Chart 22 - Renewable Load Serving Resources – Cost Assumptions

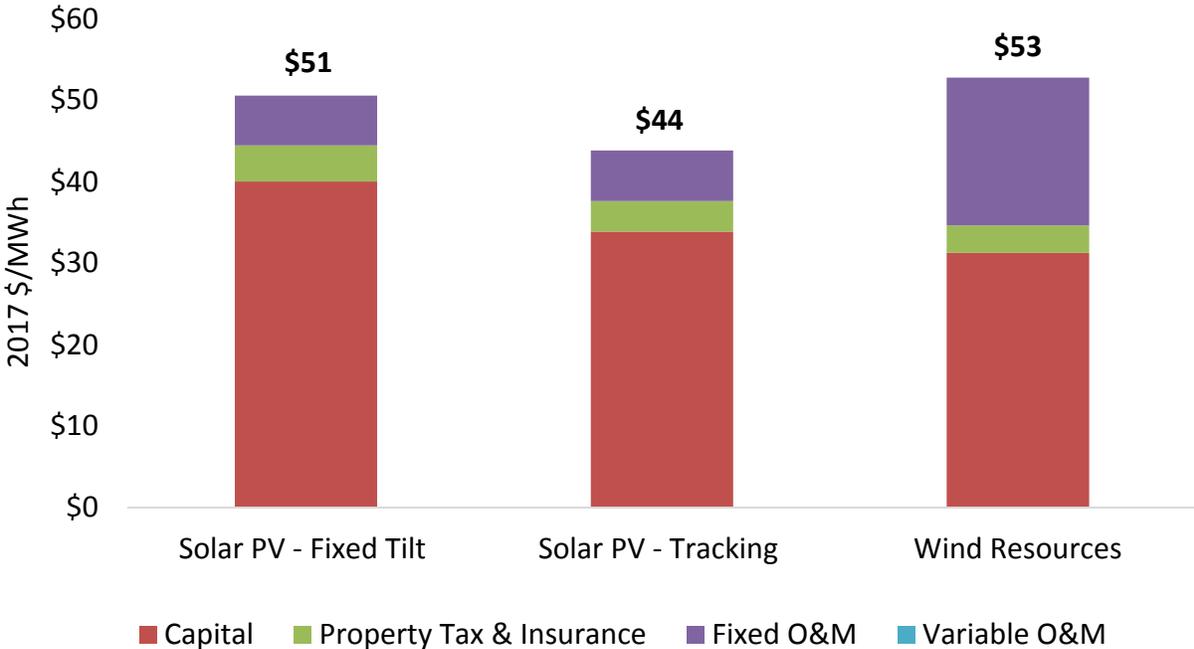

LCOE Assumptions for Load Serving Resources – Renewables

- ▶ ITC and PTC shown are for 2017 in service dates (commence construction prior to 12/31/16).
- ▶ Solar resources assume high solar insolation for projects sited in the Desert Southwest.
- ▶ Wind resources assume no ITC. PTC reflects \$23/MWh escalated at 1.5% for a term of 10 years. Capacity factors reflect projects sited in Eastern Arizona or Western New Mexico.
- ▶ Transmission wheeling costs are not reflected in cost of delivery for both solar and wind projects.

Conventional Load Serving Resources – Cost Assumptions

Table 12 includes the load serving conventional resource cost assumptions for the 2017 Integrated Resource Plan.


Table 12 - Conventional Load Serving Resources – Cost Assumptions

Plant Construction Costs	Units	Baseload NGCC	Intermediate NGCC	Small Modular Nuclear (SMR)
Project Lead Time	Years	3	3	12
Installation Years	First Year Available	2020	2020	2029
Peak Capacity , MW	MW	550	550	500
Plant Construction Cost	2017 \$/kW	\$1,100	\$1,100	\$5,100
Resource Life	Years	30	30	30

Operating Characteristics	Units	Baseload NGCC	Intermediate NGCC	Small Modular Nuclear (SMR)
Fixed O&M	2017 \$/kW	\$33.97	\$33.97	\$148.75
Variable O&M	2017 \$/MWh	\$2.04	\$2.04	\$3.06
Gas Transportation	2017 \$/kW	\$16.80	\$16.80	-
Heat Rate	Btu/kWh	7,400	7,400	9,500
Annual Capacity Factor	Annual %	75%	50%	95%
Expected Annual Output	GWh	3614.5	2,409.0	4,161.0
Fuel Source	Fuel Source	Natural Gas	Natural Gas	Uranium
Unit Fuel Cost	\$/mmBtu	\$5.04	\$5.04	\$0.90
Net Coincident Peak	NCP%	100%	100%	100%
Water Usage	Gal/MWh	350	350	800

Levelized Cost of Energy	\$/MWh	\$65	\$77	\$104
--------------------------	--------	------	------	-------

Chart 23 – Conventional Load Serving Resources – 2017 LCOE \$/MWh

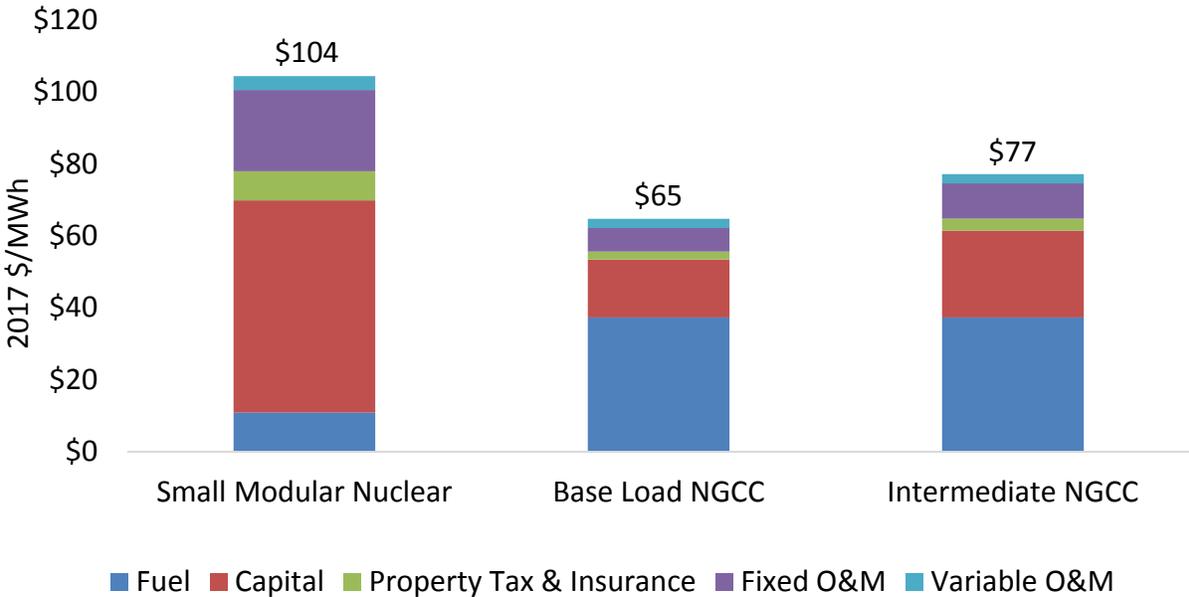

LCOE Assumptions for Load Serving Resources – Conventional

- ▶ Natural gas prices are based on PACE Global’s Base Case (Clean Power Plan) Scenario that assumes prices will average \$5.04/mmBtu from 2017 through 2032.
- ▶ Conventional resources do not include any decommissioning costs.


Grid Balancing Resources – Cost Assumptions

Table 13 includes the grid balancing resource cost assumptions for the 2017 Integrated Resource Plan.

Table 13 – Grid Balancing Resources – Cost Assumptions

Plant Construction Costs	Units	Combustion Turbine (Aeroderivative)	Combustion Turbine (Small Frame Class)	Combustion Turbine (Large Frame Class)	Reciprocating Engines (RICE)	Battery Storage (Lithium)	Demand Response
Project Lead Time	Years	2.5	2.5	2.5	1.5	0.5	Customer Load Control Programs
Installation Years	Year Available	2020	2020	2020	2018	2018	
Peak Capacity , MW	MW	45	75	220	100	100	
Construction Cost	2017 \$/kW	\$1,300	\$800	\$650	\$1,200	\$2,568	
Resource Life	Years	30	30	30	30	20	
Operating Characteristics	Units	Combustion Turbine (Aeroderivative)	Combustion Turbine (Small Frame Class)	Combustion Turbine (Large Frame Class)	Reciprocating Engines (RICE)	Battery Storage	Demand Response
Fixed O&M	2017 \$/kW	\$29.89	\$30.65	\$28.05	\$12.24	\$9.18	Based on Various Direct Load Control Programs
Variable O&M	2017 \$/MWh	\$3.57	\$3.83	\$3.57	\$4.59	\$37.35	
Gas Transportation	2017 \$/kW	\$16.80	\$16.80	\$16.80	\$16.80	-	
Heat Rate	Btu/kWh	9,800	10,500	9,900	8,000	-	
Capacity Factor	Annual %	15%	8%	12%	20%	16%	
Annual Output	GWh	59.1	52.6	231.3	175.2	140.2	
Fuel Source	Fuel Source	Natural Gas	Natural Gas	Natural Gas	Natural Gas	System	
Unit Fuel Cost	\$/mmBtu	\$5.04	\$5.04	\$5.04	\$5.04	-	
Net Coincident Peak	NCP%	100%	100%	100%	100%	100%	
Water Usage	Gal/MWh	150	150	150	50	System	
Levelized Cost of Energy	\$/MWh	\$192	\$239	\$157	\$130	\$257	\$503

Chart 24 – Grid Balancing Resources – Cost Assumptions

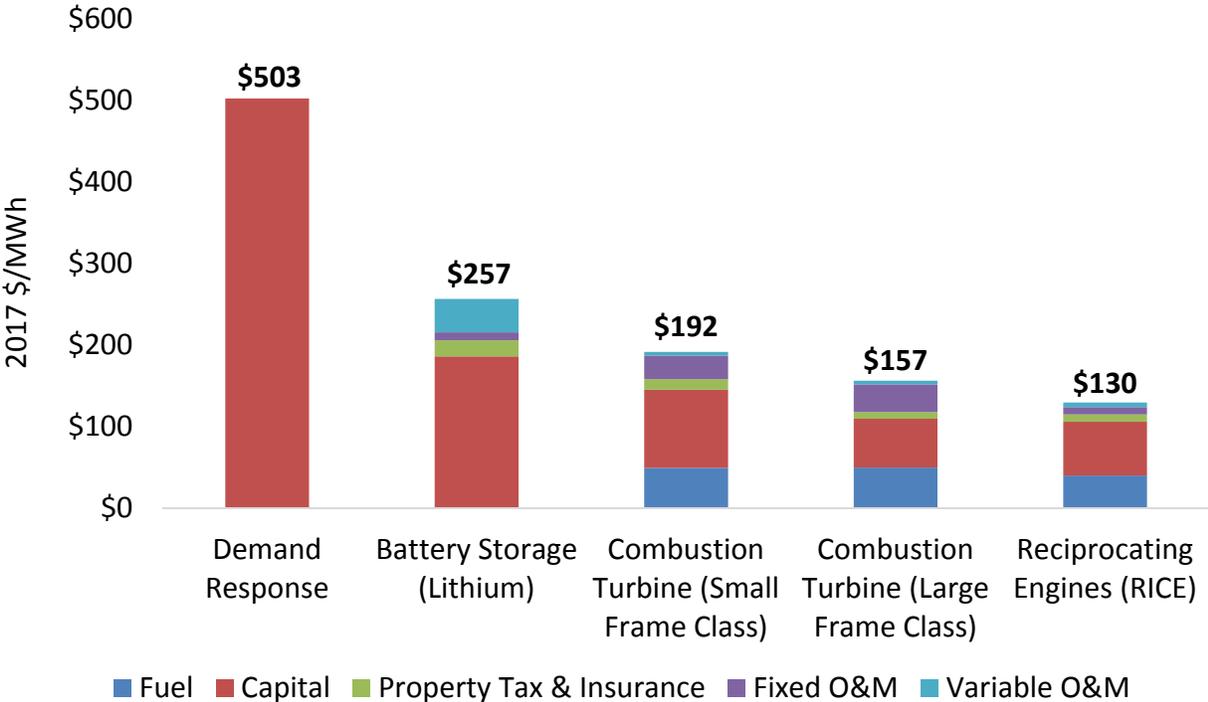

LCOE Assumptions for Grid Balancing Resources

- ▶ Natural gas prices are based on PACE Global’s Base Case (Clean Power Plan) Scenario that assumes prices will average \$5.04/mmBtu.
- ▶ Reciprocating engines are assumed to be dispatch with natural gas at a 20% capacity factor based on TEP’s resource portfolio with emphasis on supporting the integration of renewable resources. Assumes replacement cost of 65% of initial capital after 25,000 hours of operation.
- ▶ DLC costs are based on average estimated program cost of third-party load aggregators. Annual capacity factors based on limited customer interruptability. These programs assume a limit of 30 interruptible events dispatched over 6 hours totaling 180 hours per year (or 2% capacity factor).

Renewable Electricity Production Tax Credit (PTC)

The federal renewable electricity production tax credit is an inflation-adjusted per-kilowatt-hour (kWh) tax credit for electricity generated by qualified energy resources and sold by the taxpayer to an unrelated person during the taxable year. The duration of the credit is 10 years after the date the facility is placed in service for all facilities.

In December 2015, the Consolidated Appropriations Act extended the expiration date for the production tax credit to December 31, 2019, for wind facilities commencing construction with a phase-down beginning for wind projects commencing construction after December 31, 2016. The Act extended the tax credit for other eligible renewable energy technologies commencing construction through December 31, 2016. The Act applies retroactively to January 1, 2015.

The tax credit amount is adjusted for inflation by multiplying the tax credit amount by the inflation adjustment factor for the calendar year in which the sale occurs, rounded to the nearest 0.1 cents. The Internal Revenue Service (IRS) publishes the inflation adjustment factor no later than April 1 each year in the Federal Registrar. For 2015, the inflation adjustment factor used by the IRS is 1.5336.

Applying the inflation-adjustment factor for the 2014 calendar year, as published in the IRS Notice 2015-20, the production tax credit amount is as follows:

- \$0.023/kWh for wind, closed-loop biomass, and geothermal energy resources
- \$0.012/kWh for open-loop biomass, landfill gas, municipal solid waste, qualified hydroelectric, and marine and hydrokinetic energy resources.

The tax credit is phased down for wind facilities and expires for other technologies commencing construction after December 31, 2016. The phase-down for wind facilities is described as a percentage reduction in the tax credit amount described above:

Table 14 – Production Tax Credit Phase Down

Construction Year (1)	PTC Reduction
2017	PTC amount is reduced by 20%
2018	PTC amount is reduced by 40%
2019	PTC amount is reduced by 60%

(1) For wind facilities commencing construction in year.

Note that the exact amount of the production tax credit for the tax years 2017-2019 will depend on the inflation-adjustment factor used by the IRS in the respective tax years. The duration of the credit is 10 years after the date the facility is placed in service.

See <http://energy.gov/savings/renewable-electricity-production-tax-credit-ptc> for more details.

Energy Investment Tax Credit (ITC)

The Consolidated Appropriations Act, signed in December 2015, included several amendments to the federal Business Energy Investment Tax Credit which apply to solar technologies and other PTC eligible technologies. Notably, the expiration date for these technologies was extended, with a gradual step down of the credits between 2019 and 2022.

The ITC has been amended a number of times, most recently in December 2015. The table below shows the value of the investment tax credit for each technology by year. The expiration date for solar technologies and wind is based on when construction begins. For all other technologies, the expiration date is based on when the system is placed in service (fully installed and being used for its intended purpose).

Table 15 – Investment Tax Credits by Year and Technology

Technology	2017	2018	2019	2020	2021	2022	Future Years
PV, Solar Water Heating, Solar Space Heating/Cooling, Solar Process Heat	30%	30%	30%	26%	22%	10%	10%
Geothermal Electric	10%	10%	10%	10%	10%	10%	10%
Large Wind	24%	18%	12%	-	-	-	-

Solar Technologies

Eligible solar energy property includes equipment that uses solar energy to generate electricity, to heat or cool (or provide hot water for use in) a structure, or to provide solar process heat. Hybrid solar lighting systems, which use solar energy to illuminate the inside of a structure using fiber-optic distributed sunlight, are eligible. Passive solar systems and solar pool-heating systems are not eligible.

See <http://energy.gov/savings/business-energy-investment-tax-credit-itc> for more details.

Impacts of Declining Tax Credits and Technology Installed Costs

Chart 25 and Chart 26 shown below reflect the near-term capacity price declines on a \$/kW basis from 2017 - 2023 associated with the reduction in the installed costs of solar technologies relative to the levelized cost realized on a \$/MWh assuming different levels of investment tax credits by year. The solar ITC assumptions are based on the federal investment tax credit assumptions shown in Table 15 above.

Chart 25 – Solar PV Fixed, Impacts of Declining Tax Credits and Technology Installed Costs


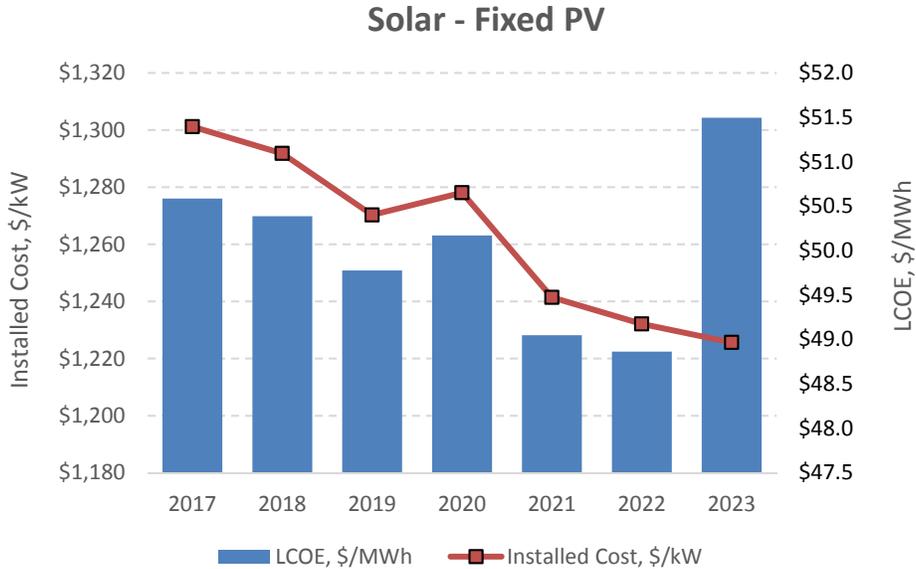



Chart 26 – Solar SAT, Impacts of Declining Tax Credits and Technology Installed Costs

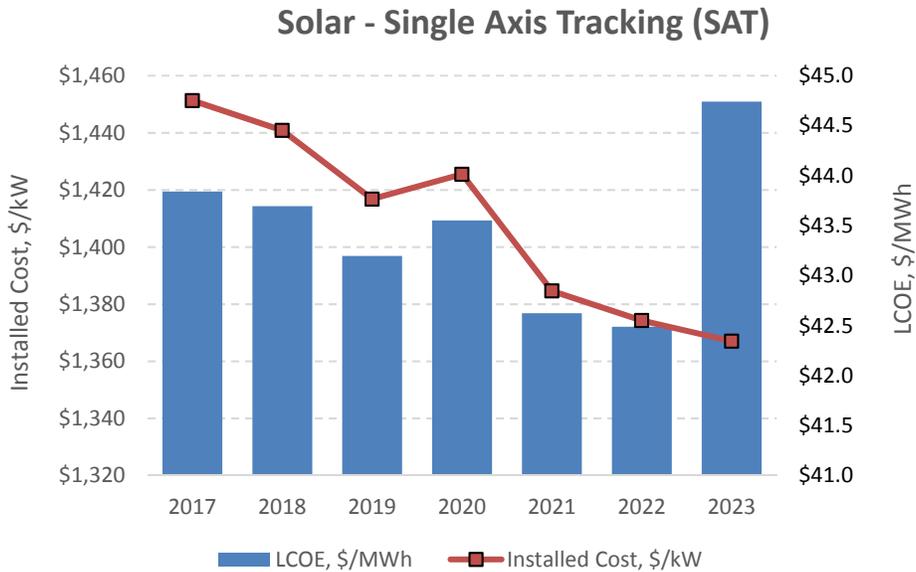

Impacts of Declining PTC and Technology Installed Costs

Chart 27 shown below reflects the near-term capacity price declines on a \$/kW basis from 2017 - 2023 associated with the reduction in the installed costs of wind resources relative to the levelized cost realized on a \$/MWh assuming different levels of production tax credits by year. The wind PTC assumptions are based on the federal production tax credit assumptions shown in Table 14 above.

Chart 27 – Wind, Impacts of Declining Production Tax Credits and Technology Price Installed Costs

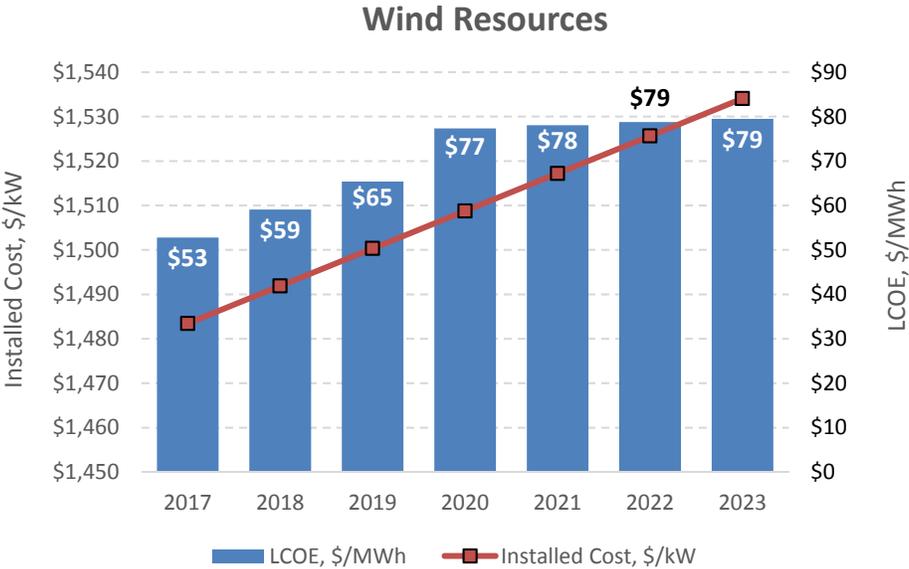

CHAPTER 5**LOAD MODIFYING RESOURCES****Energy Efficiency**

TEP recognizes energy efficiency (EE) and demand response (DR) as cost-effective ways to reduce our reliance on fossil fuels. TEP offers a variety of energy saving options for customers encouraging both homeowners and businesses to invest in EE upgrades through Demand Side Management (DSM) incentivized programs.

TEP has made great strides towards achieving the goals set by Arizona's EE Standard. The EE Standard calls on investor-owned electric utilities in Arizona to increase the kilowatt-hour savings realized through customer ratepayer-funded EE programs each year until the cumulative reduction in energy achieved through these programs reaches 22 percent of the previous year's retail sales by 2020.

The EE section presents a detailed overview of the proposed electric DSM programs targeted at the residential, commercial and industrial (C&I), and utility improvement sectors, as well as their associated proposed implementation costs, savings, and benefit-cost ratios.

TEP, with input from other parties such as Navigant Consulting, Inc. ("Navigant"), Residential Utility Consumer Office (RUCO) and the Southwest Energy Efficiency Project (SWEET), has designed a comprehensive portfolio of programs to deliver electric energy and demand savings to meet annual DSM energy savings goals outlined in the EE Standard. These programs include incentives, direct-install and buy-down approaches for energy efficient products and services; educational and marketing approaches to raise awareness and modify behaviors; and partnerships with contractors to obtain the most cost-effective return on the rate-payer dollars invested in DSM programs.

2017 Implementation Plan, Goals, and Objectives

TEP's high-level EE-related goals and objectives are as follows:

- ▶ Implement only cost-effective EE programs.
- ▶ Design and implement a diverse group of programs that provide opportunities for all customers to participate in.
- ▶ Achieve energy savings goals set in the EE Standard through 2020.
- ▶ When feasible, maximize opportunities for program coordination with other efficiency programs (e.g. Southwest Gas Corporation, Arizona Public Service Corporation) to yield maximum benefits.
- ▶ Maximize program savings at a minimum cost to the rate payer through comprehensive and cost-effective programs.

- ▶ Provide TEP customers and contractors with direct web access to detailed information on all efficiency programs (residential and commercial) for electricity savings opportunities at <http://www.tep.com>
- ▶ Expand the EE infrastructure in the state by increasing the number of available qualified contractors through training and certification in specific fields.
- ▶ Use trained and qualified trade allies such as electricians, HVAC contractors, builders, manufacturers, architects, and engineers to transform the market for efficient technologies.
- ▶ Inform and educate customers to modify behaviors that enable them to use energy more efficiently.

Planning Process

TEP's portfolio of programs incorporates elements of the most successful EE programs across North America. Programs are designed in consideration of the Tucson market and provide cost-effective programs for TEP customers. A substantial amount of information including evaluations, program plans and studies were used to develop specific programs for TEP. With input from Navigant, RUCO and SWEEP, TEP also used a benchmarking process to review the most successful EE programs from across the country, with a focus on successful Desert Southwest programs to help shape the portfolio.

TEP used the following strategies to produce the lowest cost portfolio of EE programs:

- ▶ Implementing primarily industry accepted programs that have been successfully applied by other utilities in the Southwest and across the country.
- ▶ Implementing programs through a combination of third-party contractors and TEP staff. TEP utilizes implementation contractors where they provide particular industry expertise and/or tools.

Program Screening

TEP uses rigorous models to evaluate the costs, benefits, and risks of EE and DSM programs and measures. These models are designed to estimate the capacity and energy values of EE and DR measures at an hourly level. By examining projected program performance and cost effectiveness over a wide variety of weather and cost conditions, TEP is able to measure the risks and benefits of employing EE and DSM measures versus traditional generation capacity additions, and further, to ensure that DSM resources are compared to supply side resources relatively.

The analysis of EE and DSM cost-effectiveness has traditionally focused primarily on the calculation of specific metrics, often referred to as the Societal Cost Test (SCT). As detailed in Table 16 - Comparative Benefit-Cost Tests, there are five major benefit-cost tests commonly utilized in the EE industry, each of which addresses different perspectives. The EE Standard established that the societal cost test should be used as the key perspective for determining the cost-effectiveness of EE measures and programs. Regardless of which perspective is used, benefit-cost ratios greater than or equal to 1.0 are considered cost-effective. While various perspectives are often referred to as tests, the following list of criteria demonstrates that decisions on program development go beyond a pass/fail test.

Table 16 - Comparative Benefit-Cost Tests

	SOCIETAL COST TEST	TOTAL RESOURCE COST TEST	UTILITY RESOURCE COST TEST	PARTICIPANT COST TEST	RATE IMPACT MEASURE TEST
BENEFITS					
Reduction in Customer's Utility Bill				✓	
Incentive Paid by Utility				✓	
Any Tax Credit Received		✓		✓	
Avoided Supply Costs	✓	✓	✓		✓
Avoided Participant Costs	✓	✓		✓	
Participant Payment to Utility			✓		✓
External Benefits	✓				
COSTS					
Utility Administration Costs	✓	✓	✓		✓
Participant Costs	✓	✓		✓	
Incentive Costs			✓		
External Costs	✓				
Lost Revenues					✓

Utility Resource Cost Test

The Utility Resource Cost Test (UCT), also referred to as the Program Administrator Test (PAT), measures the net benefits of a DSM program as a resource option based on the costs and benefits incurred by the utility (including incentive costs) and excluding any net costs incurred by the customer participating in the efficiency program. The benefits are the avoided supply costs of energy and demand, the reduction in transmission, distribution, generation and capacity valued at marginal costs for the periods when there is a load reduction. The costs are the program costs incurred by the utility, the incentives paid to the customers, and the increased supply costs for the periods in which load is increased.

Total Resource Cost

The Total Resource Cost (TRC) is a test that measures the total net resource expenditures of a DSM program from the point of view of the utility and its ratepayers. Resource costs include changes in supply and participant costs. A DSM program that passes the TRC test (i.e., has a ratio greater than 1) is viewed as beneficial to the utility and its customers because the savings in electric costs exceed the DSM costs incurred by the utility and its customers.

Participant Cost Test

The Participant Cost Test (PCT) illustrates the relative magnitude of net benefits that go to participants compared with the net benefits achieved from other perspectives. The benefits derived from this test reflect reductions in a customer's bill and energy costs plus any incentives received from the utility or third parties,

and any tax credit. Savings are based on gross revenues. Costs are based on out-of-pocket expenses from participating in a program, plus any increases in the customer's utility bills.

Rate Impact Measure Test

The Rate Impact Measure (RIM) Test measures the change in utility energy rates resulting from changes in revenues and operating costs. Higher RIM test scores indicate there will be less impact on increasing energy rates. While the RIM results provide a guide as to which technology has more impact on rates, generally it is not considered a pass/fail test. Instead, the amount of rate impact is usually considered at a policy level. The policy level decision is whether the entire portfolio's impact on rates is so detrimental that some net benefits have to be forgone.

Societal Cost Test

The SCT is similar to the TRC test, but it is also intended to account for the effects of externalities (such as reductions in CO₂, nitrogen oxides NO_x, and sulfur dioxide SO₂). One additional difference between the TRC and the SCT is that the SCT uses a societal discount rate in its analysis. The SCT is the regulated benefit/cost analysis required in the EE Standard. TEP has provided a SCT that accounts for the societal discount rate.

Current Energy Efficiency and DSM Programs

TEP's 2016 Energy Efficiency Plan was filed on June 1st, 2015, in accordance with Section R14-2-2405 of the EE Standard, for approval of EE and DSM programs with the ACC (Docket No. E-01933A-15-0178). TEP received the final order for approval for these programs from the ACC in Decision No. 75450 on February 11, 2016 augmenting Decision No. 74885 (December 31, 2014). TEP has requested that the ACC continue the implementation plan approved in Decision No. 75450 to program year 2017.


TEP uses EE programs to efficiently and cost-effectively alter customer energy demand and consumption and reduce the long-term supply costs for energy and peak demand. TEP's portfolio of programs is divided into residential, commercial, behavioral, support, and utility improvement sectors with administrative functions providing support across all program areas. These programs can vary greatly in their dispatch characteristics, size and duration of load response, certainty of load response, and level and frequency of customer participation. In general, programs are offered in two primary categories, 1) EE programs that reduce energy consumption, and 2) DR programs that reduce peak demand. Table 17 below lists the Commission-approved EE and DR programs currently in the TEP portfolio. Details of these programs can be found in the 2016 Energy Efficiency Plan

Table 17 - Current Energy Efficiency Programs

Residential Sector	Appliance Recycling
	Efficient Products
	Existing Homes
	Low Income Weatherization
	Multi-Family Homes
	Residential New Construction
	Shade Trees
Behavioral Sector	Behavioral Comprehensive
	Home Energy Reports
Commercial & Industrial Sector	Bid for Efficiency
	Combined Heat & Power
	C&I Comprehensive
	Commercial New Construction
	Commercial Schools
	Retro-Commissioning
	Small Business Direct Install
Support Sector	Consumer Education and Outreach
	Energy Codes and Standards
Utility Improvement Sector	C&I Direct Load Control
	Conservation Voltage Reduction
	Generation Improvement and Facilities Upgrade

Chart 28 shows the actual segmentation of energy savings across sectors as a result from the 2016 implementation.

Chart 28 – 2016 DSM Portfolio Composition by Sector

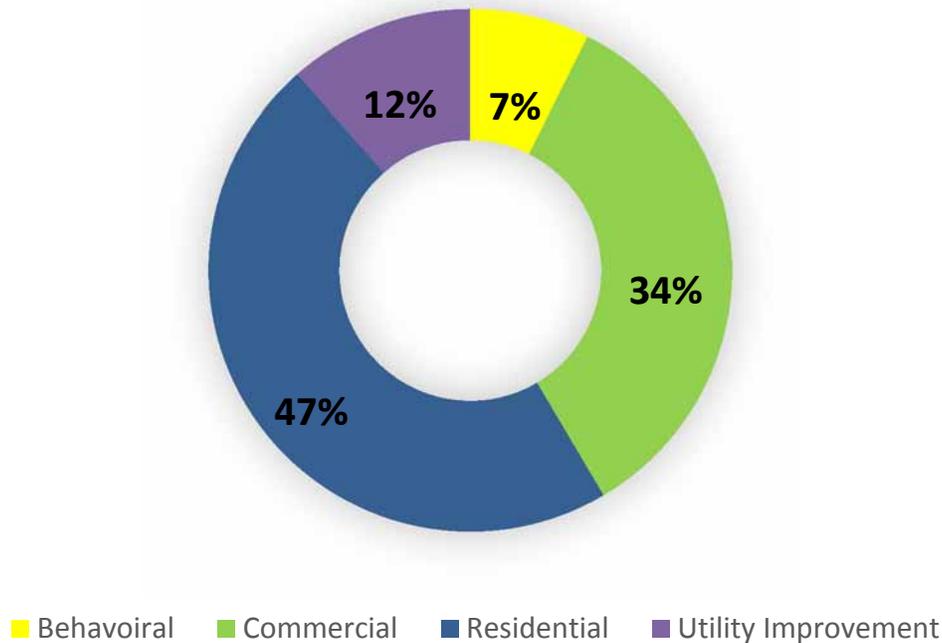

Resource Planning Integration

DSM Forecasting

Consistent with the ACC's Decision No. 71435 on Resources Planning, TEP forecasted cumulative energy savings for TEP's DSM portfolio over a 15-year time period from 2017 – 2032 including meeting Arizona's EE Standard, which concludes in 2020. TEP prepared a monthly energy and peak reduction forecasts for all years in the IRP planning period. The savings were distributed based on the actual hourly shape of all historical measures installed from 2011 through 2015 and are carried forward for the planning period. Cost dispatch modeling using this shape will approximate the impacts of EE savings on the actual system load. In addition, TEP prepared an hourly savings distribution based on the impacts of EE in 2015 and compared EE savings distribution to the shape distribution of the actual TEP system load for 2015.

In order to integrate the hourly savings impact of TEP's portfolio of DSM programs into 15-year planning horizon, TEP determined the hourly savings of each individual EE measures and then aggregated them at the portfolio-level by customer rate class. The hourly savings resolution can be summed into monthly energy and used to find peak demand savings.

TEP considered several available resources and options for determining EE measure hourly level savings data. One option was to conduct long-term end-use metering and analysis for the measures installed at

customers' premises, which would be multi-year projects and very costly. Another option was to utilize data made available from national and other state-level funded multi-year studies and research that incorporated best practices for determining hourly level measure savings. TEP found this latter option to be more prudent given the time sensitivity and expense.

TEP relied upon 8,760 hourly savings load shapes taken from widely referenced and recognized industry sources for individual EE measures that comprised each particular DSM program. These sources include:

- ▶ California's Database for Energy Efficient Resources (DEER), which is developed by the California Public Utilities Commission
- ▶ California's Commercial End-Use Survey (CEUS), which was prepared by Itron, Inc. for the California Energy Commission in cooperation with California's investor-owned utilities (i.e., Pacific Gas and Electric, San Diego Gas and Electric, Southern California Edison, Southern California Gas Company), and the Sacramento Municipal Utilities District
- ▶ Building America – National Residential Efficiency Measures Database, which is developed by the National Renewable Energy Laboratory (NREL) with support from the U.S. Department of Energy (DOE)

These load shapes were developed through extensive building end-use metering and energy simulation modeling and were normalized for historical weather conditions and patterns applicable to particular climate regions. The load shapes selected from these sources address the residential and non-residential sectors separately with different building end-uses that relate to the EE measures in the programs. TEP selected the load shapes carefully to account for seasonal or diurnal variations in operational or end-use patterns for different measures. TEP utilized the California-based DEER and CEUS load shapes only as a means to develop 8,760 hourly shaping on the EE measures. The annual savings values that will be attributed to these hourly savings load shape are calculated specifically for TEP's programs through program design and third-party Measurement, Evaluation, and Research (MER).

Since the weather-sensitive EE measure load shapes from DEER and CEUS were developed for California, TEP had to apply adjustment factors for its service territory in Arizona. First, for weather calibration purposes, TEP utilized typical meteorological year (TMY3) weather data for Tucson, Arizona and compared that to the load shapes developed for California's Climate Zone 15, which is the closest geographically as well as the most compatible weather region in California to TEP's service territory, and then adjusted hourly indexed values as needed. This approach of weather calibration ensures that weather-sensitive EE measures that have seasonal or diurnal variations in energy savings would have the appropriate effect for TEP's climate region. Furthermore, the TMY3 weather data sets, which were developed by NREL with support from DOE, are based on climate data from a period from 1991-2005. Utilizing recent historical weather data helps to weather normalize the savings effects of weather-sensitive EE measures at the hourly level. The Building America database included measure savings load shapes developed utilizing TMY3 weather data for Tucson; therefore, no such weather adjustments were needed for these load shapes.

After determining the measure shapes, TEP applied a measure's annual energy savings value with the appropriate measure end-use load shape to determine a unique measure-specific savings load shape. TEP was then able to aggregate the hourly savings value for all given measures in a particular program to determine a program-level savings load shape. From these composite program-level savings load shape, TEP was able to apply its definition of peak periods to determine coincident and non-coincident peak demand savings.

While the focus of this IRP is on future resources planning, TEP also acknowledges the importance of attributing verified savings values for individual measures and programs from MER results. TEP has retained the services of Navigant to serve as the third-party evaluation contractor for TEP's portfolio of DSM programs. Navigant verifies energy savings for programs utilizing rigorous industry evaluation standards and protocols outlined by the International Performance Measurement and Verification Protocol (IPMVP), Federal Energy Management Plan (FEMP) and the Uniform Methods Project (UMP) of the NREL.


Load Shape Results

The hourly savings determined through the Methodology Section above allowed TEP to forecast annual energy and peak demand savings for TEP's 2017 portfolio of DSM programs both to determine a 15-year outlook on resources and to meet the EE Standard savings targets by 2020.

To estimate the level of cost-effective energy savings beyond 2020, TEP relied on a report published by the EPRI titled "U.S. Energy Efficiency Potential Through 2035". Further details on TEP's assumptions for future EE are included in Chapter 10.


Chart 29 shows the EE annual savings (MWh) required to meet the Standard (including credits) through 2020, and the corresponding estimated actual reduction in retail sales through 2032.

Chart 29 – EE Annual Energy Goals (The Standard) vs. EPRI Estimated Retail Sales Reduction (MWh)

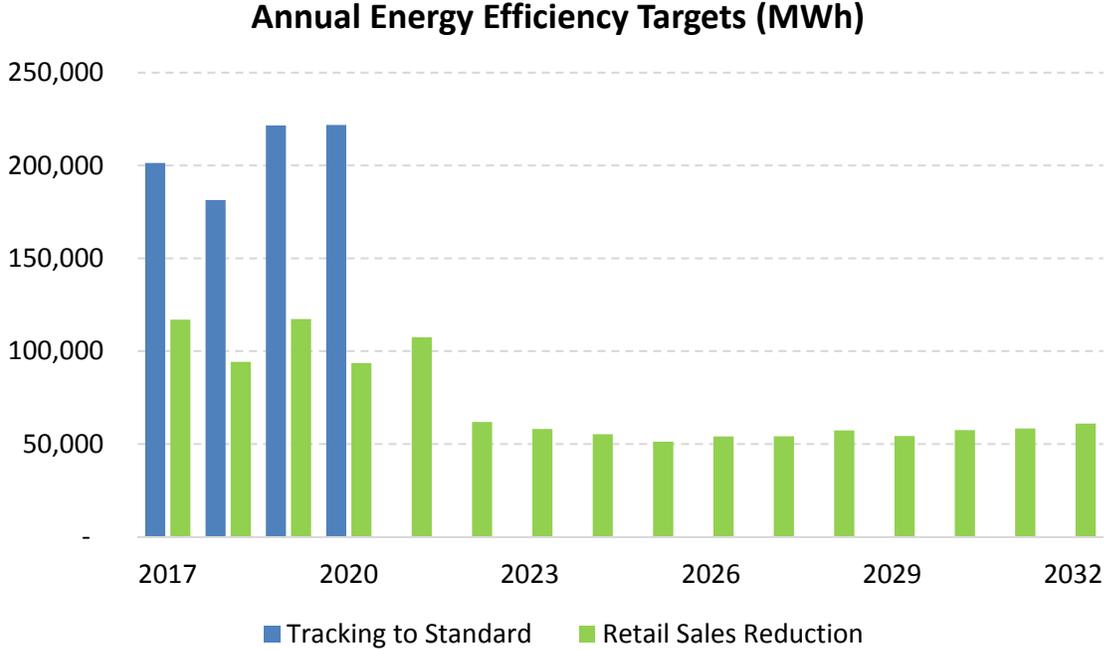

In order to evaluate EE as a resource for replacement of generation in the context of the IRP, the specific types of measures being implemented are modeled, like other resources against the forecasted system load. Modeling EE measures as a resource in TEP’s cost production model will provide a more accurate indication of the potential cost savings associated with these measures, through displacing energy (i.e. fuel) or capacity from conventional resources. Using these results, TEP can target measures that coincide with high cost resources or the system peaks, both daily and annually. Chart 30 provides a sample of how current EE measures interact with TEP’s system loads.

Chart 30 – TEP’s Typical Day Summer Load Shape vs. Cumulative EE Load Shape

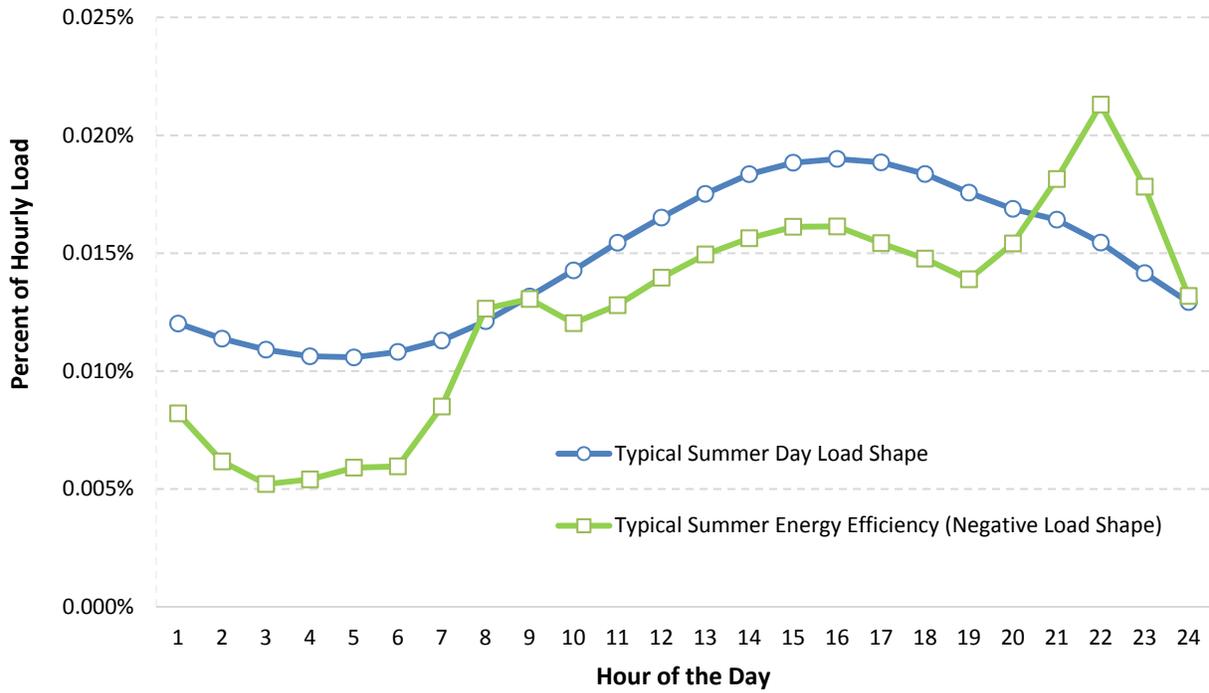

Tucson’s climate has a great impact on the system’s generation needs. As expected, TEP is a summer peaking utility, generally experiencing its greatest demand occurring in July. As shown Chart 30 the cumulative impact of EE for TEP in 2015 peaked during the 8:00PM-12:00AM timeframe. However, the TEP system load peak is between 1-8PM. In order to truly replace generation needs, EE targets and goals would need to focus more on the installation of EE measures that coincide with the system peak. Chart 30 depicts the forecasted cumulative annual peak demand savings for TEP’s portfolio of programs through 2032, based on the EE shape derived from 2015 data.

Energy Efficiency Technology Summary

Technology	Wide range of technologies and customer incentives. Technologies range from customer installed high efficiency electrical devices to design and construction of high efficiency building standards.
Characteristics	TEP offers a variety of EE programs designed for both the residential and commercial customers. The primary objective of these programs is to provide customers with consumption based information and financial incentives to reduce overall energy consumption. EE programs give customers opportunities to reduce their monthly electric bills by providing incentives for customers to invest in high efficiency technologies such as home appliances, compact fluorescent lighting, pumps, motors and HVAC equipment. Other programs provide incentives for builders to design and construct both residential and commercial buildings based on higher EE construction standards.
Benefits	Lowest cost resource. Potential environmental benefits include reductions in air emissions and water consumption. The effect of EE reduces system demand and losses and may contribute to deferring the need to construct new power plants and transmission lines.
Risks	Challenges include customer participation, market potential and sustained load reduction.
Resource Lead Time	1-2 Years

The cumulative annual peak demand savings from TEP's DSM programs does reduce the system peak with the increase in cumulative annual savings target goals in the Standard and beyond.

The implementation of TEP's DSM programs will help TEP meet the cumulative annual savings targets in the EE Standard and incorporate EE into its 15-year resource planning time-frame. EE is an important part of TEP's future resource mix. Furthermore, stratifying measure-level energy savings on an hourly level will help the planning process to identify EE measures and programs that best fit TEP's resource needs. TEP will continue to monitor DSM program activity and research EE industry best practices to determine the most cost-effective portfolio of programs that provides EE solutions to its customers and incorporates DSM investments in TEP's resource planning.

Distributed Energy Resources

Distributed Energy Resources (DER) include Distributed Generation (DG), which are small-scale, typically renewable resources often sited on utility customer premises. The Arizona RES requires that a portion of renewable energy requirements be obtained from residential and commercial DG systems. The required percentage of DG in the Arizona REST is 30% of the total renewable energy requirement. This section provides a brief overview on both residential PV systems and solar hot water heating technologies.

Figure 15 - Typical Residential Distributed PV Systems




Solar Photovoltaic DG Systems Overview

Solar PV DG systems convert sunlight directly into electricity. A residential PV power system enables a homeowner to generate some or all of their daily electrical energy needs on their roof or sometimes using a ground-mounted system. The most common type of PV system today is referred to as a “grid tied” system, which parallels the utility system and references the utility voltage and frequency to insure that the PV inverter(s) are operating properly. With a grid tied PV system, the PV system remains connected to the utility grid so that power and energy can be drawn from the utility if the PV system cannot meet the demand. PV systems may also include stand-alone battery backup or Uninterruptible Power Supply (UPS) capability to provide power and energy in the event of a utility outage. Today there are a new generation of battery systems that are capable of grid tied operation, and this will allow significant operational benefits in the future and may allow grid support operations as batteries can supplement the utility supply during peak demand times.

Every home and business that is connected to the electric utility has a main service panel, an electrical meter, and a line to the utility grid (a service drop). Power flows from the grid through the meter to the service panel where it is distributed throughout the home or business. When PV generation is added to a building, additional power from that source will also flow to the main service panel and is distributed throughout the building. In the event of a utility outage, a grid tied PV system is designed to shut down until utility power is restored. A simple grid-tied PV system diagram is show below:

Figure 16 – Residential PV System Schematic

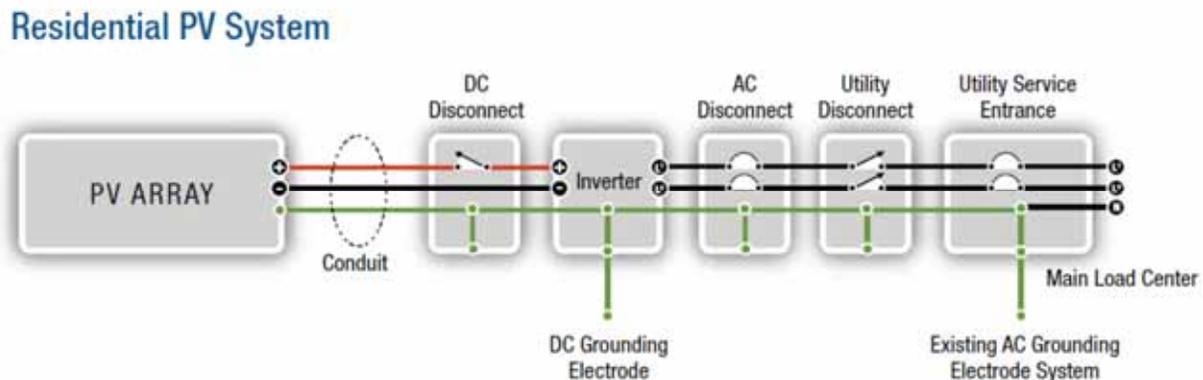


Typical System Components:

PV Array: PV systems use solar cells to convert sunlight directly into electricity. The most commonly used solar cells are made from highly purified crystalline silicon. Groups of solar cells are packaged into PV modules, which are sealed to protect the cells from the environment. Modules are wired together in series and parallel combinations to meet the voltage, current, and power requirements of the PV system. This grouping is referred to as a PV array, and the PV array produces DC power which is then converted to AC power by an inverter. PV modules typically range in size from 5-to-25 square feet and weigh about 3-4 lbs./ft².

Balance of System (BOS): The remainder of the PV system components, aside from the PV modules, is called the Balance-of-System, or BOS. BOS includes mounting hardware and wiring systems used to integrate the solar modules into the structural and electrical systems of the home or business. The wiring systems may include disconnects for the DC and AC sides of the inverter (most string inverters have AC and DC disconnects integrated into the device), ground-fault protection, and overcurrent protection for the solar modules. Many PV systems include a circuit combiner to integrate strings of PV modules. Some inverters include this fusing and combining function within the inverter enclosure. Micro-inverters have become common in the PV arena over the past few years, and the PV module is sometimes called an “AC Module”. With micro-inverters, the DC to AC conversion is achieved on each module, typically at the 300 watt power level. PV systems that utilize micro-inverters have no DC disconnects, no combiners, and the design can look quite different than the “typical grid tied PV system” shown below. Benefits of micro-inverters include the fact that one inverter failure will not have a significant impact on energy production, shading of one or several modules may not be a significant problem as it is with traditional PV systems, and the wiring of the PV system requires no DC components, but only AC wiring, which is the typical wiring that electricians are accustomed to working on, installing and servicing.

Configuration of Typical PV Systems

Figure 17 – Typical Grid Tied PV System

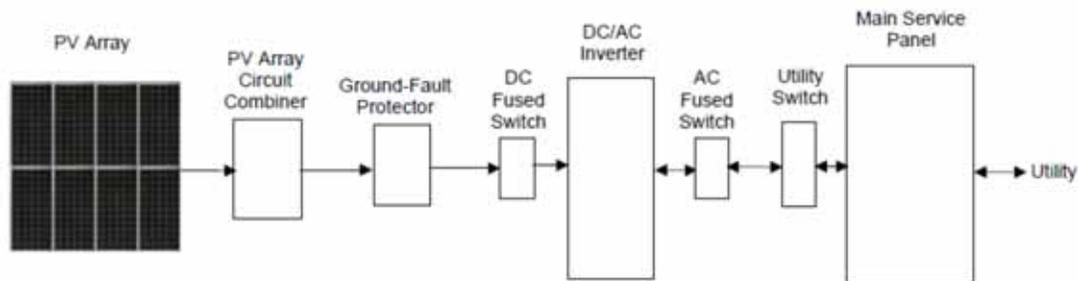

Solar Hot Water Heaters

Solar Hot Water (SHW) heating systems include storage tanks and solar collectors. There are two types of SHW systems: 1) active, which have circulating pumps and controls, and 2) passive, which don't have circulating pumps and controls. Most solar water heaters require a well-insulated storage tank. Solar storage tanks have an additional outlet and inlet connected to and from the collector. In two-tank heating systems, the solar water heater preheats water before it enters the conventional water heater. In one-tank systems, the back-up heater is combined with the solar storage in one tank. Solar water heating systems are described using four common terms:

- ▶ Active systems: use pumps to move fluids through the system
- ▶ Passive systems: rely on the buoyancy of warm water and gravity to move fluids through the system without the need for pumps
- ▶ Direct systems: heat water that feeds directly into the domestic hot water system. Direct systems always use potable water as the heat transfer fluid. In areas with high levels of dissolved minerals, carbon dioxide, or other water quality problems, these systems may require water softeners or other water quality mitigation
- ▶ Indirect systems: have independent piping and use heat exchangers to isolate solar fluids from potable domestic hot water. Systems using propylene glycol must use heat exchangers, however, water may also be used in indirect systems with heat exchangers

Figure 18 - Typical Solar Hot Water Heater System




The following system descriptions include example illustrations of system designs. In practice, systems may be configured in many different ways.

Integral Collector Storage (ICS) Passive Direct System

ICS systems are both passive and direct. The tank and collector are combined. Potable water is heated and stored in the ICS collector. As hot water is used, cold water fills the collector from the bottom. These systems work best when hot water demands are in the late afternoon and evening. Heat gained during the day may be lost at night if not used, and depends on local weather conditions. A check valve, or the arrangement of pipe runs, stops reverse thermosiphoning where heat is lost from the domestic hot water system to the night sky. These systems are the least expensive of solar thermal system designs and one of the most popular types of designs on the world market. However, they may only be used in areas that do not experience regular hard freezes. ICS collectors have more depth than flat plate collectors to accommodate integral tanks. Some builders have placed these collectors directly on the roof deck and built up around them with parapets or tile roof systems.

Integral Collector Storage (ICS) Passive Direct System

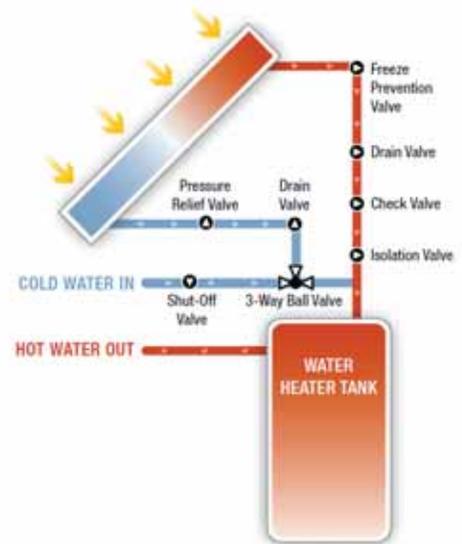


Thermosiphon Passive Direct System

Thermosiphon systems are passive with a storage tank located higher than the solar collector, and some systems may come packaged with tanks pre-mounted to collectors. In these systems the tank sits on the outside of the roof, while other systems have tanks located inside attic spaces above the collectors. These systems are direct, using potable water as the heat transfer fluid. Water pipes and tanks containing water must be protected from freezing or located in a conditioned space in climates that freeze.

Typical Installations

In general, SHW systems are mounted on a south-facing roof (in the northern hemisphere), or adjacent to the house at ground level. In either case the SHW system is generally remote from the backup and supplementary storage water heater and its tank. This distance, or the amount of finished space the loop must traverse in a retrofit installation, impacts the method and cost of installation. The most fundamental distinction is between systems that must resist freezing (closed-loop systems) and those located in climates where freezing is very rarely severe enough to threaten the integrity of the system (open-loop systems). Because closed-loop systems require either drain-back provisions or a separate freeze-protected loop to indirectly heat water in the storage tank, they generally have active components (pumps) and are more complex.

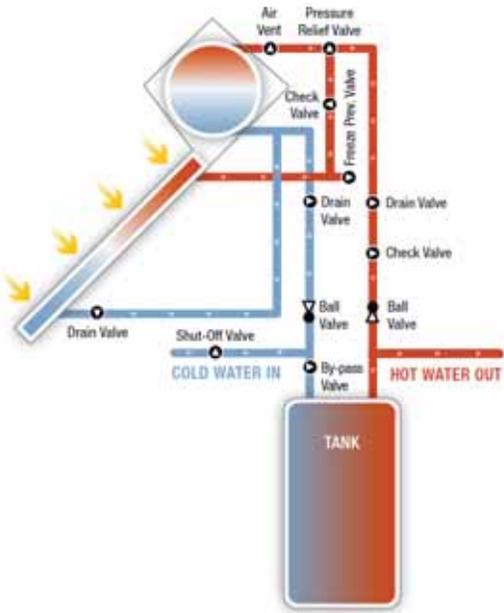

Distributed Generation Technology Summary

Technology and Fuel	Distributed Generation; Predominantly Rooftop Solar PV
Characteristics	PV cells convert sunlight directly into electricity. Cells are arranged in modules, and modules into arrays, which can be mounted in a fixed position or onto structures that enable them to track the sun.
Benefits	O&M costs are very low and not subject to future fuel prices. Emits no air pollution and consumes no water. Energy generally produced during high-demand periods. Scalability provides greater cost control and cost risk mitigation.
Risks	Unless coupled with energy storage, solar energy is only available during daylight hours and is subject to variable output during the day, depending on cloud cover.
Construction Lead Time	0.75 years

CHAPTER 6**LOAD SERVING RESOURCES****Renewable Energy**

The resource planning team relied on a number of industry experts such as Black and Veatch, United States Department of Energy, and the National Renewable Energy Laboratory to help develop the operational and cost assumptions for renewable technologies. This chapter provides an overview on the assumptions used in the resource planning evaluations. For the 2017 resource plan the following renewable technologies were considered:

- ▶ Solar – Photovoltaic (PV)
- ▶ Solar - Concentrating PV Technology (CPV)
- ▶ Solar - Concentrating Solar Power Technology (CSP)
- ▶ Wind Turbines
- ▶ Bio-Resources

Renewable resource assumptions were based on the following data sources:

1. DOE, Energy Efficiency & Renewable Energy, SunShot Initiative Website
<http://www1.eere.energy.gov/solar/sunshot/>
<https://energy.gov/eere/sunshot/about-sunshot-initiative>
2. DOE, Electricity Advisory Committee
Reports and meetings, news, etc. through 2016
<https://energy.gov/oe/services/electricity-advisory-committee-eac/electricity-advisory-committee-2016-meetings>
3. NREL Website
<http://www.nrel.gov/>
4. PACE Global Insights
5. TEP's competitive procurement process and on-going R&D efforts.

Solar PV Technology

Solar PV cells convert sunlight directly into electricity. These PV cells are the building blocks of PV modules, or panels, and these modules are the building blocks for a PV array, which can produce kilowatts to megawatts of power.

PV gets its name from the process of converting light (photons) to electricity (voltage and current), which is called the *PV effect*. The PV effect was first observed in 1839²⁰ by Alexandre Edmond Becquerel, and proven with the first practical silicon solar cell in 1954, when scientists at Bell Labs discovered that silicon (an element found in sand) created an electric charge when exposed to sunlight. Soon after, solar cells were used to power space satellites and eventually powered smaller items like calculators and watches. Today, hundreds of thousands of Americans, and millions across the world power their homes and businesses with grid tied²¹ solar PV systems. Utility companies are also using PV technology for large power stations, many in the 100s of megawatts during peak power times.

Traditional solar cells made from silicon are typically flat-plate, and generally are the most efficient²². Second-generation solar cells are called thin-film solar cells because they are made from amorphous silicon or non-silicon materials such as cadmium telluride. Thin film solar cells use layers of semiconductor materials only a few micrometers thick. Because of their flexibility, thin film solar cells can double as rooftop shingles and tiles, building facades, or the glazing for windows. All of these building material technologies are generally referred to as Building Integrated Photovoltaic.

Next-generation solar cells are being made from variety of materials other than silicon, including solar inks that may use conventional printing technologies, solar dyes, and conductive plastics. Some solar PV cells use plastic lenses or mirrors to concentrate sunlight onto a very small piece of high efficiency PV material. The PV material is generally more expensive, but because so little is needed, the systems are seen as becoming cost effective for use by utilities and industry. However, because the lenses must be pointed at the sun, the use of concentrating collectors is limited to the sunniest parts of the country that include California, Nevada, and Arizona.

Solar modules and arrays used to power homes and businesses are typically made from solar cells combined into modules that hold about 40 cells. A typical home will have an array of 10 to 20 solar panels to power the home, with an average residential PV system size of 5 kW²³. The modules are often mounted at a fixed angle facing south, or they can be mounted on a tracking device that follows the sun, allowing them to capture the most sunlight. For large electric utility or industrial applications, hundreds of solar arrays are interconnected to form a large utility-scale PV system often in the 10s or 100s of MW of nameplate capacity.

²⁰ https://www1.eere.energy.gov/solar/pdfs/solar_timeline.pdf

²¹ Grid Tied PV systems are PV systems that are connected in parallel to the electric utility grid, where some or all of the energy is consumed locally and some or all of the energy is sent back to the utility system for use by other consumers

²² For more on efficiency see <http://www.nrel.gov/pv/materials-devices.html>

²³ <http://www.seia.org/research-resources/solar-photovoltaic-technology>

Solar Resource Characteristics

Several forms of solar power technology are available today in order to capture energy from the sun. One form, solar PV, converts sunlight into direct current power. A device called an inverter then converts the direct current power into alternating current power to be used by consumers and tied to the electric grid. Another form of solar is CSP, where CSP uses large reflectors and tracking systems to gather energy from sunlight and focus it to generate heat. Heat from the concentrated sunlight may be used to produce steam that turns a turbine generator to generate alternating current power. Some CSP systems may heat molten salts or other materials to be used after the sun goes down, and when that power is needed. This is another type of energy storage that is being studied and developed throughout the world, and may help solve some of the challenges related to the diurnal nature of the sun.

In certain respects, the technological development and commercialization of utility-scale solar power is currently at a stage similar to that of wind power prior to its recent period of rapid growth and widespread adoption by the electric utility industry. For example, large amounts of capital are being invested in research, design and demonstration efforts to improve solar power generating technologies and achieve improved economies of scale. Examples include intensive R&D on advanced forms of solar PV technologies, and construction of demonstration projects based on large-scale concentrating solar generating technology.


Photovoltaic Solar Power Technology

As noted above, the two primary forms of solar power generating technologies are solar PV and concentrating solar power. PV systems make up the bulk of existing installed solar generating facilities, and can be built at practically any size – from one kilowatt to 100s of megawatts. PV modules can be connected in groups to become an array, and a PV array can be configured in many different layouts based on the available rooftop or the available land to place these arrays.



Flat-Plate Photovoltaic Array

Source: Renewable Energy Atlas of the West: A Guide to the Region's Resource Potential

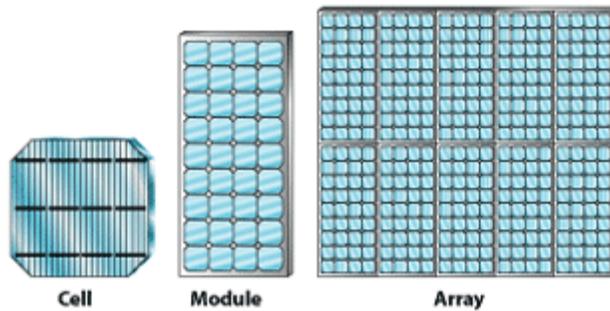


Source: NREL: National Renewable Energy Laboratory

A single PV cell produces a small amount of power. To produce more power, cells are electrically interconnected and physically mounted to a frame to form modules, which can in turn be connected into arrays to produce yet more power. Because of this modularity, PV systems can be designed to meet many electrical requirements, both large and small. PV systems can even be designed to have battery storage systems connected, providing power and energy when it is needed or for emergencies.

Flat-Plate PV Systems

The most common PV array design uses flat-plate PV modules (sometimes referred to as PV panels). These PV panels can either be fixed in place or allowed to track the movement of the sun. Tracking systems, which are more expensive to install and have higher maintenance requirements, can be single axis tracking or dual axis tracking, and generally result in a significant increase in energy production.

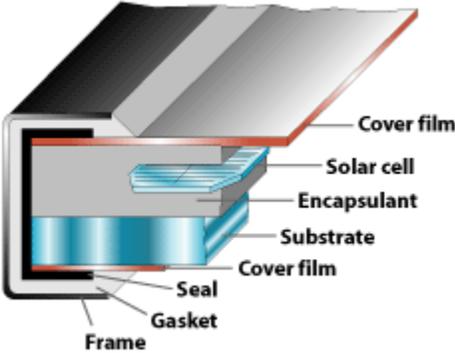

One typical flat-plate module design uses a substrate of metal, glass, or plastic to provide structural support in the back; an encapsulant material to protect the cells; and a transparent cover of plastic or glass. Source: NREL

PV systems respond to sunlight that is either direct or diffuse. Even in clear skies, the diffuse component of sunlight accounts for between 10% and 20% of the total solar radiation on a horizontal surface. On partly sunny days, up to 50% of that radiation is diffuse. And on cloudy days, 100% of the radiation is diffuse.

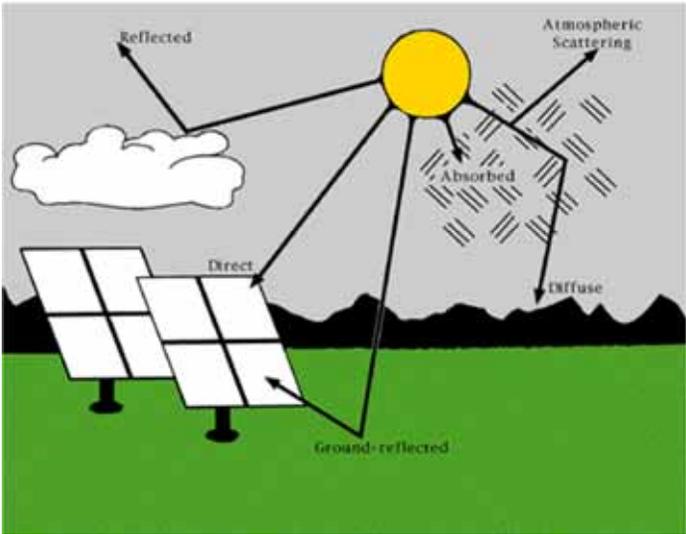


Illustration of the direct solar radiation and the indirect, diffuse radiation that contribute to a PV array. Source: NREL

Mounting Structures

PV arrays must be mounted on a stable, durable structure that can support the array and withstand wind, rain, hail, and other adverse conditions. However, stationary structures are typically designed with flat-plate systems. These structures tilt the PV array at a fixed angle determined by the latitude of the site, the requirements of the load, and the availability of sunlight. Among the choices for stationary mounting structures, rack mounting may be the most versatile. It can be constructed fairly easily and installed on the ground or on flat or slanted roofs.


The advantages of fixed arrays are that they lack moving parts, there is virtually no need for extra equipment, and they are relatively lightweight compared to tracking systems. These features make them suitable for many locations, including most residential roofs. Because the panels are fixed in place, their orientation to the sun is usually at an angle that provides less than optimal energy production and maximum energy production time of day. Therefore, less energy per unit area of a PV array is collected compared with that from a tracking array. However, this drawback must be balanced against the higher cost of the tracking system. Chart 50 illustrates the increased energy production of a single-axis tracking (SAT) system, which is dependent on location, but can provide an increase in annual energy production of up to 20-40%.

Single Axis and Dual Axis Tracking Systems

Sometimes, the solar mounting structure is designed to track the sun. There are two basic kinds of tracking structures: one-axis and two-axis. The SAT PV systems are typically designed to track the sun from east to west. They are used with flat-plate systems and sometimes with concentrator systems. The two-axis type is used primarily with PV concentrator systems. These units track the sun's daily course and its seasonal course between the northern and southern hemispheres. Naturally, the more sophisticated systems are the more expensive ones, and they usually require more maintenance.

Chart 31 - Comparison of Solar PV Systems

(Fixed Panel vs. Single Axis Tracking)

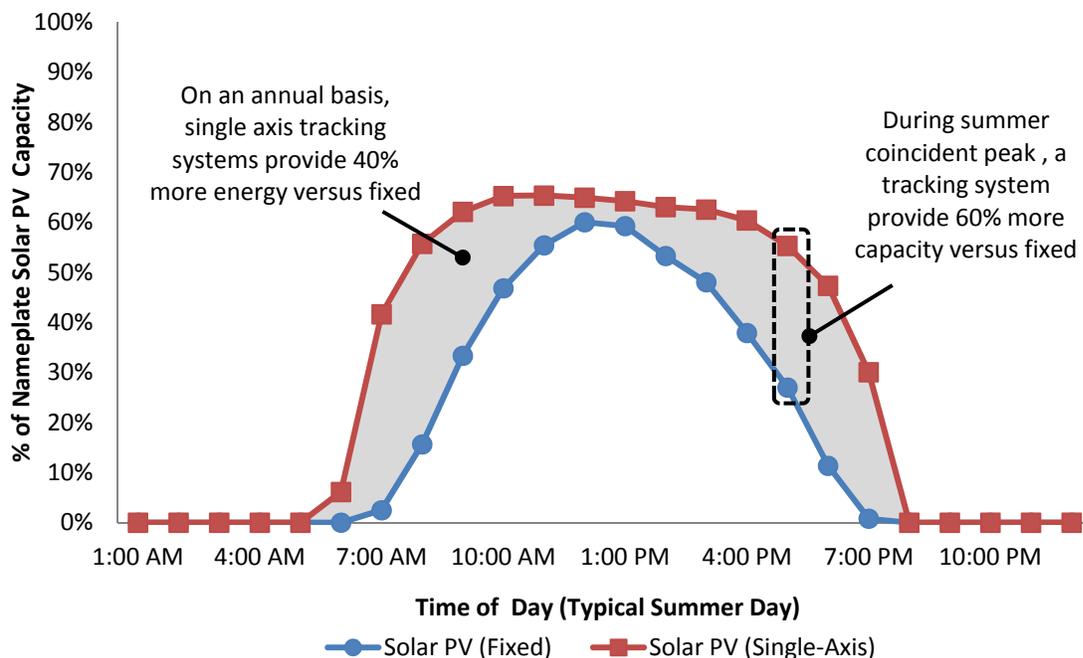


Solar PV Technology Summary

Technology and Fuel	Solar PV Technology
Characteristics	PV cells convert sunlight directly into electricity. Cells are arranged in modules, and modules into arrays, which can be mounted in a fixed position or onto structures that enable them to track the sun.
Benefits	O&M costs are very low and not subject to future fuel prices. Emits no air pollution and consumes no water. Energy generally produced during high-demand periods. Scalability provides greater cost control and cost risk mitigation.
Risks	Unless coupled with energy storage, solar energy is only available during daylight hours and is subject to variable output during the day, depending on cloud cover.
Construction Lead Time	0.75 years

U.S. Solar Map

This map shows the national solar PV resource potential for the U.S., and is based on the monthly average daily total solar resource potential on grid cells. The insolation values represent the resource available to a flat plate collector, such as a PV panel, oriented due south at an angle from horizontal to equal to the latitude of the collector location. This is typical practice for PV system installation, although other orientations are also used. Additional maps are available at the NREL website located at <http://www.nrel.gov/gis/solar.html>


Map 2 - U.S. PV Solar Resource Map

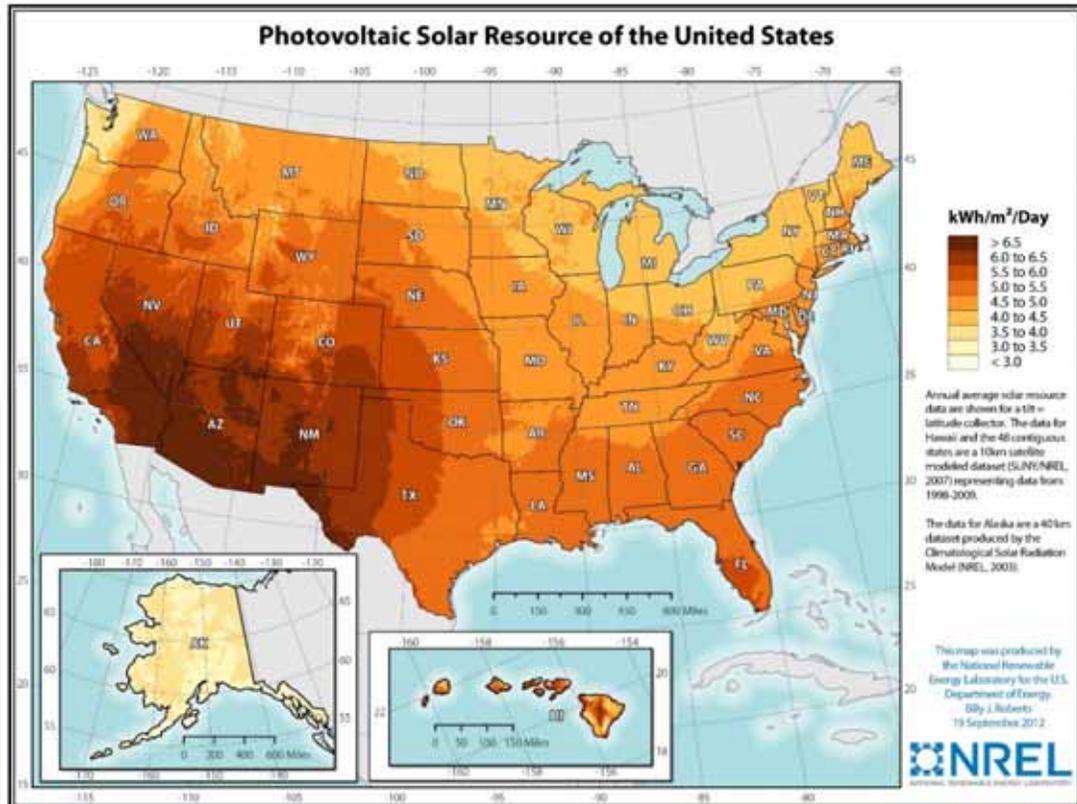

Arizona Solar Power Map

The Global Horizontal Resource of Arizona map provides monthly average and annual average daily total solar resource averaged over surface cells of 0.038 degrees in both latitude and longitude, or nominally 4 km in size. The inputs are based on the PATMOS-X model that uses half-hourly radiance images in visible and infrared channels from the GOES series of geostationary weather satellites.


Map 3 - Global Horizontal Solar Resource of Arizona

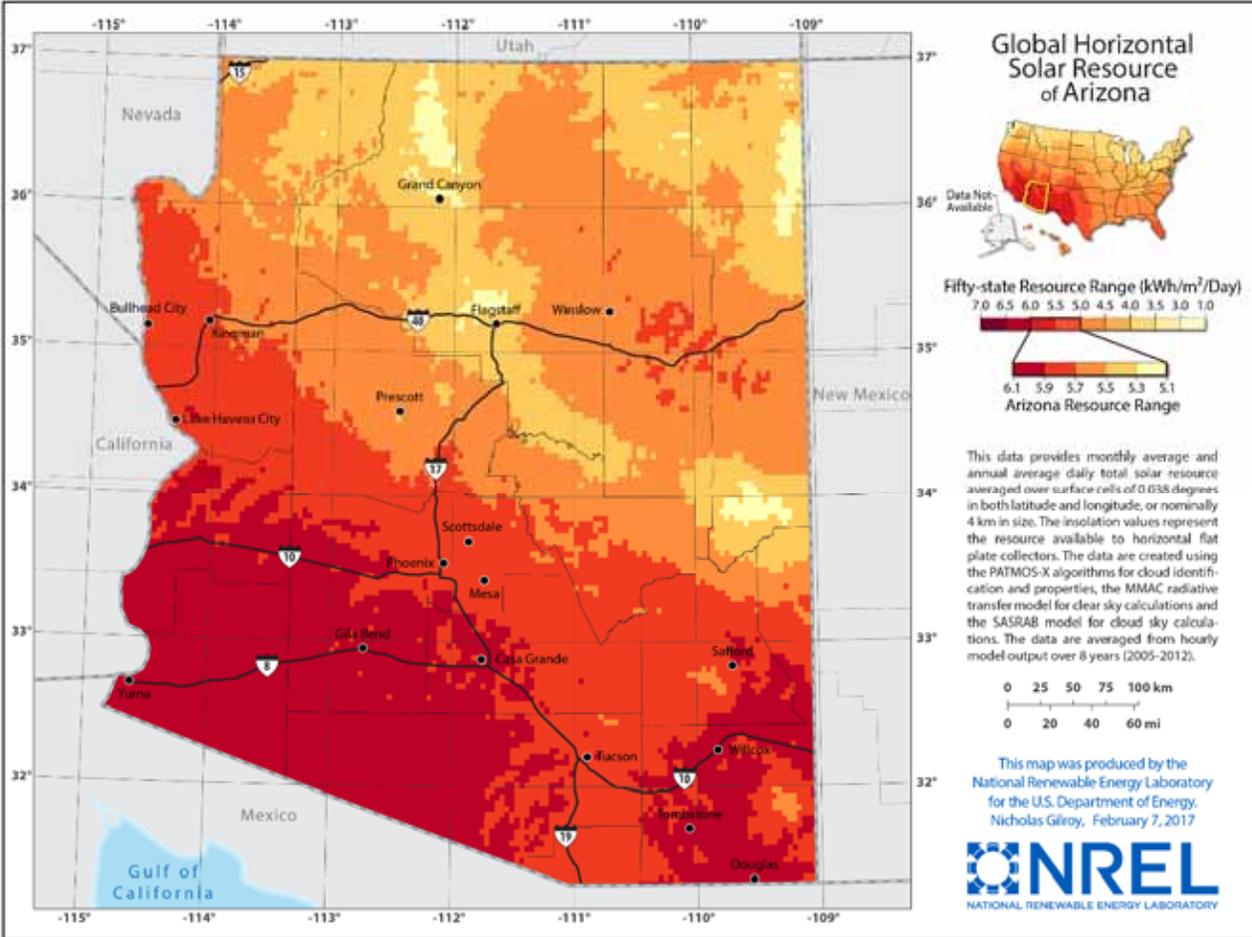

New Mexico Solar Power Map

The New Mexico NREL Solar Insolation Map is based on estimates monthly daily total radiation, averaged from hourly estimates of direct normal irradiance over eight years. The inputs are based on hourly visible irradiance from the GOES geostationary satellites, and month average aerosol optical depth, precipitable water vapor, and ozone sampled at a 10km resolution.

Map 4 - New Mexico NREL Solar Insolation Map

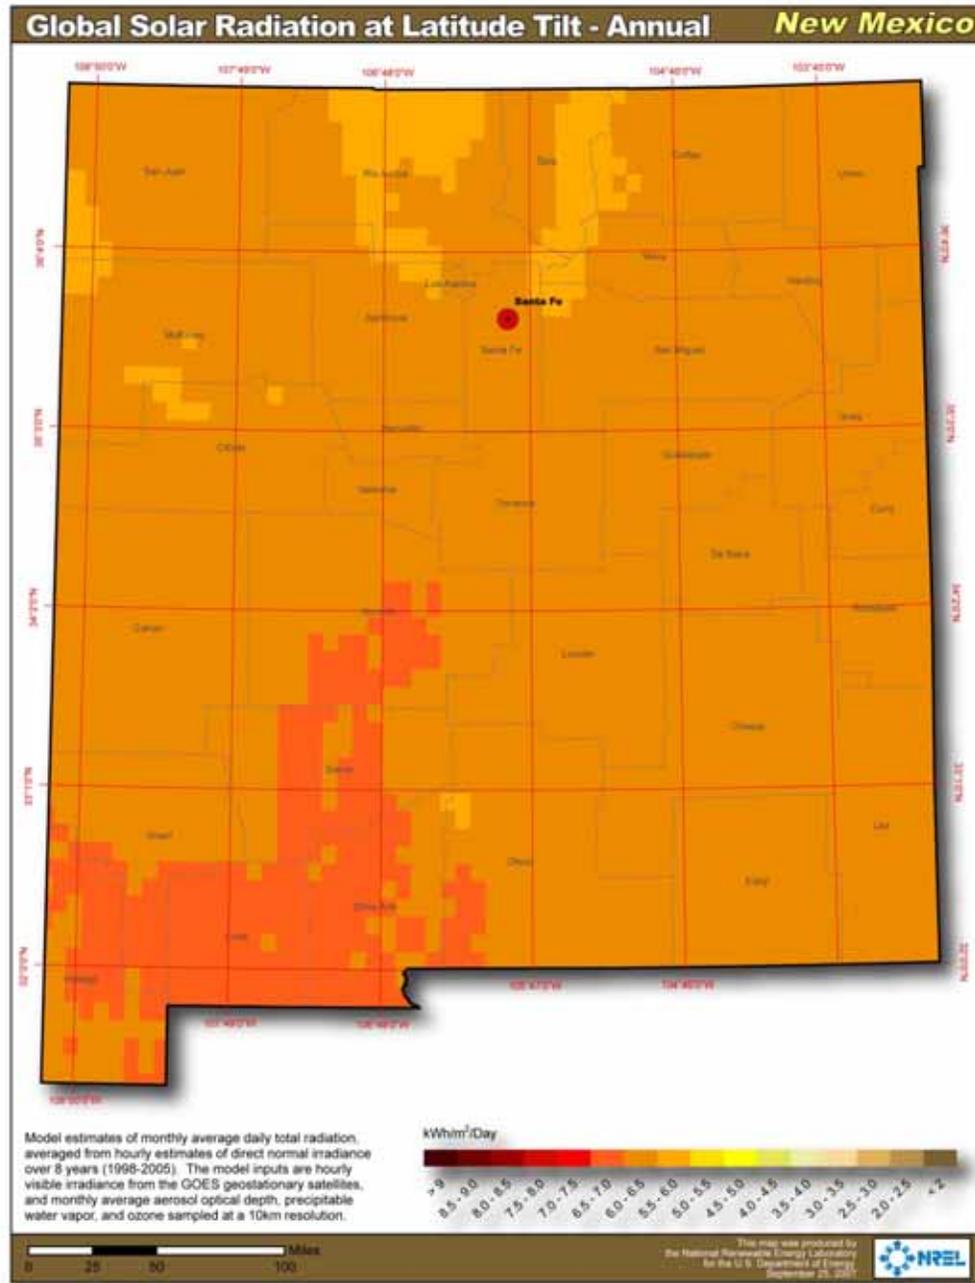

Concentrating Photovoltaics (CPV)

Concentrating photovoltaic systems use lenses or mirrors to concentrate sunlight onto high-efficiency solar cells. These solar cells are more expensive than conventional cells used for flat-plate PV systems. However, the increased cell efficiency requires less cell area to produce a given amount of power.

CPV technology offers the following advantages:

- Potential for solar cell efficiencies greater than 40%
- No moving parts
- No intervening heat transfer surface
- Near-ambient temperature operation
- No thermal mass; fast response
- Reduction in costs of cells relative to optics
- Scalable to a range of sizes

Because of their relatively high cost, CPV systems require the use of concentrated sunlight to be cost-competitive with other solar power options. Thus, groups such as NREL have focused on the development of multi-cell packages (dense arrays) to improve overall performance, improve cooling, and install reliable prototype systems.

CPV systems are not included in TEP's long-term resource plan at this time due to their high costs, as they are typically two to three times higher than more traditional solar and wind resources on a levelized cost basis. Also, market prices and cost data are difficult to obtain because the CPV market is young and there are a relatively low number of installations and companies in the field. Recently, the CPV industry has struggled to compete with PV prices, leading CPV companies exiting the market, while others face challenges in raising the capital required to scale.²⁴

CPV Technology Summary

Technology and Fuel	Concentrating Photovoltaics (CPV)
Characteristics	Uses mirrors or lenses on a single-axis or dual-axis tracking system to concentrate sunlight onto high-efficiency PV cells.
Benefits	Performs best in high-sunlight regions. Efficiency is not affected by high ambient temperatures. Trackers allow for high levels of power production through the day. Less land and land disturbance required relative to conventional PV systems.
Risks	Costs are two to three times higher than more conventional solar technologies. CPV market is still young and not well developed.
Construction Lead Time	1 year

²⁴ Phillips, Simon et al. Current Status of Concentrator Photovoltaic (CPV) Technology, Version 1.2, February 2016.

Concentrating Solar Power Technology (CSP)

Concentrating Solar Power is another type of solar power generation, and is considered an ideal technology for warm climates that are prevalent in Arizona. Concentrating solar power uses mirrors to reflect and concentrate sunlight onto receivers that collect the solar energy and convert it into thermal energy. This thermal energy can then be used to produce electricity via a steam turbine or heat engine driving a generator. In virtually all applications, CSP is large in scale, on the order of 100 MW or larger. These large systems are similar in many respects to traditional coal, natural gas, or nuclear generator systems and utilize synchronous generators to produce electricity. While the CSP systems generally do not operate 24/7 because of the diurnal nature of the sun, they do provide grid support when they are operational because of the synchronous generation. This important feature of grid support is an important technical factor when comparing CSP to PV generation systems that utilize inverters, which do not currently provide inertia to the grid.

There are three generic CSP system architectures: line-focus (trough systems), point-focus central receiver (power towers), and point-focus distributed receiver (dish-engine systems).

Power Tower CSP Systems

Power tower systems consist of a field of large, nearly flat mirror assemblies, known as heliostats, which track the sun and focus the light onto a receiver at the top of a tower. In a typical configuration, a heat-transfer fluid, such as water, water and glycol mixtures, or molten nitrate salts is pumped through the receiver, and used to generate steam to power a conventional steam-turbine power cycle generating electricity. In some systems, excess thermal energy can be stored during daylight hours to provide electricity at times when the sun is not available and at night. An advantage of power tower systems over linear concentrator systems is that higher temperatures can be achieved in the working fluid, leading to higher efficiencies and lower-cost electricity. Sunlight can be utilized from a large area, and concentrated on a small area on the tower, and that approach reduces the distance that heat capturing fluids must travel to generate power and energy.

CSP Technology Summary

Technology and Fuel	Concentrating Solar Power Technology (CSP)
Characteristics	Mirrors concentrate sunlight onto a fluid that can generate steam for electric generators.
Benefits	Electric generators can be synchronized to the grid, thereby providing inertia. For some CSP technologies, thermal storage can be used to address intermittency issues and provide power after sunset.
Risks	Costs are two to three times higher than more conventional solar technologies.
Construction Lead Time	4 to 5 years

Ivanpah Solar Electric Generating Station


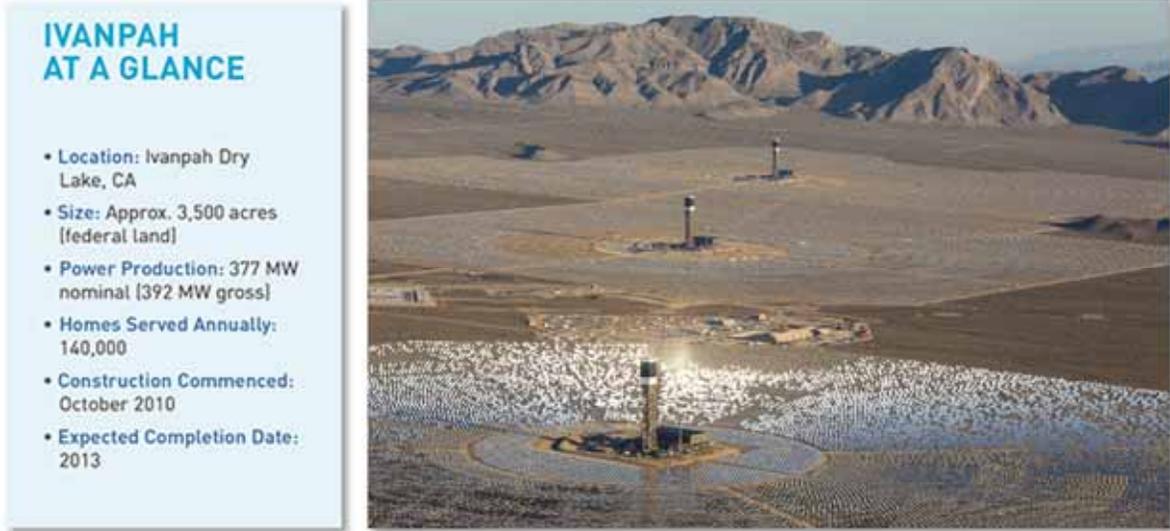


Figure 19 - Figure 8 - Ivanpah Solar Electric Generating Station (392 MW)



The Ivanpah Solar Electric Generating Station is located in Ivanpah Dry Lake, Calif., approximately 40 miles southwest of Las Vegas. BrightSource began development in 2006, and construction commenced in October 2010, led by engineering, procurement, and construction partner Bechtel. The station was first connected to the grid in September 2013 and went into commercial operation in late 2013. The station is comprised of three separate units and has long-term PPAs in place with Pacific Gas & Electric (Units 1 and 3) and Southern California Edison (Unit 2). Image

The Ivanpah Solar Electric Generating System is comprised of three separate units with a total capacity of 392 MW. Ivanpah is a joint effort between NRG Energy, Google, Bechtel, and BrightSource Energy. The station uses over 300,000 software-controlled heliostats that concentrate sunlight onto three 459-foot towers. Four types of heliostats are used depending on the distance from the tower; the furthest out are more than half a mile away. The heliostats are capable of withstanding 85-mph winds.

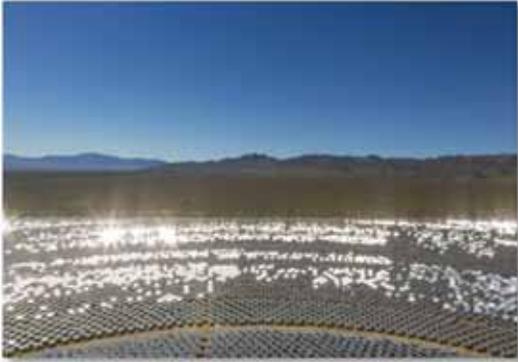

Ivanpah Computer Controlled Heliostats



Ivanpah Solar Receiver and Condensers

Each tower supports a 2,100-ton boiler that directs steam into a turbine generator at ground level. Natural gas is used to warm the boiler up from a cold start, but in normal use, it retains enough heat from the previous day to start up on sunlight alone. A 110-ton counterweight is continually repositioned to keep the tower stable. The concentrated sunlight generates steam in the tower-top boilers. The facility relies on air-cooled condensers to condense the turbine exhaust, reducing water consumption by as much as 95% less than a wet-cooled thermal plant. The plant’s only water requirements are boiler makeup water and for cleaning, and the water is obtained from two wells on the site.



One of Three 130 MW Solar Power




Close up of Solar Receiver

Ivanpah's \$2.2 billion cost was supported by \$1.6 billion in loan guarantees from the DOE's Loan Programs Office²⁵ (LPO). The plant is just a portion of the 2.8 GW of LPO-financed large-scale solar (CSP and PV) that is currently operating or under construction. The LPO currently oversees a portfolio of more than \$30 billion in loans, loan guarantees, and commitments that support more than 30 closed and committed projects. LPO-supported facilities include one of the world's largest wind farms as well as several of the world's largest solar generation and thermal energy storage systems.

Stirling Engine Dish Technology

The solar Stirling Engine is well beyond the research and development phase, with more than 20 years of recorded operating history. The Stirling technology is based on an electrical solar dish system, which consists of a unique radial solar concentrator dish structure that supports an array of curved glass mirror facets, designed to automatically track the sun, collect and concentrate solar energy onto a Power Conversion Unit (PCU). The PCU is coupled with, and powered by, a SES Stirling engine that generates grid-quality electricity.

Figure 20 - Stirling Engine Dish

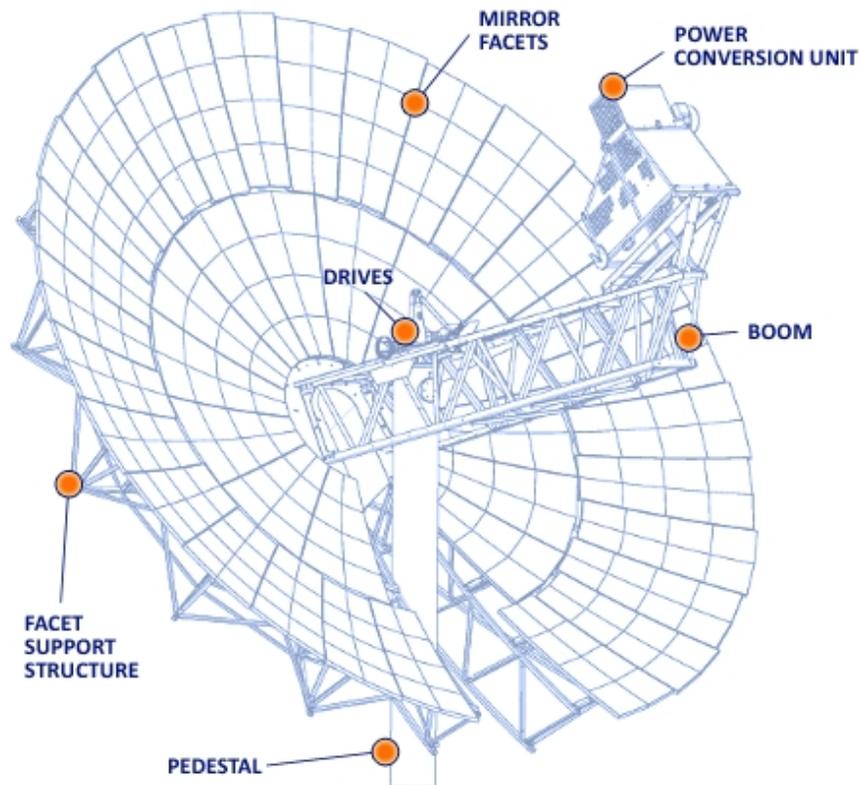

²⁵ <https://energy.gov/sites/prod/files/2014/11/f19/DOE-LPO-Financial%20Performance%20November%202014.pdf>

The conversion process in the PCU involves a closed-cycle, high-efficiency four-cylinder, reciprocating Solar Stirling Engine utilizing an internal working fluid that is recycled through the engine. The Solar Stirling Engine operates with heat input from the sun that is focused by the dish assembly mirrors onto the PCU's solar receiver tubes that contain hydrogen gas. The PCU solar receiver is an external heat exchanger that absorbs the incoming solar thermal energy. This heats and pressurizes the gas in the heat exchanger tubing, and this gas in turn powers the solar Stirling Engine.

Figure 21 - Solar Parabolic Dish-Engine System - 25 kW (NREL)



A generator is connected to the solar Stirling Engine, and waste heat from the engine is transferred to the ambient air via a radiator system. The gas is cooled by a radiator system and is continually recycled within the engine during the power cycle. The conversion process does not consume water, as is required by most thermal-powered generating systems.

Parabolic Trough Power Plants (PTPP)²⁶

A PTPP system is typically oriented in a north-south direction and tracks the sun from east to west focusing solar energy on a long tubular receiver. The working fluid in a trough system is usually a synthetic oil that is heated to approximately 390°C (734°F). The hot oil is used to generate steam for use in a conventional Rankine cycle steam turbine system. The predominant CSP systems in operation in the United States are linear concentrators using parabolic trough collectors. In addition, trough systems can be hybridized (natural gas co-firing) or may use thermal storage in order to dispatch power when most valuable to electric utilities, which is usually during peak load times during the late afternoons.


²⁶ For more information, see <https://www.mtholyoke.edu/~wang30y/csp/PTPP.html>

Figure 22 - Harper Lake Solar CSP Project (NREL)



Figure 23 - Schematic of a Parabolic Trough Power Plant (PTPP) with thermal storage.

(Mount Holyoke College)

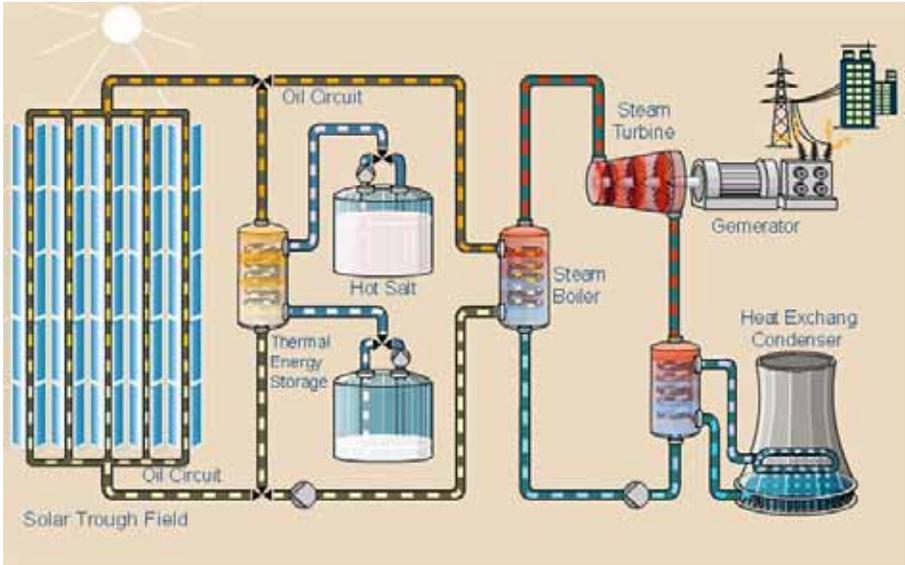


Source: <https://www.mtholyoke.edu/~wang30y/csp/PTPP.html>

Parabolic Trough Power Plant Technology

As shown in the PTPP example below, the solar trough field heats synthetic transfer oil that is used to generate superheated, high-pressure steam that is delivered to a steam turbine. This turbine powers an electrical generator, creating electricity that can be delivered to the bulk power system for utility use.

Figure 24 - Solar PTPP Schematic

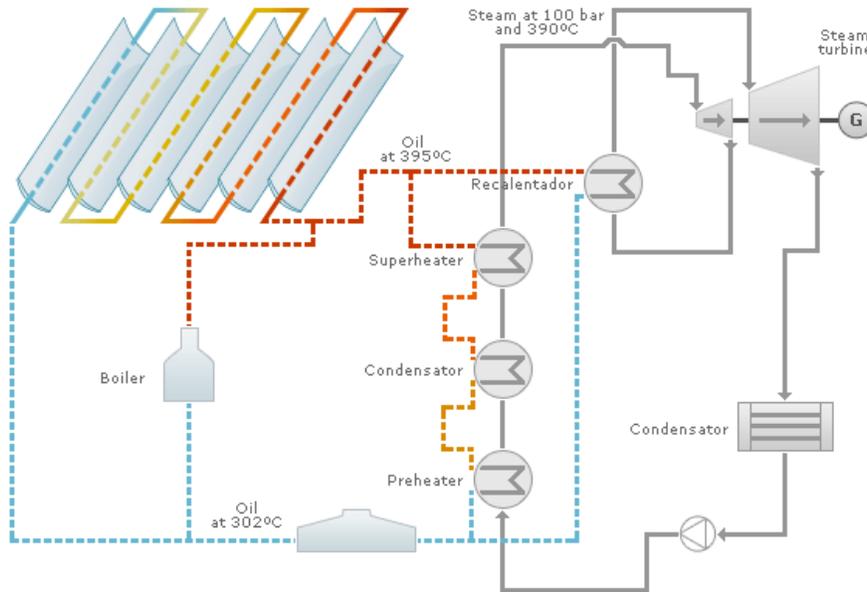

Mojave PTPP Project

The Mojave Solar Project consists of two 125 MW parabolic trough power plants for a total of 250 MW. The Mojave Solar technology uses mirrors to concentrate the thermal energy of the sun to drive a conventional steam turbine. The plant is located about 20 miles from Barstow, California, and was completed in December of 2014 by Abengoa. Abengoa secured a \$1.2 billion loan guarantee from the US DOE. Pacific Gas & Electric has agreed to purchase the power generated from the solar thermal facility as part of a 25 year PPA with Abengoa Solar.


Figure 25 - Mohave Solar Collectors



Hybridized Configuration with Natural Gas Co-Firing

ISCC technology combines the benefits of solar energy with the benefits of a combined cycle. The operation of a solar combined hybrid plant is similar to a conventional combined cycle plant. The fuel (preferably natural gas) is burned generally on a combustion chamber of a gas turbine. The heat coming from the solar field is added to escape gases that are directed to the heat retriever, resulting in increased steam generation and, consequently, an increase of electricity production from the steam turbine.


Figure 26 - Solar CSP Hybrid with Natural Gas Co-Firing

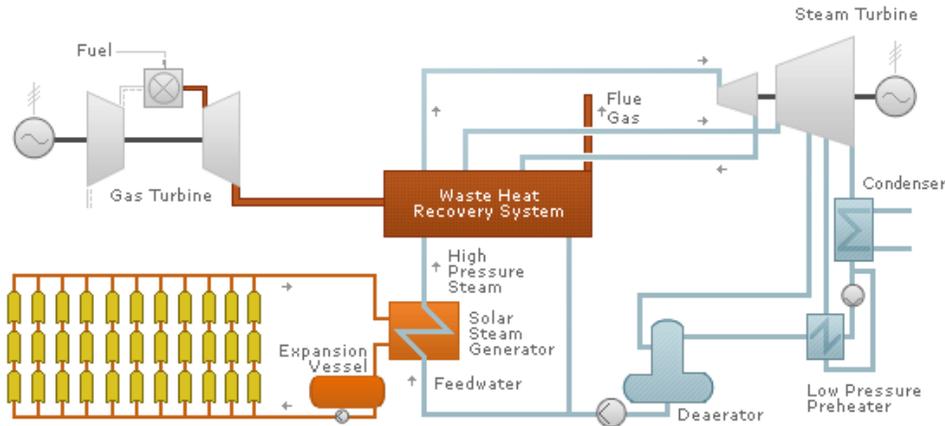

Storage Configuration based on Two-Tank Molten Salt System

Concentrating solar power technologies are being enhanced with the addition of energy storage systems. With the use of a thermal energy storage system, solar plants are able to produce energy output during non-daylight hours. One of the materials being used to store the sun's thermal capacitance is molten-nitrate salt. In this design configuration, large insulated tanks filled with molten salt are used with PTPP technology to store the heat from the synthetic transfer oil. This stored heat is used to improve the dispatchability of the solar resource by providing power after the sun goes down. Systems employing this storage technology may benefit from the stored heat and produce power for 6-8 hours after sundown.

Figure 27 - Solar CSP with Thermal Storage

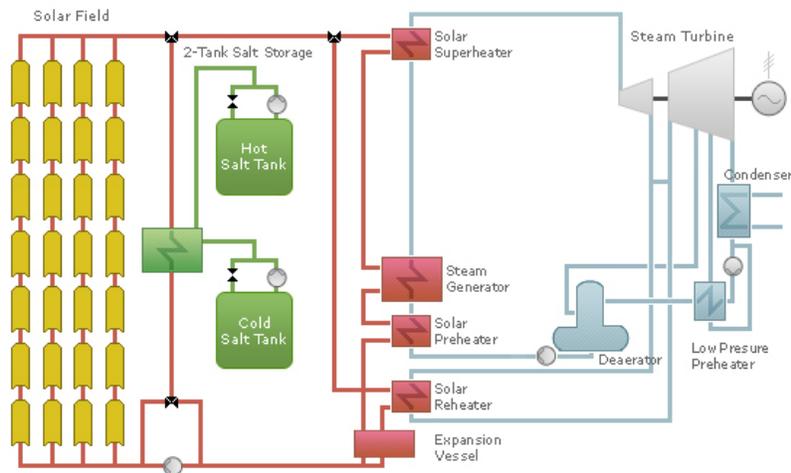

Solana Generating Station

Solana solar thermal plant, a PTPP concentrating solar power CSP plant and the first in the U.S. with thermal energy storage began commercial operations in October 2013.²⁷

The 280-MW plant, near Gila Bend in Arizona, employs molten salt to store about six hours of thermal energy at full power, allowing the facility to continue operating during periods of peak evening demand. The addition of thermal storage also allows the facility to smooth out any intermittency in generation as a result of cloudy periods during the day, which allows the plant to operate more like a traditional thermal generating system.

The three-square mile facility employs 2,700 parabolic trough mirrors and a pair of 140-MW steam turbines. Heated oil from the mirrors is used to heat molten salt in six pairs of hot and cold tanks with a capacity of 125,000 metric tons.

Solana sells all its power to Arizona Public Service, the state's largest utility, through a 30-year PPA. The facility cost approximately \$2 billion to build, and was financed in part with a \$1.45 billion loan guarantee from the Department of Energy.

²⁷ For more information see https://www.nrel.gov/csp/solarpaces/project_detail.cfm/projectID=23



Aerial View of Solana Solar Field



Parabolic Trough Collector



Thermal Energy Storage Tanks



Solana's Power Blocks

Wind Power

Resource Characteristics

Wind power is the process of mechanically harnessing kinetic energy from the wind and converting it into electricity. The most common form of utility-scale wind technology uses a horizontal-axis rotor with turbine blades to turn an electric generator mounted at the top of a tall tower. For utility-scale wind power production, dozens of wind turbines may be grouped together at a wind farm project. Power generated by the wind turbines is collected at a substation where transformers increase the voltage and the power is then fed into the transmission system.

Because air has low mass, the wind itself has low energy density. The amount of wind power that can be produced at a given project site is dependent on the strength and frequency of wind. Wind velocity determines quantity of power that can be produced. For example, a doubling of wind speed allows roughly eight times as much power to be produced.

Over the last twenty years, the use of wind power has increased rapidly, making it the predominant form of new renewable generation resource, with many large-scale installations around the world. Major advances in wind power technology were achieved in the 1990s and 2000s, allowing much larger turbines to be developed. For example, wind turbines with a capacity of 1.5 megawatts to 5 megawatts are now common and wind turbines larger than 8 megawatts are being developed. This has created economies of scale, driving down the unit cost of energy from wind power resources.

Figure 28 - Kingman Wind Farm (10 MW Project)




UNS Electric Wind Project

A small wind farm outside of Kingman, Arizona developed by Western Wind Energy Corporation.

U.S. Wind Resource Map


Map 5 - U.S. Wind Resource Map

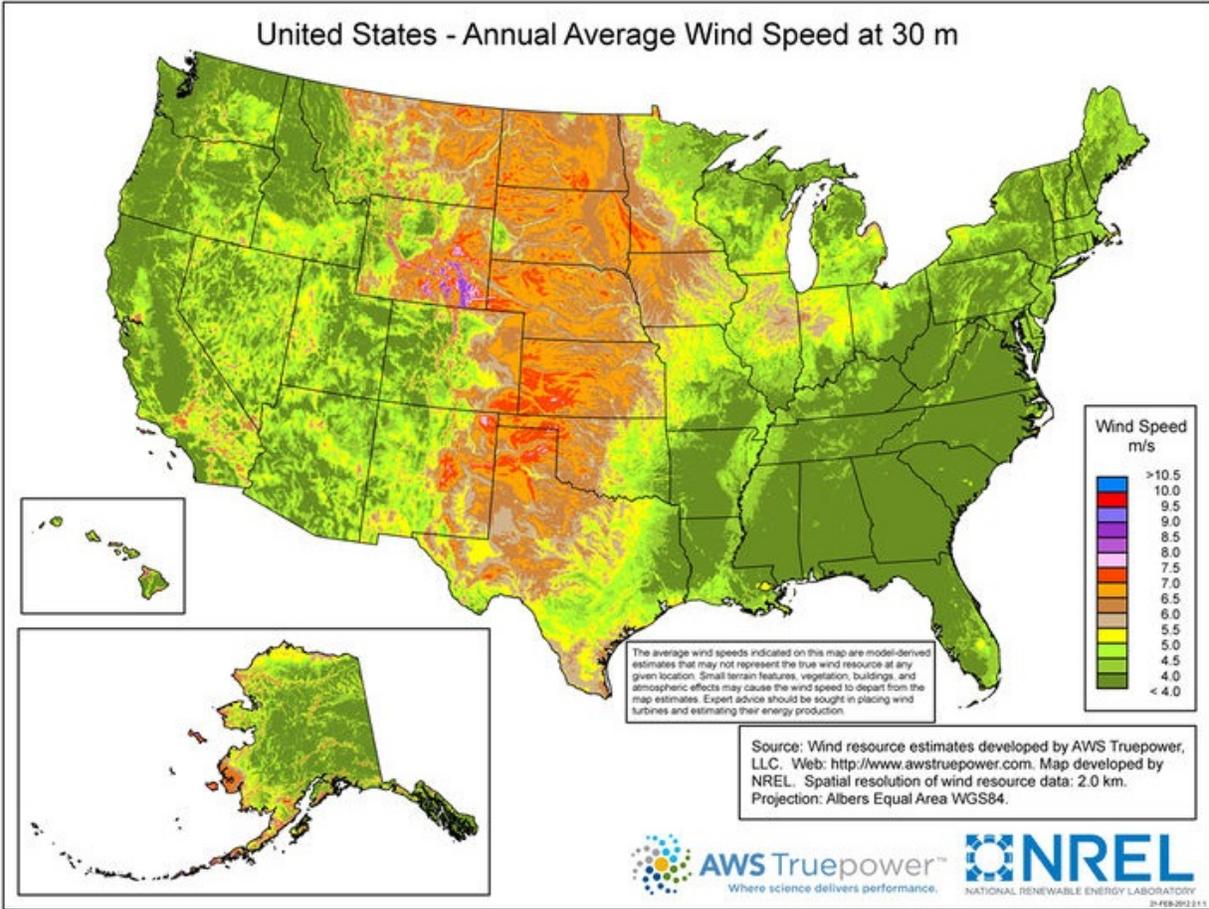

Arizona Wind Resource Map

The U.S. Department of Energy's Wind Program and the NREL published an 80-meter (m) height wind resource map for Arizona²⁸. The Arizona Wind Resource Map shows the predicted mean annual wind speeds at an 80-m height. Areas with annual average wind speeds around 6.5 meters per second and greater at 80-m height are generally considered to have a resource suitable for wind development. Utility-scale, land-based wind turbines are typically installed between 80m and 100m high. NREL publishes wind resource maps at elevations of 30m, 50m, 80m, 90m (offshore), and 100m.

Map 6 - Arizona NREL Wind Resource Map

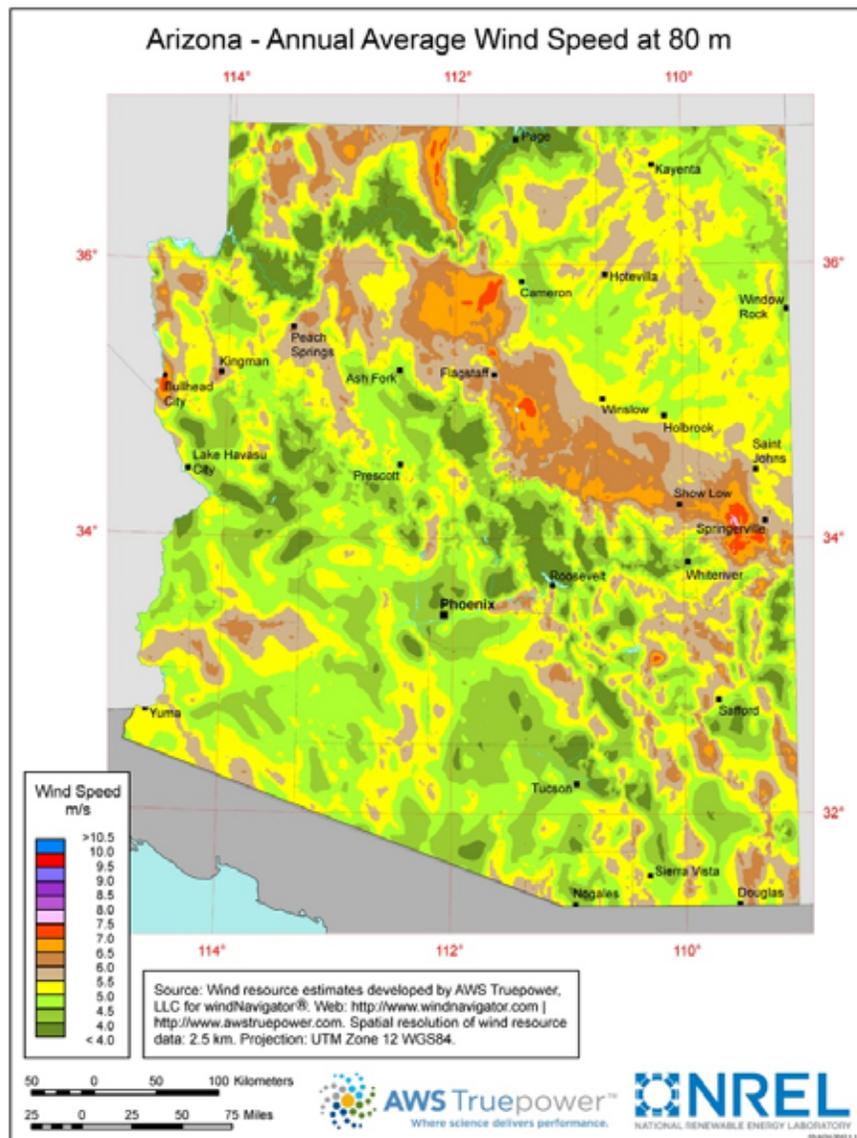


²⁸ <http://www.nrel.gov/gis/wind.html>

Arizona Wind Resource Potential

It is estimated that Arizona’s wind resource capacity potential is approximately 10,900 MW based on an annual capacity factor of 30%. On an annual basis this results in 30,600 GWh of potential annual wind generation for the state.


Chart 32 - Arizona NREL Wind Resource Potential

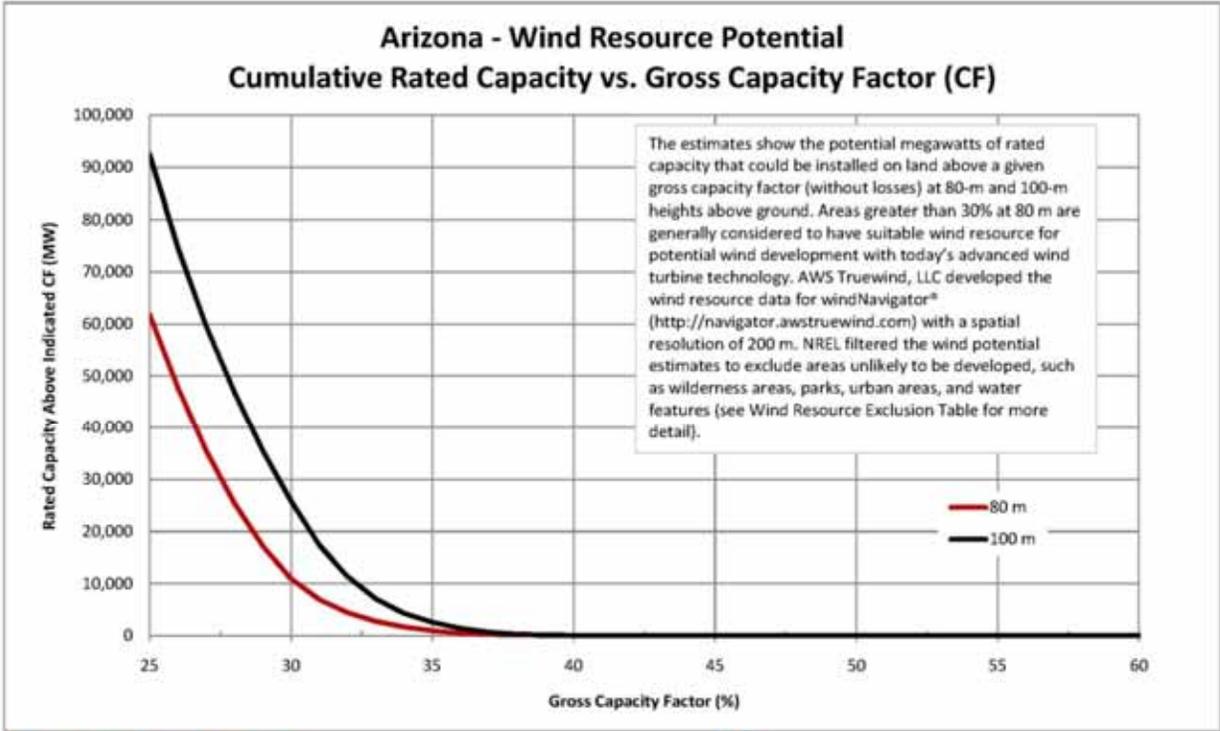

New Mexico Wind Resource Map

The U.S. Department of Energy's Wind Program and the NREL published an 80-m height wind resource map for New Mexico. The New Mexico Wind Resource Map shows the predicted mean annual wind speeds at an 80-m height. Areas with annual average wind speeds around 6.5 meters per second and greater at 80-m height are generally considered to have a resource suitable for wind development. Utility-scale, land-based wind turbines are typically installed between 80 and 100 m high. As mentioned above, NREL publishes wind resource maps at elevations of 30m, 50m, 80m, 90m (offshore), and 100m.


Map 7 - New Mexico NREL Wind Power Map - 80m

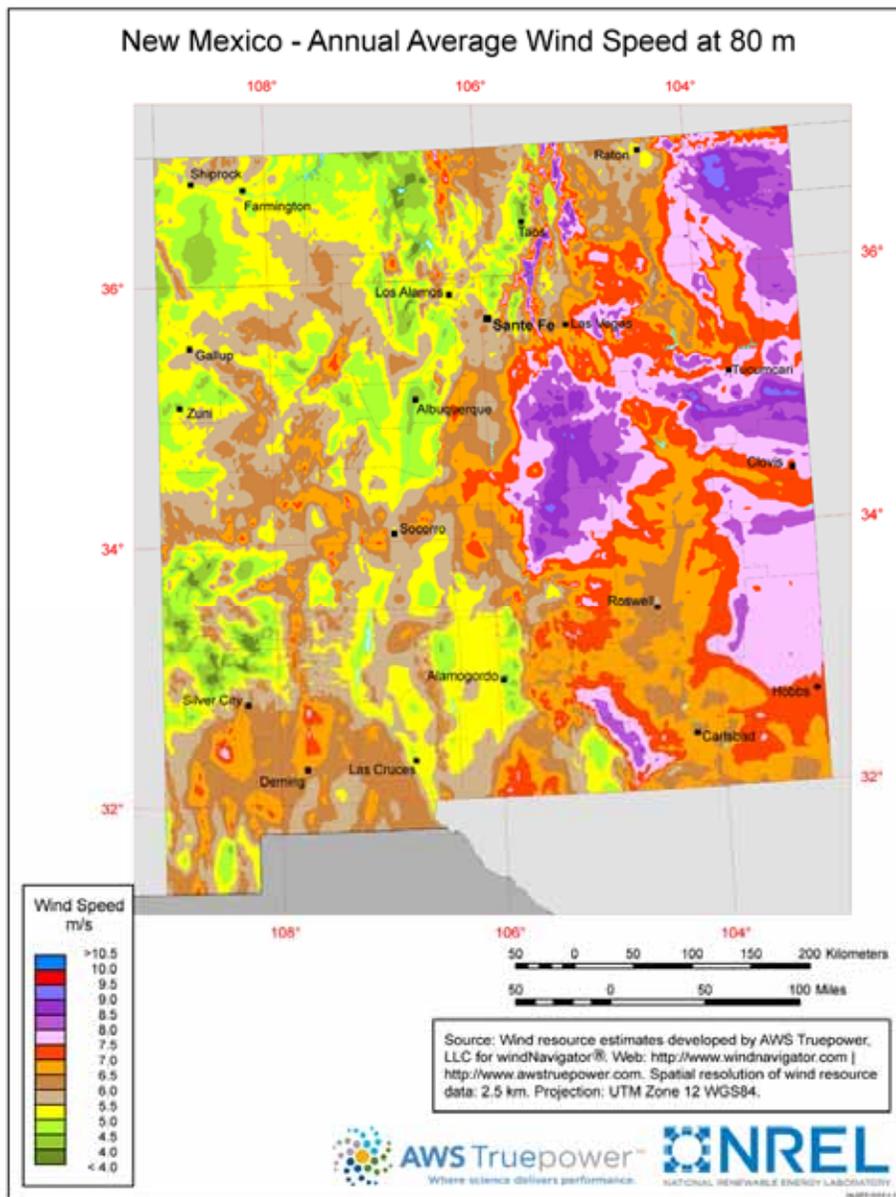

New Mexico Wind Resource Potential

It is estimated that New Mexico’s wind resource capacity potential is approximately 492,000 MW based on an annual capacity factor of 30%. On an annual basis this results in 1,645,000 GWh of potential annual wind generation for the state.

Chart 33 – New Mexico Wind Resource Potential

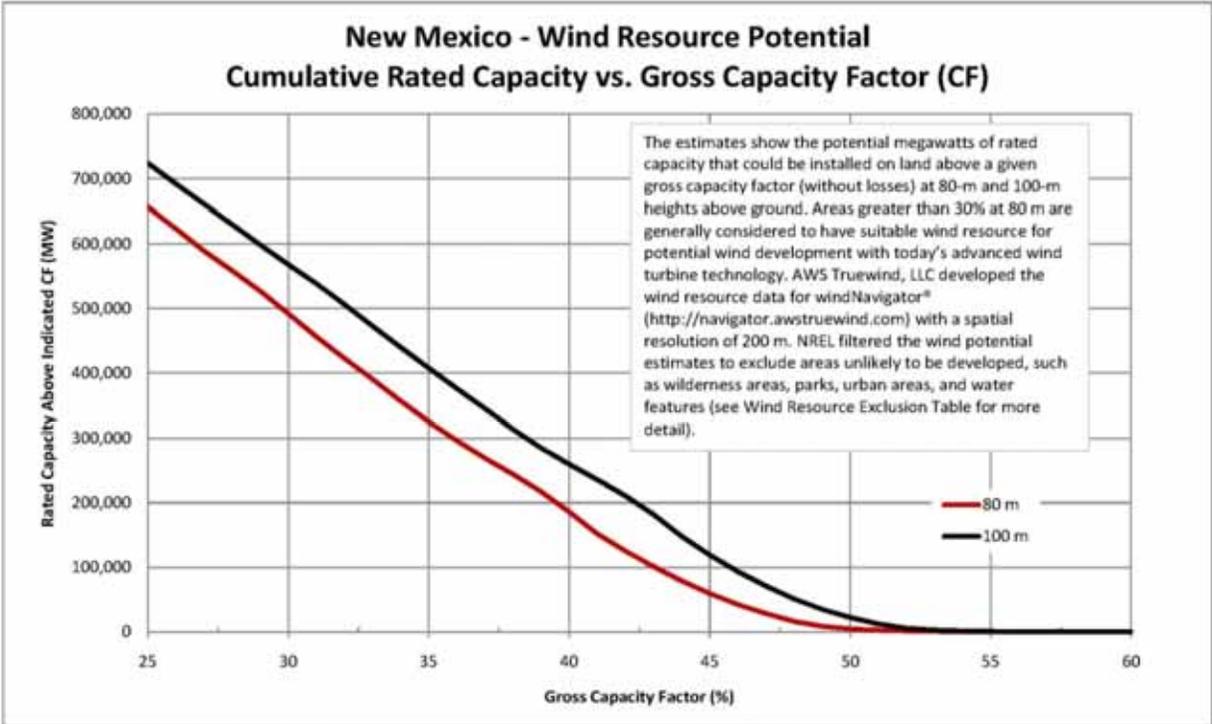

Wind Resource Technology

As the wind starts to blow, yaw motors turn a turbine's nacelle so that the rotor and blades face directly into wind. The blades are shaped with an airfoil cross section (similar to an aircraft wing) and this causes air to move more quickly over one side than the other. This difference in speed causes a difference in pressure, which in turn causes the blade to move, the rotor to turn, and a rotational force (or torque) to be generated.

The rotor is connected to a gearbox (on most turbines) and in turn to a generator housed in the nacelle that converts the torque into electricity. The electricity is then fed into a transformer located either inside or just outside the turbine which steps up the voltage to reduce losses in the transmission of electricity. From there the electricity travels through underground cables to an electricity sub-station, usually on or near the wind farm site, where the voltage is stepped up with power transformers and exported to the local grid.

There are four types of utility-scale wind turbines now in use, with the majority of new installations being types III and IV due to their use of power electronics to control behavior and generate at a much wider window of wind speeds.

Type I: Squirrel cage induction generator


Type II: Wound-rotor induction generator with adjustable external rotor resistance

Type III: Doubly-fed induction generator

Type IV: Induction generator with full converter interface

Typically turbines begin to generate electricity at wind speeds of 3-4 m/s (7-9 mph). The amount of torque (and thus electricity) generated increases with wind speed up to around 15 m/s (34 mph) where the maximum (or rated) capacity of the turbine is reached. Output is then maintained at this level until a turbine is shut down when the wind reaches high speeds of around 25m/s (57 mph) to protect it from excessive loads - though the turbines are in fact designed and certified to withstand wind speeds up to 70 m/s (157 mph).

Figure 29- 3D Drawing of Nordex N80/2500kW Wind Turbine

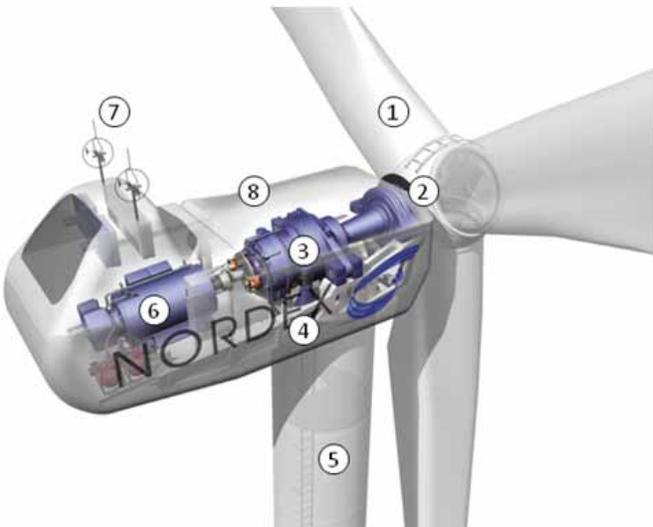

- HOW A WIND TURBINE WORKS**
1. Rotor assembly of three blades mounted on a hub that is connected via the main shaft to the gearbox.
 2. Pitch motors change the angle of attach of the blades so as to control rotational speed and torque.
 3. Gearbox converts the rotational speed of the rotor to a suitable speed for the generator.
 4. Yaw motors continually turn the nacelle so as to ensure the rotor faces into the wind.
 5. Tower supports the nacelle and rotor. The tower contains electrical cables and access ladders.
 6. Generator converts the torque generated by the rotor to electrical energy.

Wind Technology Summary

Technology and Fuel	Wind Power
Characteristics	Kinetic energy of the wind is transformed into mechanical energy through a rotor, and then into electrical energy by a generator housed inside the nacelle of a wind turbine tower.
Benefits	Historically one of the cheapest forms of renewable energy in most of the US. Can provide energy at any time of the day/night.
Risks	Generally more intermittent and less predictable than the output from solar facilities.
Construction Lead Time	1 year.


Bioenergy/Bio-Resources

Biofuels are a set of energy resources that are produced using biological processes, and can be derived directly from plants or indirectly through other processes including agricultural waste.

Some types of biofuel power plants utilize the heat produced from the combustion of biological materials to produce electricity. Biofuel generation, from multiple sources, is a relatively mature, proven technology. In addition, biomass resources, like other forms of renewable energy, can be at or near carbon-neutral. Being carbon-neutral refers to achieving net zero carbon emissions by balancing a measured amount of carbon released with an equivalent amount sequestered or offset.

The National Renewable Energy Laboratory publishes maps that provide data related to the available annual biomass for fuel and other use. Most of this biomass is based on agricultural waste from U.S. farms.


Map 8 – U.S. NREL Biomass Map

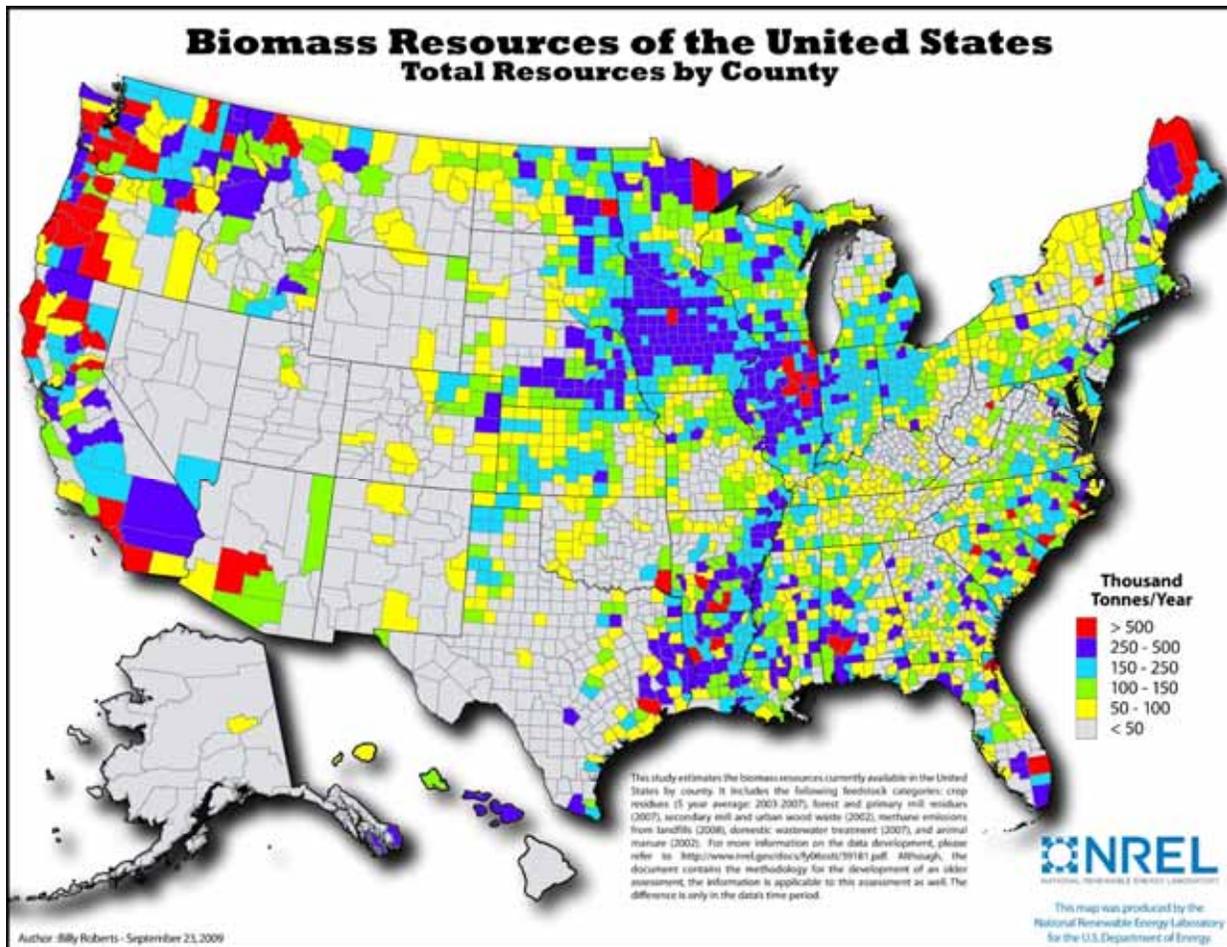

Arizona Biomass Map

The Arizona NREL Biomass Map illustrates the biomass resources available in Arizona by county. Biomass feedstock data are analyzed both statistically and graphically using a Geographic Information System (GIS). The following feedstock categories are evaluated: crop residues, forest residues, primary and secondary mill residues, urban wood waste, and methane emissions from manure management, landfills, and domestic wastewater treatment.


Map 9 – Arizona NREL Biomass Map

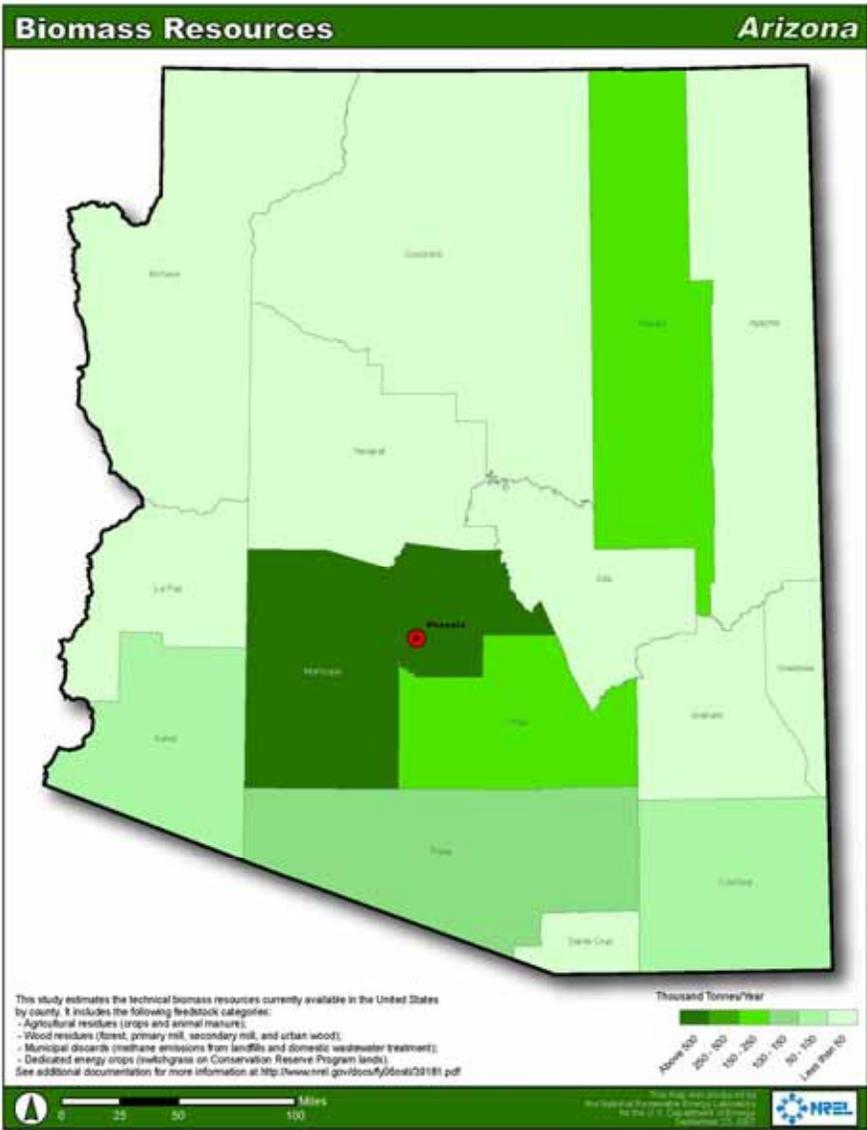

New Mexico Biomass Map

The New Mexico NREL Biomass Map illustrates the biomass resources available by county in New Mexico. Biomass feedstock data are analyzed both statistically and graphically using a GIS. The following feedstock categories are evaluated: crop residues, forest residues, primary and secondary mill residues, urban wood waste, and methane emissions from manure management, landfills, and domestic wastewater treatment. The map shows the available biomass resources, as do the other maps shown in this report for various regions, but does not indicate actual use of those resources.

Map 10 – New Mexico NREL Biomass Map

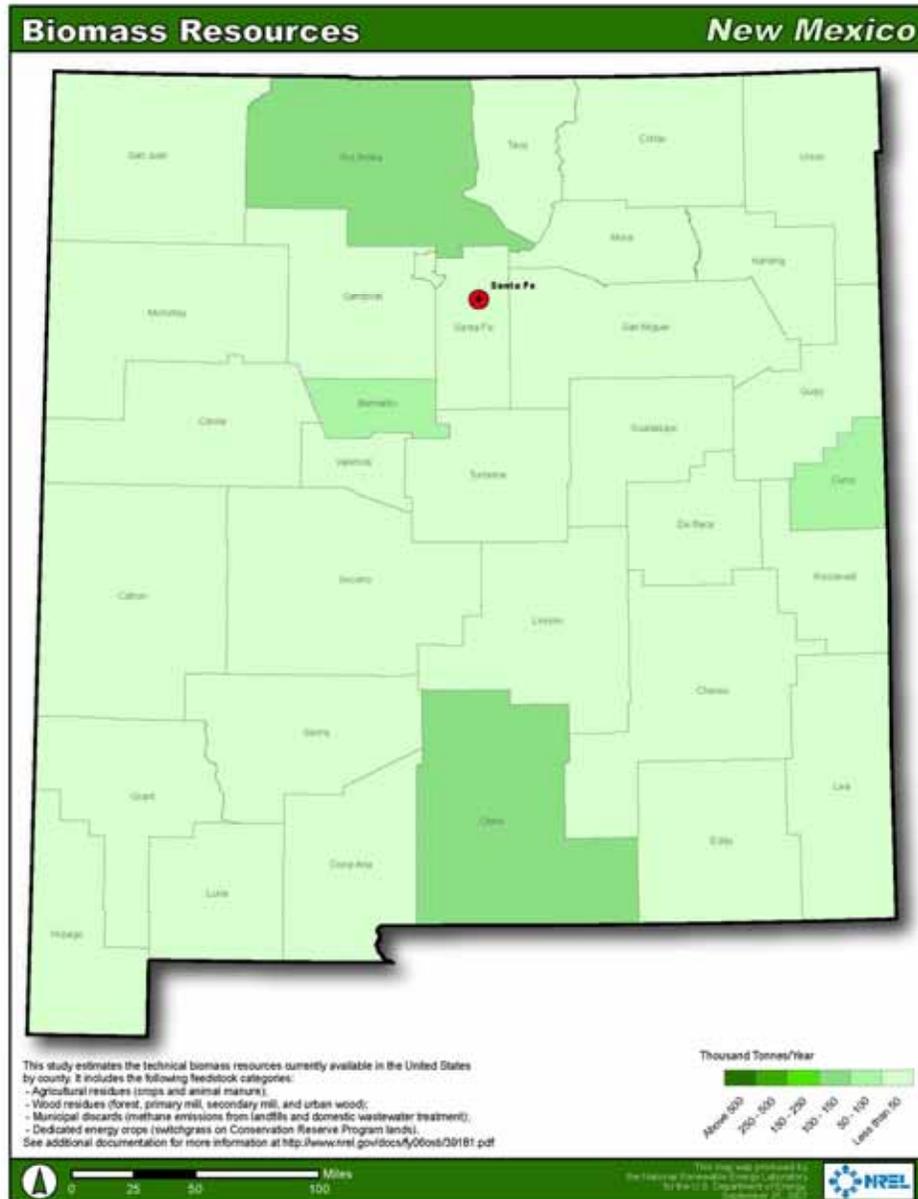

Biomass Technology Overview

Biofuel energy sources can be divided into two broad categories: biomass and biogas.

Biomass: This category includes all solid biological materials. The most common source of biomass fuel is wood. However this category can also include manure, sewage sludge, agricultural waste, and even cultivated biomass agricultural products such as grasses.

Biomass power plants operate in a manner very similar to coal and natural gas power plants. In general, the heat produced from combustion of the biomass is used to produce steam that in turn is used to spin a turbine and produce electricity. In addition to dedicated biomass power plants, there is also the potential for using biomass sources as a co-firing fuel with traditional resources such as coal.

Biogas: This category includes the capture of gasses naturally produced as a part of biological processes. One of the most common biogas is methane, and is often collected from the process of decay at landfills. Another potential source is the methane produced from bacterial digestion of manure.

Biogas resources may be used to produce electricity as part of a dedicated plant in the same manner as a traditional natural gas plant, and biogases are sometimes used to supplement other fuel sources.

Transmission and Siting Requirements

Biofuel resources may or may not require significant electric transmission upgrades depending on the location of the source of fuel. For instance, plants utilizing wood waste or gas produced as a part of sewage treatment would likely be located near load centers and require minimal additional transition resources. On the other hand, a plant utilizing agricultural or forest thinning waste would likely be located a significant distance from load centers and may require electric transmission upgrades.

Dispatch Characteristics

One of the potential advantages for the adoption and use of biomass power plants is that it can be used as a dispatchable, reliable, base load resource (in contrast to many other renewables). Direct-fired biomass power plants often operate at capacity factors of 85% and above, similar to coal and natural gas powered plants.

Environmental Attributes

The principal environmental advantage for using biofuels is that biofuels are considered carbon-neutral. While the process of burning biofuels does release CO₂, a nearly equal amount of CO₂ is absorbed from the atmosphere as the biological source of the fuel grows. While the burning of biofuels is carbon-neutral, it does entail significant emissions of NO_x and PM, requiring the use of scrubbing technology at the power plant. In addition to some unfavorable emissions, the use of biomass also risks other negative environmental impacts if the fuel is not collected in a sustainable manner. In general, however, biofuels are harvested from waste sources, and sustainability is generally an insignificant issue.

Biomass Technology Summary

Technology and Fuel	Biomass
Characteristics	Electricity generated through the combustion of biologic material or biologic material byproducts (i.e., biogas).
Benefits	Similar in concept to traditional thermal-based power plants. Carbon emissions can be partially or fully offset through CO2 sequestration by the replacement feedstock.
Risks	Currently about twice the cost of other renewable energy sources.
Construction Lead Time	5 years.

Natural Gas Resources

Advances in natural gas exploration and development, such as directional drilling and hydraulic fracturing, have dramatically increased the amount of proven reserves in the US and consequently brought prices down to about one-fourth of their peak in 2008. This, plus the increasing costs of controlling emissions from coal-fired power plants, has led to an increase in electricity generation from natural gas-fired power plants, which now exceeds generation from coal-fired power plants nationally.

There are a number of ways natural gas can be used to generate electricity. As with other fossil fuels, it can be burned in boilers to generate steam. A more efficient process, and the one used predominantly to generate electricity from natural gas, is the combined cycle process, which is described below. Finally, natural gas can be used in simple cycle combustion turbines to produce electricity. This technology is not as efficient as combined cycle but has operational advantages over steam and combined cycle technologies, such as cycling on and off more frequently (and at less cost) and changing its output more rapidly to follow rapid load changes or to compensate for rapid power changes from solar and wind resources. Combustion turbines thus have the most value when used as grid balancing resources and are discussed further in Chapter 7.

Natural gas combined cycle technology is the most efficient and cost-effective way of generating electricity from natural gas. The basic principle of NGCC is to produce power in a gas turbine which can be converted to electric power by a coupled generator, and to use the hot exhaust gases from the gas turbine to produce steam in a heat recovery steam generator (HRSG). This steam is then used to drive a turbine and generator to produce more electric power. The use of both gas and steam turbines in a single plant results in higher conversion efficiencies and lower emission. Additionally, natural gas can be fired in the HRSG to produce additional steam and associated output for meeting peak loads – a process commonly referred to as duct firing. The heat rate will increase during duct-fired operation, but this incremental duct-fired heat rate is generally less than the resultant heat rate from a similarly sized simple cycle natural gas power plant.


NGCC Technology Summary

Technology and Fuel	Natural Gas Combined Cycle (NGCC)
Characteristics	Uses natural gas to power one or more combustion turbines whose exhaust is used to generate steam for an additional turbine, resulting in a highly-efficient electricity-generation process.
Benefits	Produces electricity more efficiently and with fewer emissions than other fossil-fired technologies. Capable of changing out put more rapidly and following load more closely than other fossil-fired technologies.
Risks	Over the long term, costs are subject to natural gas prices and greenhouse gas regulations.
Construction Lead Time	3 years.

Coal Resources

As shown on Chart 34, below, the percentage of U. S. electric power generation from coal has been on a decline since 2008. This decline is largely due to reduced costs of competing sources of generation such as natural gas, solar and wind. However, in 2017 and 2018, as natural gas prices are expected to increase, coal is predicted to regain some share of the electricity generation mix, and coal production is expected to increase slightly.

Chart 34 - U.S. Net Electricity Generation

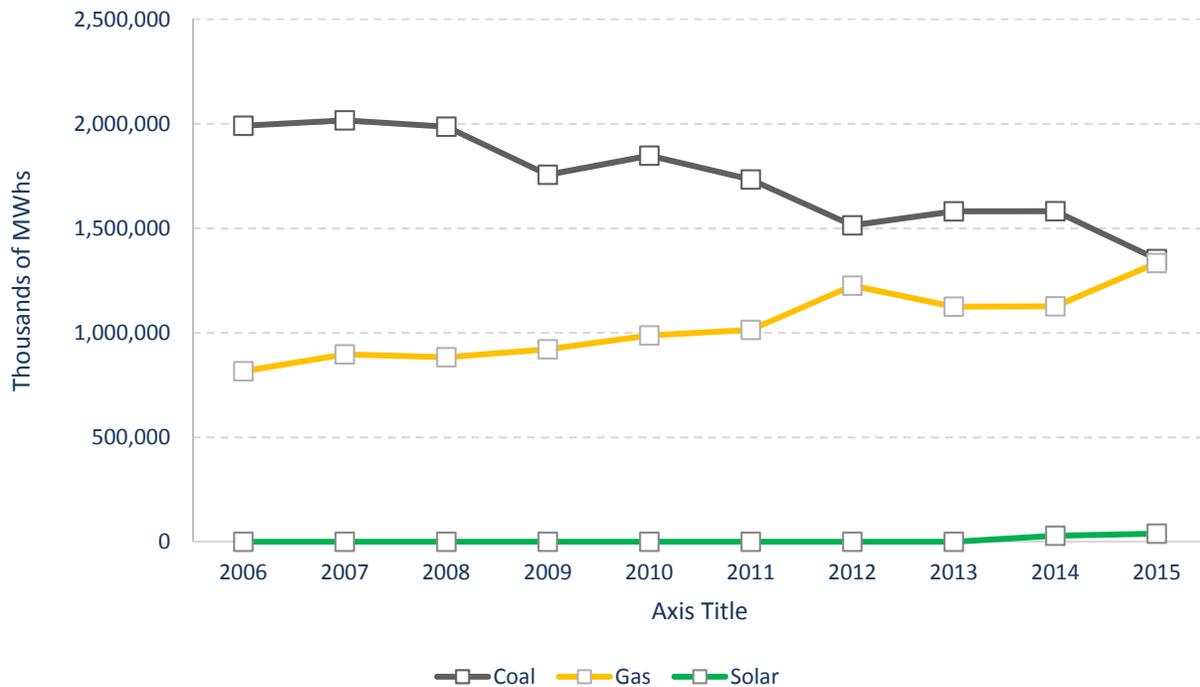

Source: U.S. Energy Information Administration, *Short-Term Energy Outlook*, February 2017²⁹

The U.S. Energy Information Administration expects the share of U.S. total utility-scale electricity generation from natural gas will fall from 34% last year (2016) to an average of 32% in 2017 as a result of higher expected natural gas prices. The forecast natural gas share is forecast to rise slightly to 33% in 2018. Coal's generation share rises from 30% in 2016 to average 31% in both 2017 and 2018. Non-hydropower renewables are forecast to provide 9% of electricity generation in 2017 and 10% in 2018.

²⁹ <https://www.eia.gov/todayinenergy/detail.php?id=29872#>

Pulverized Coal Technology Summary and Costs

Technology and Fuel	Sub-Critical Design, Pulverized Coal
Characteristics	Unit capacity can range in size from 250 to 600 MW. Performance characteristics range anywhere from 9,500 to 10,500 Btu per kWh. Annual capacity factors for these units range from 80 to 90% Units
Benefits	Mature technology. Fuel price stability and abundant supply. Resources are used to serve base load obligations. Coal plant plants are often used for system regulation and meeting spinning reserve requirements.
Risks	Coal plants are typically sited in remote locations requiring high capital investment in both plant and transmission. High CO2 emissions risk and high cooling water requirements.
Construction Lead Time	7 Years


Integrated Gasification Combined-Cycle (IGCC)

Technology and Fuel	Combined Cycle Plants, Coal Gasification
Characteristics	Newer technology. Unit capacity can range in size from 400 to 600 MW. Performance characteristics range anywhere from 9,000 to 11,000 Btu per kWh. Annual capacity factors for these units average 75%
Benefits	Designs that incorporate carbon capture and storage (CCS) are projected to be less expensive than coal facilities equipped with CCS.
Risks	Higher capital costs than other coal and natural gas resources. Carbon capture and storage technology unproven.
Construction Lead Time	8 Years for IGCC without CCS, 9 Years for IGCC with CCS

Coal Market Prices

TEP currently has ownership shares in four coal-fired power plants in Arizona and New Mexico, most of which are under long-term contracts for coal supply.

Chart 35 – TEP Coal Price Assumptions

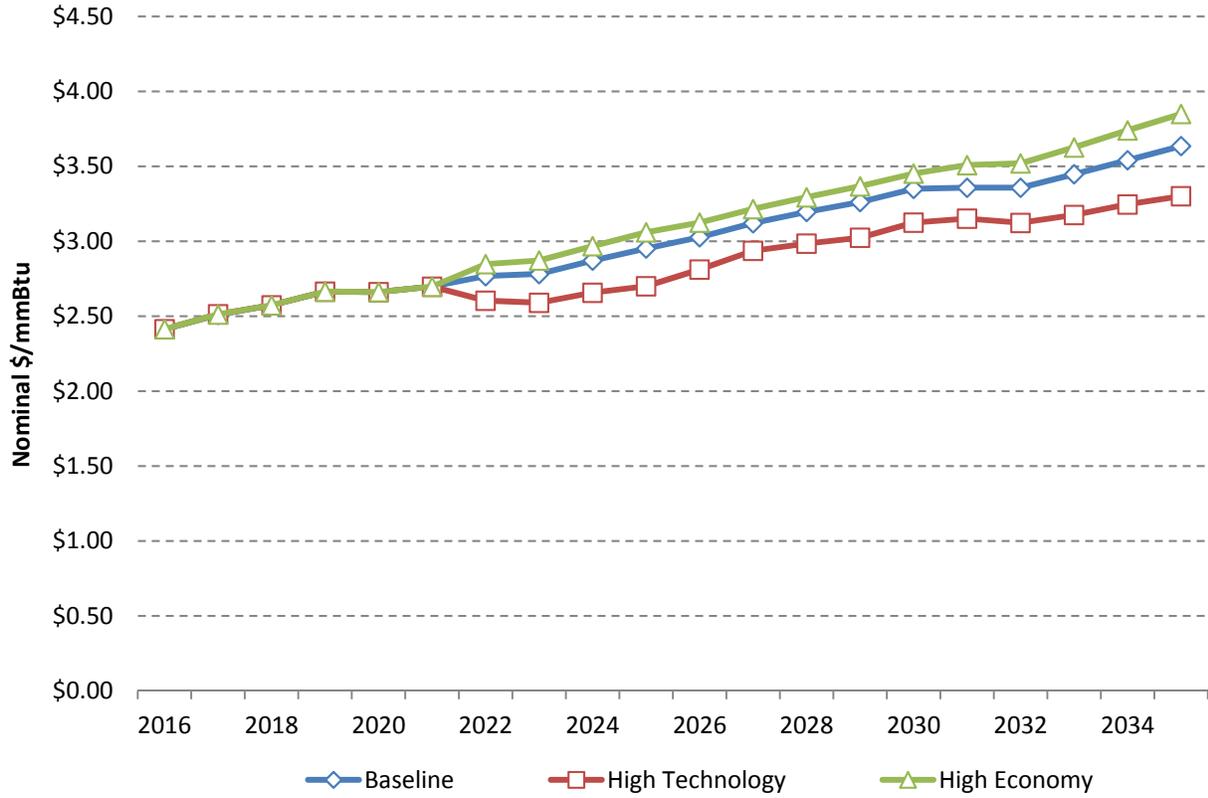

Nuclear Resources

When large-scale nuclear power plants went online over 60 years ago, it was a promising technology that delivered safe, reliable and most importantly, clean energy. In 2015, nuclear energy production was approximately 800 TWh or 20% of the total U.S. electric generation. The downside to nuclear power plants is the cost. The plants are expensive to develop, construct and expensive to operate. As the cost of renewable energy continues to decline and new technologies deliver low carbon power more reliably, the costs of nuclear plants become more unattractive. Combine these factors with projected low natural gas prices, nuclear becomes even more costly by comparison. In the last 5 years, a handful of nuclear power plants have been retired, including San Onofre in southern California in 2012 and 2013. Pacific Gas & Electric, owner and operator of Diablo Canyon Power Plant, announced that it will retire 2,160 MW when licenses expire in 2024 and 2025.

Small Modular Nuclear Reactors

Small modular nuclear reactors (SMR), approximately one-third the size of current nuclear plants, are compact in size (300 MW or less) and are expected to offer many benefits in design, scale, and construction (relative to the current fleet of nuclear plants) as well as economic benefits. As the name implies, being modular allows for factory construction and freight transportation to a designated site. The size of the facility can be scaled by the number of modules installed. Capital costs and construction times are reduced because the modules are self-contained and ready to be “dropped-in” to place.

A World Nuclear Association 2015 report on SMR standardization of licensing and harmonization of regulatory requirements, said that the enormous potential of SMRs rests on a number of factors:

- ▶ Because of their small size and modularity, SMRs could almost be completely built in a controlled factory setting and installed module by module, improving the level of construction quality and efficiency.
- ▶ Their small size and passive safety features make them favorable to countries with smaller grids and less experience with nuclear power.
- ▶ Size, construction efficiency and passive safety systems (requiring less redundancy) can lead to easier financing compared to that for larger plants.
- ▶ Moreover, achieving ‘economies of series production’ for a specific SMR design will reduce costs further.

The World Nuclear Association lists the features of an SMR, including:

- ▶ Small power, compact architecture and usually employment of passive concepts (at least for nuclear steam supply system and associated safety systems). Therefore, there is less reliance on active safety systems and additional pumps, as well as AC power for accident mitigation.
- ▶ The compact architecture enables modularity of fabrication (in-factory), which can also facilitate implementation of higher quality standards.
- ▶ Lower power leading to reduction of the source term as well as smaller radioactive inventory in a reactor (smaller reactors).
- ▶ Potential for sub-grade (underground or underwater) location of the reactor unit providing more protection from natural (e.g. seismic or tsunami according to the location) or man-made (e.g. aircraft impact) hazards.
- ▶ The modular design and small size lends itself to having multiple units on the same site.

- ▶ Lower requirement for access to cooling water – therefore suitable for remote regions and for specific applications such as mining or desalination.
- ▶ Ability to remove reactor module or in-site decommissioning at the end of the lifetime

Figure 30
50 MWe NuScale Power Module

The World Nuclear Association website has detailed information related to SMRs. The website is located at: <http://www.world-nuclear.org/info/nuclear-fuel-cycle/power-reactors/small-nuclear-power-reactors/>

NuScale Power™ is developing 50 MWe modules that can be scaled up to 600 MWe (12 modules). The scalability of SMRs allows for small utilities like TEP to consider their viability while lessening the financial risk. In December of 2013, NuScale was awarded a grant by the DOE that would cover half (up to \$217 million) to support development and receive certification and licensing from the Nuclear Regulatory Commission (NRC) on a single module.

In the fall of 2014, NuScale signed teaming agreements with key utilities in the Western region, which include Energy Northwest in Washington State and the Utah Association of Municipal Power Systems (UAMPS), representing municipal power systems in Utah, Idaho, New Mexico, Arizona, Washington, Oregon, and California. This initial project, known as the UAMPS Carbon Free Power Project, would be sited in eastern Idaho and is being developed with partners UAMPS, which will be the plant owner, and Energy Northwest, which will be the operator. The team expects that the 12-module SMR will be operation in 2024.



Figure 31 - NuScale Cross-section of Typical NuScale Reactor Building



Permitting and Time to Commercial Operation

As mentioned above, the UAMPS Carbon Free Power Project is expected to be in operation by 2024. The project timeline and milestone targets are tightly coordinated to complete the project in 11 years. Design and engineering is complete in the first 7 years and it overlaps with the licensing timeline. Construction and fabrication spans the remaining 5 years of the schedule.

SMR Technology Summary

Technology and Fuel	Small Modular Nuclear Reactor (SMR), Plutonium
Characteristics	Unit Capacity can range in size and modules are combined to achieve economy of scale. SMR is typically considered under 300 MW. Base-load type capacity factors (95%). NuScale Power is developing a power plant with funding and partnership with the DOE.
Benefits	Zero emissions and high capacity factors. Modular and factory-built, assembled on site.
Risks	High capital costs and no large scale production. Prototypes are being developed. Spent nuclear fuel disposal and maximum security required.
Construction Lead Time	11 years

CHAPTER 7**GRID BALANCING AND LOAD LEVELING RESOURCES****Energy Storage**

New challenges presented by greater amounts of renewable generation have prompted a greater interest in electric energy storage. The term Energy Storage System (ESS) covers many different types of technology. Each technology has specific attributes and applications that lead to using them based on individual system requirements for an identified need. The energy storage technologies are made up of systems such as pumped hydro, compressed air energy storage, various types of batteries, and flywheels.

Pumped Hydro-Power

This technology has been in use for nearly a century worldwide. Pumped hydro accounts for most of the installed storage capacity in the United States. Pumped hydro plants use lower cost off-peak electricity to pump water from a low-elevation reservoir to a higher reservoir. When the utility needs the electricity or when power prices are higher, the plant releases the water to flow through hydro turbines to generate power.

Typical pumped hydro facilities can store enough water for up to 10 or more hours of energy storage. Pumped hydro plants can absorb excess electricity produced during off-peak hours, provide frequency regulation, and help smooth the fluctuating output from other sources. Pumped hydro requires sites with suitable topography where reservoirs can be situated at different elevations and where sufficient water is available. Pumped hydro is economical only on a large (250-2,000 MW) scale, and construction can take several years to complete.

The round-trip efficiency of these systems usually exceeds 70 percent. Installation costs of these systems tend to be high due to siting requirements and obtaining environmental and construction permits presents additional challenges. Pumped hydro is a proven technology with high peak use coincidence.

Compressed Air Energy Storage (CAES)

A leading alternative for bulk storage is compressed air energy storage. CAES is a hybrid generation/storage technology in which electricity is used to inject air at high pressure into underground geologic formations. CAES can potentially offer shorter construction times, greater siting flexibility, lower capital costs, and lower cost per hour of storage than pumped hydro. A CAES plant uses electricity to compress air into a reservoir located either above or below ground. The compressed air is withdrawn, heated via combustion, and run through an expansion turbine to drive a generator. The dispatch typically will occur at high power prices but also to meet system needs.

CAES plants can use several types of air-storage reservoirs. In addition to salt caverns, underground storage options include depleted natural gas fields or other types of porous rock formations. EPRI studies show that more than half the United States has geology potentially suitable for CAES plant construction. Compressed air can also be stored in above-ground pressure vessels or pipelines. The latter could be located within right-of-ways along transmission lines. Responding rapidly to load fluctuations, CAES plants can perform ramping duty to smooth the intermittent output of renewable generation sources as well as provide spinning reserve and frequency regulation to improve overall grid operations.

Batteries

Several different types of large-scale rechargeable batteries can be used for ESS, including lead acid, lithium ion, sodium sulfur (NaS), and redox flow batteries. Batteries can be located in distribution systems closer to end users to provide peak management solutions. An aggregation of large numbers of dispersed battery systems in smart-grid designs could even achieve near bulk-storage scales.

In addition, if electric and plug-in hybrid electric vehicles become widespread, their onboard batteries could be used for ESS, by providing some of the supporting or “ancillary” services in the electricity market, such as providing capacity, spinning reserve, or regulation services, or in some cases, by providing load-leveling or energy arbitrage services by recharging when demand is low to provide electricity during peak demand.

Flywheels

These rotating discs can be used for power quality applications since they can charge and discharge quickly and frequently. In a flywheel, energy is stored by using electricity to accelerate a rotating disc. To retrieve stored energy from the flywheel, the process is reversed with the motor acting as a generator powered by the braking of the rotating disc.

Flywheel systems are typically designed to maximize either power output or energy storage capacity, depending on the application. Low-speed steel rotor systems are usually designed for high power output, while high-speed composite rotor systems can be designed to provide high energy storage. A major advantage of flywheels is their high cycle life—more than 100,000 full charge/discharge cycles.

Scale-power versions of the system, a 100 kW version using modified existing flywheels which was a proof of concept on approximately a 1/10th power scale, performed successfully in demonstrations for the New York State Energy Research and Development Authority and the California Energy Commission.

Energy Storage Applicability


Although the list of energy storage technologies discussed above is not all-inclusive, it begins to illustrate the point that not every type of storage is suitable for every type of application. Typical use applications for energy storage technologies may include:

Energy Management – Batteries can be used to provide demand reduction benefits at the utility, commercial and residential level. Batteries can be designed to replace traditional gas peaking resources. They can also be used as short-term replacement during emergency conditions.

Load and Resource Integration – Energy storage systems can be designed to smooth the intermittency characteristics of specific loads and/or renewable energy systems.

Ancillary Services – Flywheels, batteries and pumped hydro have the potential to balance power and maintain frequency, voltage and power quality at specified tolerance bands.

Grid Stabilization – Pumped Hydro, CAES and various batteries can improve transmission grid performance as well as assist with renewable generation stabilization.

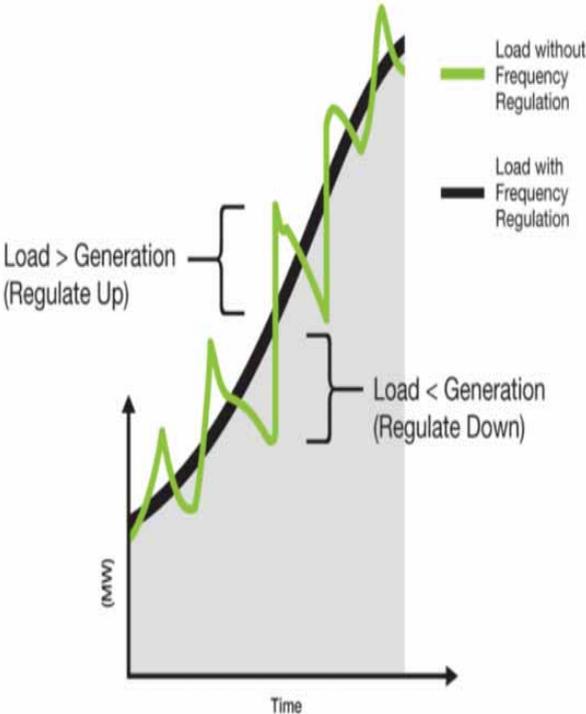

NextEra Energy Resources (10 MW)

Lithium nickel-manganese-cobalt battery

DeMoss Petrie Substation

In-service January 2017

Ancillary Service Target:

**Frequency Response 10 MW
In 10 seconds to 15 minutes (2.5 MWh)**

Because of the different use case potentials the technologies can be implemented in a portfolio strategy.

There are four challenges related to the widespread deployment of energy storage:


- ▶ Cost Competitive Energy Storage Technologies (including manufacturing and grid integration)
- ▶ Validated Reliability & Safety
- ▶ Equitable Regulatory Environment
- ▶ Industry Acceptance

TEP shows the need to develop a portfolio of future storage technologies that will support long-term grid reliability. The need for future storage technologies is focused on supporting the need for quick response time ancillary services. These services are listed below:


- ▶ Load Following/Ramping
- ▶ Regulation
- ▶ Voltage Support
- ▶ Power Quality
- ▶ Frequency Response

Figure 32 – Energy Storage Value Proposition

The Role of Energy Storage

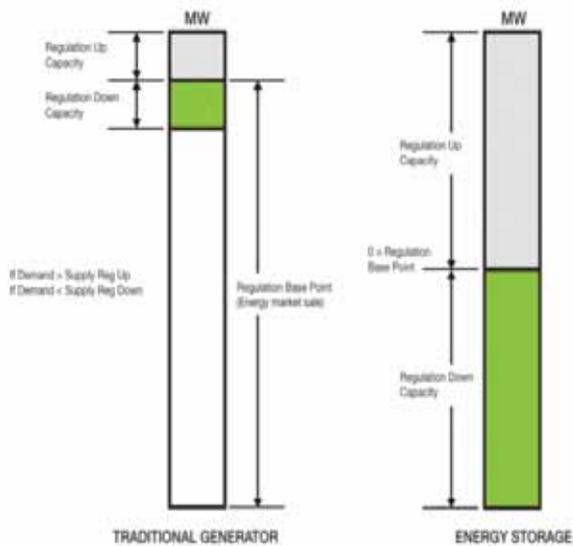

The Value Proposition

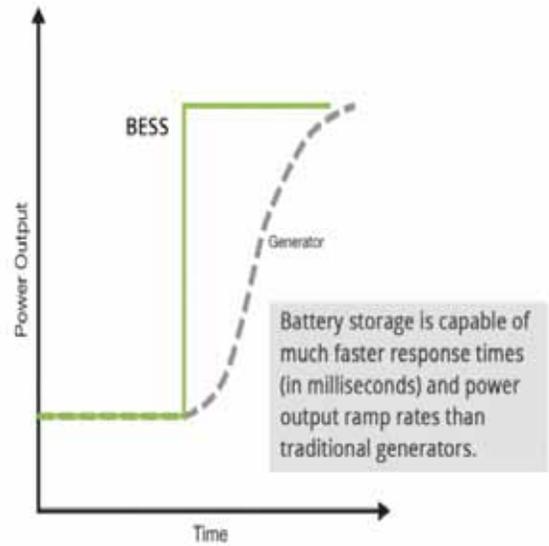

Energy Storage Technology Summary

Batteries

Technology and Fuel	Batteries
Characteristics	Various storage chemistries and energy/power configurations are available.
Benefits	High degree of flexibility in terms of siting, application (e.g., energy vs ancillary services), and scalability. Single systems can serve multiple purposes. Prices for most battery types are rapidly declining.
Risks	Levelized costs are still higher than other forms of energy storage, industry standards are still evolving, and some benefits can be difficult to monetize.
Construction Lead Time	6 months.

Pumped Hydro

Technology and Fuel	Pumped Hydro
Characteristics	Water is pumped from a lower reservoir to a higher reservoir, and the energy is recovered by releasing the water through hydro turbines.
Benefits	Mature technology capable of storing large amounts of energy for use over many hours at a time.
Risks	Requires suitable topography for the upper and lower reservoirs and a large up-front capital investment.
Construction Lead Time	5 years.

Compressed Air Energy Storage

Technology and Fuel	Compressed Air Energy Storage (CAES)
Characteristics	Air is compressed, typically in underground geologic formations, and the energy is recovered by using the compressed air to supply a combustion turbine.
Benefits	Mature technology capable of storing large amounts of energy for use over many hours at a time.
Risks	Very little commercial experience and requires a large up-front capital investment.
Construction Lead Time	3 years.

Fast Response Thermal Generation

TEP's 30% by 2030 renewable energy target will necessitate the construction or acquisition of fast-responding generating resources. Reciprocating internal combustion engines (RICE) and combustion turbines (CTs) are the preferred technology that will assist in mitigating renewable energy intermittency and variability. RICE have quicker start-up and ramping capabilities than most CTs. Aeroderivative CTs are based on aircraft jet engine design with increased cycling capabilities. These units can ramp faster than large frame combustion turbines making them well-suited for peaking and load-following applications. Large frame CTs have higher heat rates than aeroderivative and RICE but they produce higher temperature exhaust, so it makes them more suitable for combined cycle configurations.

Reciprocating Internal Combustion Engines

RICE are simply combustion engines that are used in automobiles, trucks, railroad locomotives, construction equipment, marine propulsion, and backup power applications. Modern combustion engines used for electric power generation are internal combustion engines in which an air-fuel mixture is compressed by a piston and ignited within a cylinder. RICE are characterized by the type of combustion: spark-ignited, like in a typical gas powered vehicle or compression-ignited, also known as diesel engines.

Figure 33 – Wartsila-50SG



An emerging use of these engines is in large-scale electric utility generation. The combustion engine is not a new technology but advances in efficiency and the need for fast-response generation make it a viable option to stabilize variable and intermittent electric demand and resources. RICE has demonstrated a number of benefits;

- ▶ Fast Start Times – The units are capable of being on-line at full load within 5 minutes. The fast response is ideal for cycling operation. RICE can be used to 'smooth' out intermittent resource production and variability.
- ▶ Run Time - The units operate over a wide range of loads without compromising efficiency, and can be maintained shortly after shut down. After shut down, the unit must be down for 5 minutes, at a minimum to allow for gas purging.
- ▶ Reduced O&M – Cycling the unit has no impact on the wear of RICE. The unit is impacted by hours of operation and not by starts and cycling operations as is the case with combustion turbines.
- ▶ Fast Ramping – At start, the unit can ramp to full load in 2 minutes on a hot start and in 4 minutes on a warm start. Once the unit is operational, it can ramp between 30% and 100% load in 40 seconds. This ramping is comparable to the rate that many hydro facilities can ramp at.

- ▶ Minimal Ambient Performance Degradation – Compared to Aeroderivative and Frame type combustion turbines, RICE output and efficiency is not as drastically impacted by temperature. The site altitude does not significantly impact output on RICE below 5,000 feet mean sea level.
- ▶ Gas Pressure – RICE can run on low pressure gas, as low as 85 PSI. Most CT's require a compressor for pressure at 350 PSI.
- ▶ Reduced Equivalent Forced Outage Rate (“EFOR”) – Each RICE has an EFOR of less than 1%. A facility with multiple RICE will have a combined EFOR that is exponentially less by a factor of the number of units at the facility.
- ▶ Low Water Consumption – RICE use a closed-loop cooling system that requires minimum water.
- ▶ Modularity – Each RICE unit is built at approximately 2 to 20 MWs and is shipped to the site.

An intriguing application for RICE is its potential for regulating the variability and intermittency of renewable resources.

Figure 34 – Reciprocating Internal Combustion Engine Facility



RICE Technology Summary

Technology and Fuel	Reciprocating Internal Combustion Engine (RICE), Natural Gas or Diesel
Characteristics	Unit capacity can range in size, TEP is evaluating 10 and 20 MW sized units that run on natural gas. Expected heat rate is approximately 8,000 Btu/kWh. These engines have a proven performance record as they've been used in marine crafts for decades. The units scaled for electric generation will deliver load-serving and grid-balancing services. The units are quick starting and fast responding.
Benefits	RICE meets the need for peak capacity and more importantly for fast response to renewable intermittency and variability. The units use circulating water for cooling and therefore require minimal water. RICE is modular in size and can start within 2 to 5 minutes.
Risks	Natural gas price volatility
Construction Lead Time	2 years

Large Frame Combustion Technology Summary

Technology and Fuel	Combustion Turbines (Large Frame), Natural Gas
Characteristics	Unit capacity can vary from 50 to 350 MW. Expected heat rate can range from 9,300 Btu/kWh for the larger units while the smaller units demonstrate a heat rate near 11,000 Btu/kWh. Typical start time is slower than RICE or Aeroderivative but equipment options from manufacturers can bring them closer.
Benefits	Large frame CTs can meet a need for intermediate and base-load applications. The units can be coupled for combined-cycle generation. Capital cost per kW are below Aeroderivative and RICE.
Risks	Natural gas price volatility
Construction Lead Time	2.5 years

Aeroderivative Combustion Turbine Technology Summary

Technology and Fuel	Combustion Turbines (Aeroderivative), Natural Gas
Characteristics	Unit capacity can vary from 20 to 100 MW. Performance during summer peak conditions is approximately 10,000. Faster start and ramp than large frame simple cycle CTs
Benefits	Meet the need for peaking capacity and load following applications. The units can be sited locally and help to reduce transmission infrastructure. Reduced water consumption.
Risks	Natural gas price volatility
Construction Lead Time	3 years

Demand Response

Demand Response refers to a class of programs offered by the utility to incentivize customers, generally C&I customers with high energy demand, to reduce their energy demand (kW) based on system needs. DR programs may be used to support standard benefits which include avoided firm capacity required to meet reserve requirements, reduced or avoided open-market power purchases during periods of high energy prices, and greater grid stability and reduction in outages due to reduced grid demand. Although DR has traditionally been focused on providing “capacity” through a reduction (i.e. curtailment) in customer demand during peak periods, it is increasingly being considered for additional services such as ramping or load leveling, wherein energy demand is “rescheduled” versus curtailed.

Customers enter into DR agreements voluntarily and in doing so receive a financial incentive, such as a reduced electricity rate, in exchange for committing some portion of their energy demand to the utility’s control. These agreements typically have limitations including the amount of energy demand the customer commits to the utility, as well as the number and duration of events during which the utility can call on the demand reductions. Some agreements even provide customers the option to “opt out” of a particular call event, which makes certain portion of the DR capacity less than 100% dispatchable.

Strategies used by customers under DR agreements include:

- ▶ Reduction of HVAC load
- ▶ Reduction of other mechanical load (compressors, motors)
- ▶ Reduction of lighting load
- ▶ Curtailment of production lines

The specific strategies that customers use to meet their DR commitments will depend on certain external conditions such as time of day, season, weather, etc., and can also depend on the amount of advance notice provided by the utility. Because customers have energy needs specific to their line of business, DR programs are most effective at meeting predictable utility needs such as summer peak where a utility can provide a day-ahead notice based on high forecast temperatures. DR is less effective (i.e. less dispatchable) at meeting unexpected or intermittent energy demands.

Demand Response Technology Summary

Technology	Utility installed thermostats and switches at customer site used to control customer demand.
Characteristics	The goal of DR is to reduce customer peak demand rather than overall energy use. Programs target summer peak periods to offset the utilities' need to procure additional resource capacity. Programs may utilize cycling methodologies, load shifting, or direct interruption during summer peaks or system emergencies.
Benefits	Depending on program design, DLC is often utilized as a dispatchable resource as part of utility operations. Can decrease utility ramping demand as well as well as load leveling and providing peak capacity, potentially deferring or delaying the need for additional generation or transmission capacity.
Risks	Challenges include limited customer participation, minimum yearly call options and low dispatch duration.
Program Lead Time	1 Year

Rate Design

One element of the provision of electric utility services that affects customer usage patterns and, therefore, impacts future capacity needs is retail rate design. However, consideration of the impact of rate design on resource planning is often neglected in the IRP process. This section provides an overview of approaches to retail rate design that may affect future resource needs and should be considered as components of the IRP process. The two broad rate design categories discussed in this section are demand rates and time-varying rates. That is followed by a brief discussion of the effects of increased penetration of DG on system operations and future capacity needs and the implications for rate design. The section ends with an overview of TEP's approach retail rate design as it relates to resource planning.

Demand Rates

The most basic electric utility rate design is the two-part rate, which consists of a fixed basic service charge and volumetric energy charges assessed on the kWh consumed during a billing period. Most residential and small commercial customers receive service on a two-part rate structure.

Demand rates, or three-part rates, assess charges on a customer's peak demand during a billing period in addition to a fixed charge and volumetric energy charges. The peak demand upon which the customer is billed may be measured as the customer's maximum kW over time intervals ranging from instantaneous to a one-hour interval. Billing demand may also be defined as the maximum demand over the entire billing period or only during defined on-peak periods and may incorporate a demand ratchet. A demand ratchet further defines billing demand as the maximum of measured demand and some percentage of maximum billing demand for a set number of prior billing periods. Because system peak demand is a major driver in the need for additional generating capacity, charging customers directly for their contribution to system peak may provide a price signal that reduces peak demand and therefore results in delaying the need for future capacity additions. Medium and large commercial customers and industrial customers usually take service on some variation of a three-part demand rate.

Time-Varying Rates

Time-varying rates, if designed properly, may be used to induce load shifting from peak to off-peak periods by providing a price signal that results in higher prices during peak periods and lower prices during off-peak periods. Shifting loads may reduce the need for additional capacity by reducing the need for energy supply at peak times. Time-varying rates may also be used in a three-part demand rate structure and both the demand and energy components of the rate design can have time-varying elements.

Time-varying electric rates include Time-of-use (TOU) rates, critical peak pricing, and real-time pricing (RTP). TOU is the most basic and by far the most commonly used of time-varying approaches to retail electric pricing and consists of pre-defined peak and off-peak time periods with differentiated pricing for each. RTP is the most sophisticated and variable approach, with hourly prices determined by day-ahead market prices or real-time spot market prices for electricity. Critical peak pricing rates are fixed rates where customers are charged higher prices during peak demand events that are announced in advance. A variation of critical peak pricing is a pricing regime where customers receive a rebate for reducing usage during a pre-announced peak demand event.

Distributed Generation

The increased penetration of DG, predominantly rooftop solar, in the TEP service area creates some challenges for both system operations and system capacity planning and the Company recognizes the need to adapt its rate design to address these challenges. The peak period for rooftop solar production occurs during midday and does not coincide with the TEP system peak periods, which occur in the late afternoon during the summer and morning and late afternoon to early evening during the winter. As a result, rooftop solar energy output is highest on the system during midday when energy resources are abundant. However, increasing solar generation may have only a minor impact on reducing system peak demand. Therefore, future rate designs should focus more on shifting consumption away from the system peak periods into the periods of peak solar production, which has the benefit of improving system load factor and operations and also alleviates the need for future capacity additions to serve peak demand. From a rate design perspective, combining TOU rates with demand rates and expanding off-peak hours to include more hours with abundant rooftop solar energy will serve to modernize utility rate design and address the challenges put forth by increased DG development.

TEP Rate Design

Currently, TEP offers optional TOU rates to all retail customer classes except Large Power Service (LPS) customers who take service only on a TOU rate. Residential and Small General Service customers have historically taken service on two-part rates and the LGS and LPS customer classes have mandatory three-part demand rate structures. TEP has formed a Medium General Service (MGS) customer class where customers will be moved predominantly from the Small General Service class and placed on a three-part demand rate following a transition period.

TEP recognizes the impacts that increasing rooftop solar penetration will have on system load shapes and the challenges that poses for system operations and capacity planning. In the Company's 2015 rate case, TEP proposed, and the ACC approved, several changes to its existing retail rates to address these challenges with a more modern rate design. For example, TEP expanded rate options for Residential and Small General Service customers to include three-part demand rates. These rate options also have TOU variants for energy charges and billing demand is defined as the maximum one-hour measured kW demand during on-peak periods for all options. In addition, TEP expanded the summer and winter off-peak hours in its Residential TOU and Residential TOU demand rate tariffs.

More information can be found at TEP's website: <https://www.tep.com/rates/>

Desert Southwest Wholesale Power Markets - Transformation


Wholesale Power Market Overview

Historically, the wholesale power markets have served the Desert Southwest as an efficient mechanism for utility operators to buy and sell standard market-based products as a means to optimize their resource portfolios. However, with the rapid increase in renewable resource penetration throughout the region, a transformation of market fundamentals is currently underway and is changing how both load-serving entities and wholesale merchants transact within these markets. While these changes will have economic implications for day-ahead and real-time operations, resource portfolios of the future will also need to adapt with fast start, fast-ramping, flexible generation in order to take advantage of short duration price fluctuations in order to minimize portfolio costs for customers.

Non-Dispatchable Renewable Must Run Resources

Because most solar and wind resources are non-curtailable resources, utility operators must dispatch around the solar and wind output. In today's wholesale power markets, solar generation typically displaces on-peak generation, causing a downward shift in market prices from the hours of 8 AM to 4 PM. In some hours throughout the year, this surplus power results in the market clearing price going negative due to generation exceeding system demand.


Chart 36 – Impact of Solar Surplus on the Wholesale Power Markets

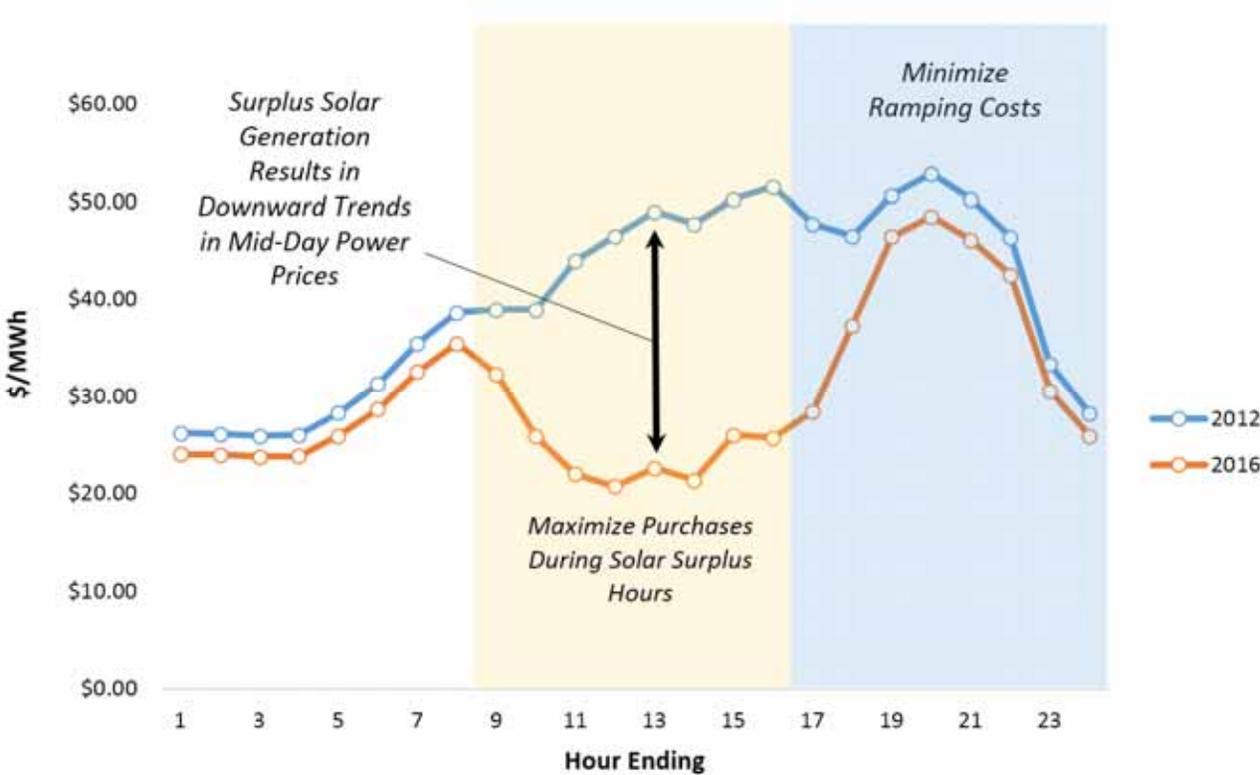

Impacts on Baseload Generation Resources

In addition to surplus renewable generation, low cost shale gas production has also played a significant role in transforming the supply and demand economics of natural gas. As we saw in 2015 and 2016, expanded natural gas production from shale formations is directly impacting the economic viability of many baseload coal and nuclear resources. Unlike renewables, most thermal plants like coal and nuclear, have higher operating costs that cannot be fully recovered in the wholesale market. Thus, the ultimate effect of high penetrations of renewables and low cost natural gas will likely be an accelerated retirement of older and higher cost coal and nuclear resources. Alternatively, resources like NGCC units that have lower operating costs are more competitive in today's wholesale power markets. This competitive advantage will likely set the stage for NGCC units to displace coal and nuclear as baseload resources since they are better positioned to maintain profitability in a market driven by low natural gas prices.

Chart 37 - Comparisons of Coal vs. Natural Gas Combined Cycle Resources

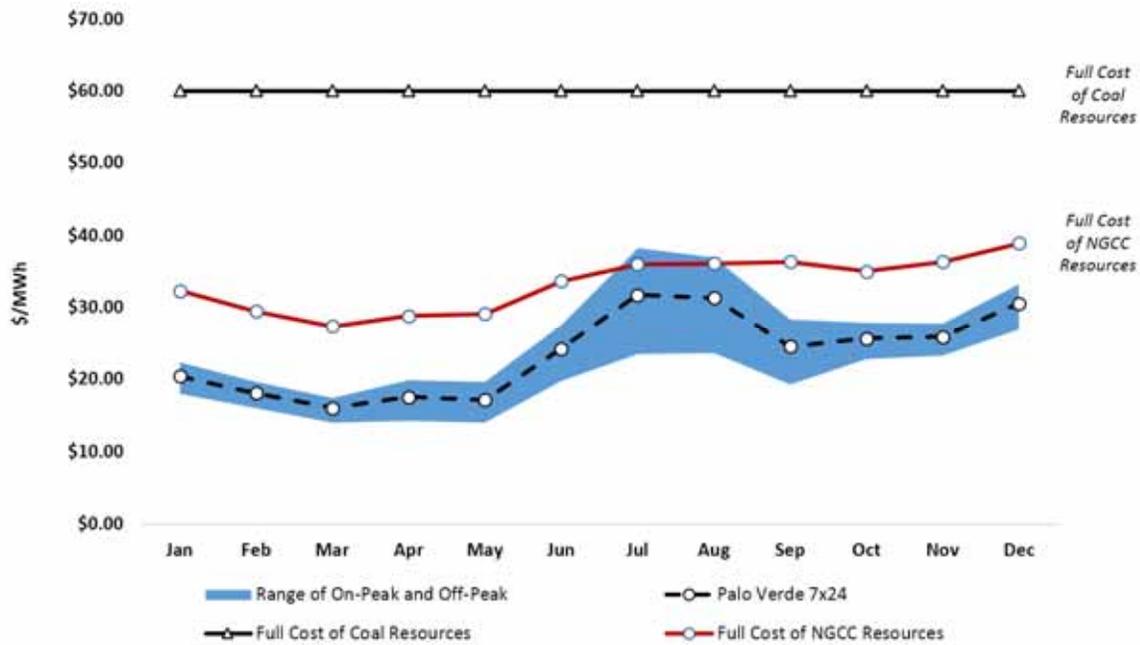

Reduction in Overall Natural Gas Demand and Commodity Prices

In addition to the market changes listed above, renewable resources are dramatically reducing the power sector's overall demand for natural gas consumption.³⁰ Low load growth coupled with a higher penetration of renewable energy and historically low natural gas prices, have resulted in low wholesale power prices during the last two years. This trend is likely to continue for some time due to the increased efficiencies in shale production and the declining cost of renewable energy resources, which are below the cost of traditional fossil fuel resources on a long-term levelized basis. As noted in the Wood MacKenzie Base Case, despite uncertainty regarding U.S. energy policy changes, recent analysis suggests low natural gas prices are one of the biggest disruptors of the power sector. This low price trajectory will cause natural gas to increasingly displace coal in the foreseeable future. Because of this trend and steady growth in renewables, wholesale power prices will likely stay depressed over the long term.³¹

³⁰ NREL Study: A Retrospective Analysis of the Benefits and Impacts of U.S. Renewable Portfolio Standards. <https://emp.lbl.gov/sites/all/files/lbnl-1003961.pdf>

³¹ Long-term forecast projections based on Wood-Mackenzie, North America Gas, Power and Coal Markets – No Carbon Case. February 2017.

Arizona Gas Storage Project

As TEP reduces its reliance on coal, cleaner, more efficient natural gas will play a bigger role in maintaining the Company's grid operations. Today, TEP relies on the El Paso and Transwestern pipeline networks to deliver natural gas primarily from the San Juan and Permian supply basins to support its long-term, as well as real-time power generation needs. In other regions of the country, natural gas storage provides a reliability backstop to a multitude of pipeline operational constraints that can impact the delivery of natural gas. However, in Arizona there are currently no natural gas storage facilities. As part of the Company's 2017 IRP integration strategy, TEP is in the process of evaluating local natural gas storage as a resource which may improve TEP's system reliability by meeting its future hourly gas balancing and generation ramping requirements as the Company integrates higher levels of renewable resources.

Kinder Morgan 2017 Open Season

On January 31, 2017, Kinder Morgan issued an open season³² for an Arizona based natural gas storage project that would offer storage related services including no-notice transportation (NNT)³³. AGS project will consist of four to eight natural gas salt storage caverns to be located in Pinal County Arizona, near Eloy having an initial design working inventory of one (1) billion cubic feet (Bcf) per cavern for a total capacity of at least four Bcf and having a projected minimum aggregate injection capacity of 168,000-183,000 thousand cubic feet (Mcf) per day and a projected minimum aggregate withdrawal capacity of 400,000 Mcf per day. TEP is still evaluating the proposal from Kinder Morgan and will continue to evaluate proposals from entities which present the greatest opportunity for increasing system flexibility, and providing the greatest support for reliability at the least cost.

³² A natural gas construction project can take an average of about three years from the time it is first announced until the project is placed in service. The first step in the process is to conduct an open season to determine market interest. An open season is held for 1-2 months, giving potential customers an opportunity to enter into an agreement to sign up for a portion of the capacity rights that will be available. If enough interest is shown during the open season, the sponsors will develop a preliminary project design and move forward. If not enough interest is evident, the project will most likely be dropped or placed on indefinite hold. http://passportebb.elpaso.com/WesternPipes-Notices/EPNG-Notices/NOTICE_16834_Arizona_Gas_Storage_Project.pdf

³³ No-notice transportation services allow LDCs and utilities to receive natural gas from pipelines on demand to meet peak service needs for its customers, without incurring any penalties. These services include access to storage facilities that provide increased flexibility to receipt and delivery points on a real-time basis.

CHAPTER 8**REGIONAL TRANSMISSION PLANNING****Overview****Ninth Biennial Transmission Assessment**

TEP participates in the Biennial Transmission Assessment (BTA) conducted by the Commission to assess the adequacy of Arizona's transmission system to reliably meet existing and future energy needs of the state. The 9th BTA concluded that the existing and planned transmission system is adequate to reliably serve the needs of the state during the study period.

Reliability Must Run (RMR) Assessment

An RMR condition exists for the Tucson load pocket because the TEP load exceeds the system import limit of the existing and planned transmission system. However, the projected load can be served through a combination of power imports and local generation. In the 7th BTA, the Commission ordered the suspension of RMR studies pending review of criteria that will trigger restarting RMR studies. TEP has not met any of the criteria, therefore, RMR studies were not performed for the 9th BTA.

Ten Year Snapshot Study

TEP participated in the Ten Year Snapshot Study conducted by the Southwest Area Transmission Arizona Subcommittee (SWAT-AZ) participants. This study concluded that the Arizona 2025 transmission plan is robust and can withstand simulated contingencies and that delaying any single planned project beyond 2025 did not have significant impact on system performance.

Extreme Contingency Study

TEP conducted powerflow analysis of outages involving TEP corridors that include 3 or more lines and TEP substations that include 3 or more transformers with a low side voltage of 100kV and higher. This evaluation is considered Critical Energy Infrastructure Information (CEII) and was filed with the Commission under a confidentiality agreement.

Effects of Distributed Generation and Energy Efficiency Programs


As required in the 8th BTA, TEP performed a sensitivity analysis to determine the effects of DG and EE programs on future transmission needs. This analysis determined that no additional transmission facilities are required due to these programs.

WestConnect

TEP actively participates in WestConnect regional planning and interregional coordination activities in compliance with FERC Order 1000. WestConnect is one of four planning regions that was established to develop and implement FERC approved regional planning processes designed to facilitate joint regional transmission planning among the transmission owning entities that participate in the WestConnect Planning Region.

Participants may join one of five sectors consisting of the Transmission Owner with Load Serving Obligations (TOLSO)³⁴, Transmission Customer, Independent Transmission Developer (ITD), State Regulatory Commission and Key Interest Group. Currently there are eighteen (18) Transmission Owners in the TOLSO sector, eight (8) developers in the ITD sector and one (1) participant in the Key Interest Group. The Transmission Customer and State Regulatory Commission sectors have no participants. Members of sectors participate in WestConnect governance that consists of the Planning Management Committee (PMC) with subcommittees including Planning Subcommittee (PS), Cost Allocation Subcommittee (CAS), Contracts and Compliance Subcommittee and Legal Subcommittee. TEP is active on the PMC, PS and CAS as well as on various task forces as required. WestConnect’s regional planning process is biennial and is implemented according to the following timeline.


Figure 35 - WestConnect Planning Timeline

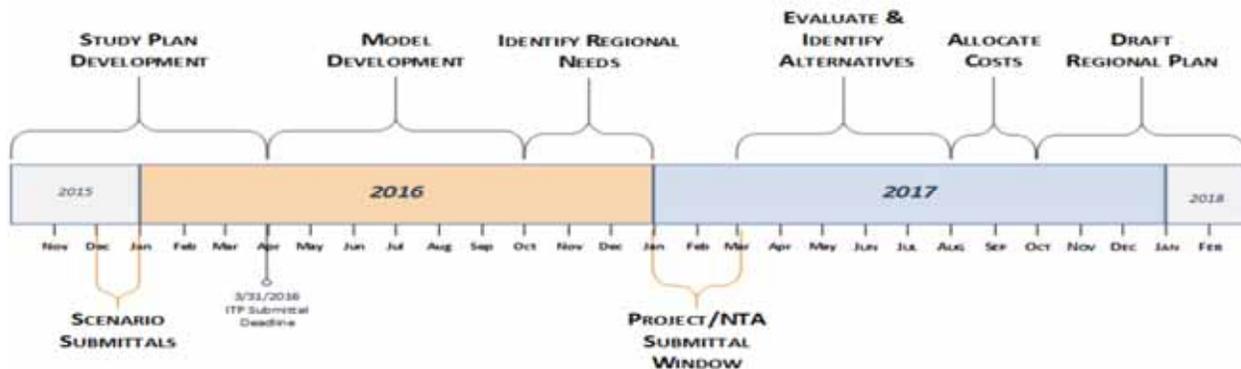

Coordination with the other three Western Planning Regions (CAISO, Columbia Grid (CG) and the Northern Tier Transmission Group (NTTG)) occurs throughout the process beginning with development of the study plan. The footprints of the respective Western Planning Regions (WPR) are shown in the following Western Planning Regions map.

³⁴ TEP / UNSE is an enrolled member of TOLSO.

Map 11 - Western Planning Regions

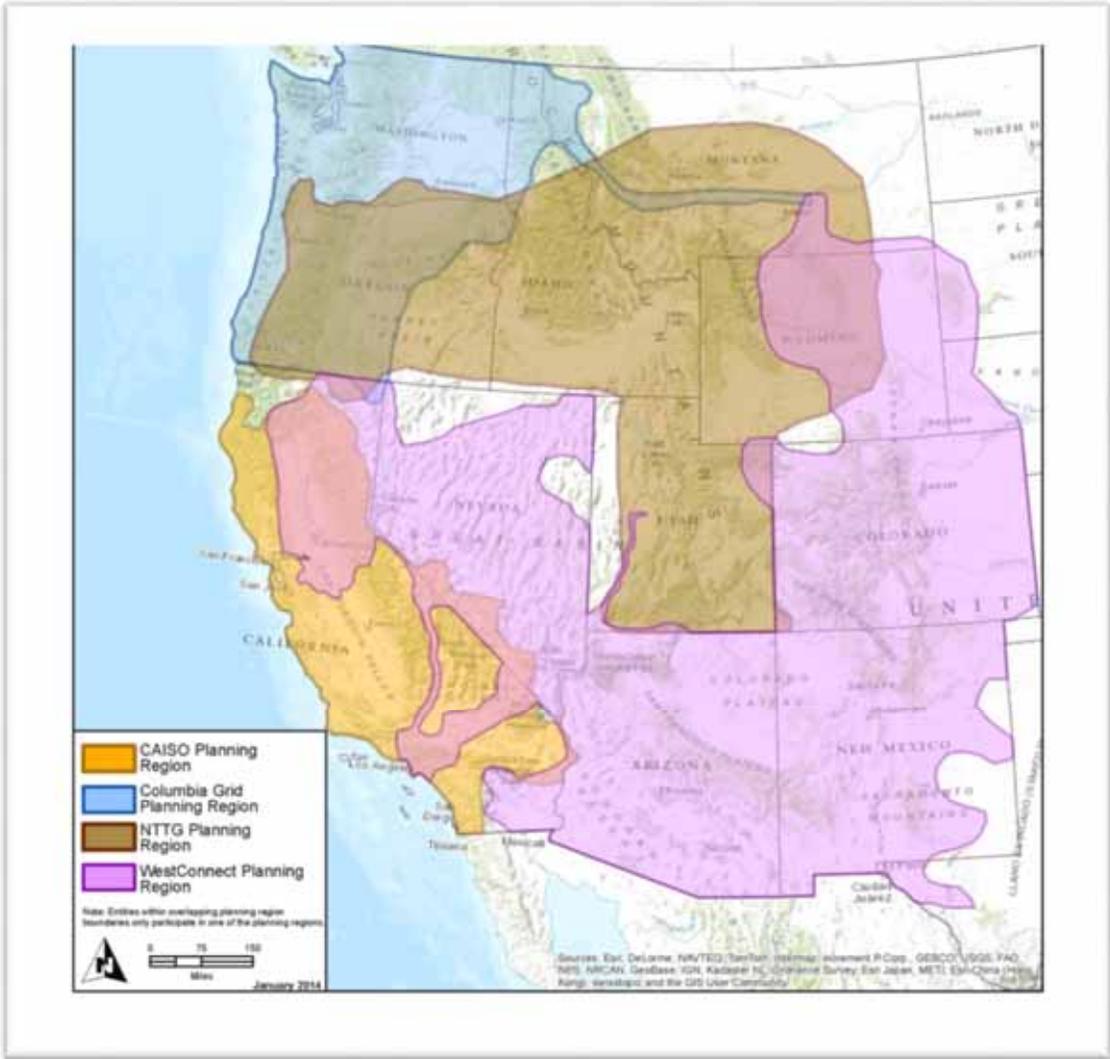

Participating in WestConnect and interregional coordination activities is essential to maintaining data and modeling accuracy and to ensuring consistency among local, regional and Western Interconnection-wide transmission plans. Coordination with WECC, as described in the following section is evolving.

WECC

TEP participates on the Planning Coordinating Committee (PCC) and Transmission Expansion Planning Policy Committee (TEPPC), as well as their respective subcommittees. These committees are in the process of being replaced by the Reliability Assessment Committee (RAC) as approved by the WECC Board on December 6, 2016. The approved proposal states, “The RAC would replace the current TEPPC and PCC and assume responsibility for all products currently under the purview of both committees. The RAC would be a single reliability

assessment organization within WECC that would facilitate a unified approach to evaluating potential reliability risks and efficiently use stakeholders' expertise".³⁵

RAC governance is accomplished through four subcommittees consisting of the Scenario Development, Studies, Modeling and Data Subcommittees reporting to the RAC. Representation on each of the subcommittees includes a single member representing the four WPR plus two International Planning Regions (IPR)³⁶, along with the other participants as described in the WECC Board approved RAC proposal.

The key deliverable of RAC is a process to create an Anchor Data Set (ADS) that will begin and conclude with the biennial Transmission Plans of the WPR. The ADS will be a combination of solved power flow and production cost models that may be used by WECC, the WPR's and other entities as a consistent starting point for reliability assessment and other regional studies. TEP participated with WestConnect on development of the ADS process in collaboration with the other three WPR and WECC.

Multi-Regional & Interconnection-Wide Transmission Planning

TEP participates in the Southwest Area Transmission (SWAT) Group that is comprised of transmission regulators/governmental entities, transmission users, transmission owners, transmission operators and environmental entities. SWAT Transmission Owner membership systems are included in the states of Texas (El Paso), New Mexico, Arizona, Nevada and California. SWAT participates in the WestConnect regional planning process, representing its members, primarily in coordinating model development. The initial investigation of the implications of pending EPA rules was coordinated through SWAT. This study effort was subsequently expanded to the systems in WestConnect, California and beyond.

SWAT created a Coal Reduction Assessment Task Force (CRATF) in February 2013 for the purpose of assessing the reliability impacts of anticipated as well as hypothetical coal retirements in the southwest. In the Eighth BTA, the CRATF reported on the first phase of a reliability study and was ordered in Decision No. 74785 to file the results of the study within 30 days of completion. Currently being led by TEP, the ultimate goal is to evaluate the impacts from reduced availability of coal generation within the scope and timeline of the WestConnect Regional Study Plan.

TEP participated with Arizona Electric Power Cooperative (AEPSCO), Arizona Public Service Company (APS), SRP and the Western Area Power Administration (WAPA), in developing a realistic Arizona Utility Clean Power Plan (CPP) Compliant scenario that was submitted to WestConnect. The WestConnect PMC adopted that scenario as a "WestConnect" Utility scenario that is currently in the process of evaluation, along with other higher renewable penetration/coal retirement scenarios, to identify transmission system "opportunities".

The WestConnect cases and study work will be used to assess the impact of the CPP on the reliability of the Arizona transmission system as ordered by the ACC in the 9th BTA. The objective of coordinating with the WestConnect biennial regional planning process was to gain access to the most current and accurate data sets for the systems surrounding Arizona.

Evolving Resource Mix Challenges

The Arizona transmission system was designed to accommodate the large coal generation fleet that is geographically distant from the load centers. The integration of renewable energy projects and the simultaneous reduction of coal resources is likely to have an impact on the operation of the transmission grid.

³⁵ Source: Recommendation 1. [Create a Reliability Assessment Committee \(RAC\)](#) of the JPTRTF Proposal – Revised October 5, 2016.

³⁶ The IPR include the Baja Mexico and western Canadian regions.

The loss of system inertia and dynamic reactive capability, as well as changes in power flows, pose significant risks and updates should continue to be filed in the BTA process.

TEP gave a presentation at the RETI 2 Western Outreach Workshop in Las Vegas on September 1, 2016. The main purpose was, "...to better understand the transmission implications of accessing renewable energy from elsewhere in the West, as well as identifying potential markets for California's own excess renewable energy production that may help meet California's 2030 RPS and GHG goals most efficiently". Key concerns expressed by TEP were:

- An Integrated Regional Resource Plan that defines the necessary energy resources and transmission assets with a coordinated strategy to deploy them does not yet exist
- Such an Integrated Regional Resource Plan is necessary to conduct comprehensive regionally coordinated reliability studies.
- Short timeline for expected rate of renewable resource deployment and coal plant retirements

Key Issues:

- ▶ Coal Plant Retirements/Replacement Resources are uncertain
- ▶ Changing California Imports/Exports driven by Nuclear and Gas OTC Retirements, Increasing Renewable Penetration and Wind Resources from New Mexico & Wyoming
- ▶ Loss of "inertia" associated with coal plant shutdown, resulting in possible stability and/or frequency response impact
- ▶ Change in generation pattern and resource mix will impact Path Ratings
- ▶ New requirements that include, but are not limited to, ramping, frequency response, voltage regulation and dynamic reactive capability will have to be determined through separate studies among the regions.

Therefore TEP is interested in obtaining frequency response and stability information based on system analyses that take rapidly changing operating conditions resulting from high renewable resource penetration, coal- and gas-fired generation retirements and materially revised resource mix into consideration. Such analysis is intended to be used to identify additional alternative market mechanisms based on demonstration of actual anticipated physical transmission system benefits. These efforts will require further continued coordination and cooperation among the Arizona utilities and stakeholders, SWAT, WestConnect, the other WPR and IPR, and WECC. The ADS will be among the most critical assets to allow credible analyses to be completed to inform resource and transmission planning decisions.

Other Regional Transmission Projects

Other large projects proposed for interconnection in eastern and southeastern Arizona may influence TEP's long-term resource planning decisions.

Nogales DC Intertie

The Nogales Interconnection Project is a proposed direct current interconnection, commonly known as a DC tie, which will allow for an asynchronous interconnection between the electric grids in southern Arizona and the northwest region of Mexico. The project will support the reliability of the electric system, including providing bidirectional power flow and voltage support, as well as emergency assistance, as needed, for the electric system both north and south of the border.

Map 12 - Nogales DC Intertie Study Area and Route



The first phase would consist of a new 150 MW DC tie located on property currently owned by TEP; a new 3-mile 138 kilovolt (kV) transmission line that would originate at UNSE's Valencia Substation in Nogales, Arizona and extend to the west and south to the new Gateway Substation; and a new approximately 2-mile 230 kV transmission line that would extend south from the Gateway Substation to the U.S.-Mexico border where it would interconnect with a transmission line to be constructed in Mexico. The second phase would expand the DC Tie capacity to 300 MW. The timing of the second phase is not yet certain.

Picture 1 – Sharyland HVDC on the Texas-Mexico Border



SunZia Southwest Transmission Project


SunZia is a double-circuit 500 kV line that will originate in central New Mexico at a proposed substation near Ancho, New Mexico and terminate at the proposed Pinal Central substation near Casa Grande, Arizona. It is being planned to provide New Mexico and Arizona additional access to renewable energy resources. SunZia could increase import capacity from New Mexico by as much as 3,000 MW.

The SunZia Southwest Transmission Project is planned to be approximately 515 miles of two single-circuit 500 kV transmission lines and associated substations that interconnect SunZia with numerous 345 kV lines in both states. SunZia will connect and deliver electricity generated in Arizona and New Mexico to population centers in the Desert Southwest.

The electricity distributed by SunZia should help meet the Southwest Region and California's demand for renewable energy.

On January 23, 2015, the BLM issued a Record of Decision (ROD) that approved SunZia's application for a right-of-way across federally owned property. The ROD concluded the six and half year effort to comply with NEPA.

Map 13 - Sunzia Proposed Project Route

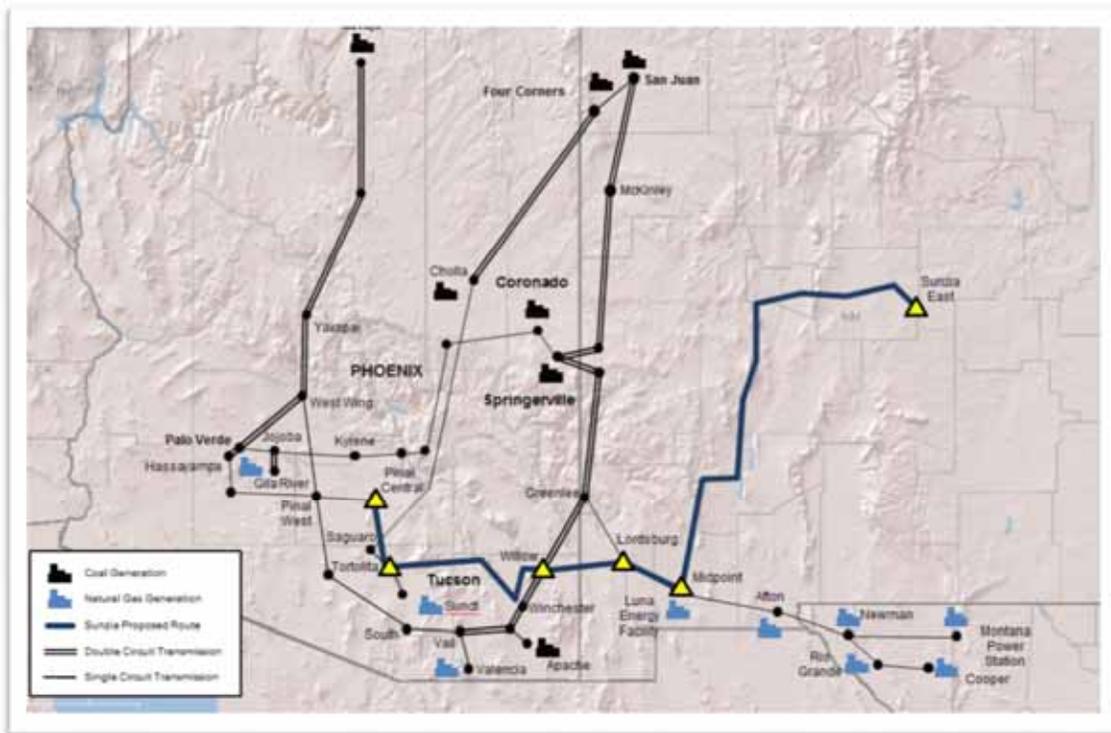


The Southline Transmission Project

The Southline Transmission Project is a proposed transmission line designed to collect and transmit electricity across southern New Mexico and southern Arizona, bringing potential electric system benefits to the Desert Southwest. The project is being designed to minimize land and resource impacts by developing a route along existing linear features and by upgrading existing transmission lines where feasible. The project will provide up to 1,000 megawatts of transmission capacity in both directions, and will interconnect with up to 14 existing substation locations. The project consists of two sections:

The New Build Section would involve the construction of approximately 240 miles of new 345kV double-circuit electric transmission lines in New Mexico and Arizona. The New Build is defined by end points of the existing Afton Substation, south of Las Cruces, New Mexico, and the existing Apache Substation, south of Wilcox, Arizona.

The Upgrade Section would consist of double-circuit 230-kV lines connecting the Apache Substation to the existing Saguaro Substation northwest of Tucson, Arizona. The Upgrade Section would rebuild approximately 120 miles of existing single-circuit 115-kV transmission lines, currently owned by WAPA, providing up to 1,000 MW of transmission capacity between these substations. A new line segment approximately 2 miles in length will be required to interconnect with the existing TEP Vail Substation, located just north of the existing Western line. The upgrade section will also interconnect at TEP's Tortolita and DeMoss Petrie substations.


Map 14 - Southline Proposed Project Route

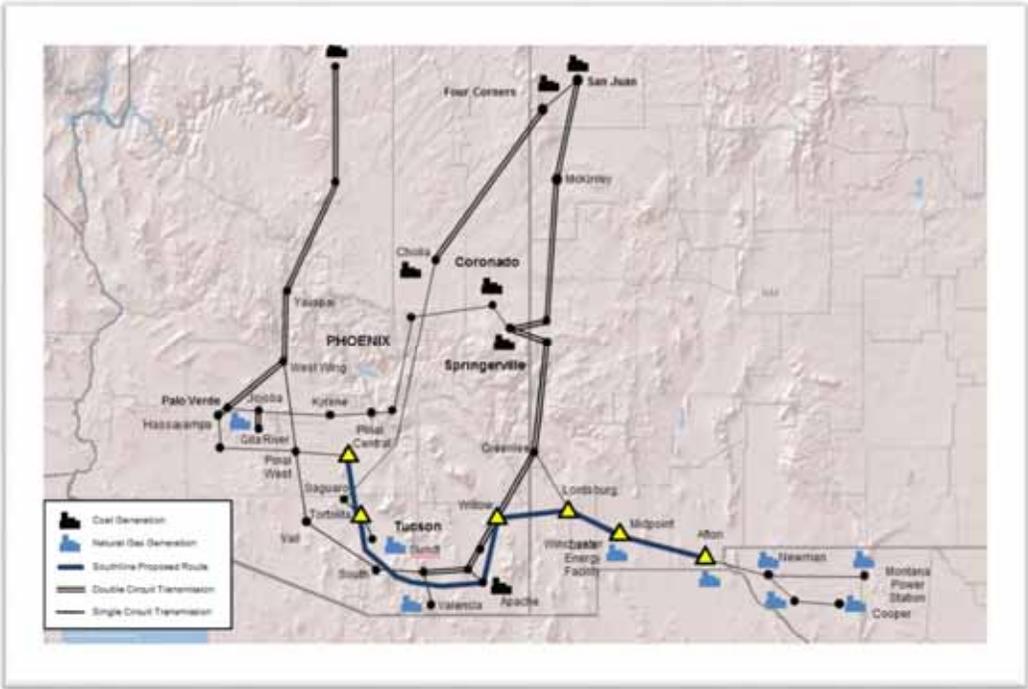

Western Spirit Clean Line

The Western Spirit Clean Line will collect renewable power from east-central New Mexico and deliver approximately 1,000 MW of power to markets in the western United States that have a strong demand for renewable energy. The energy will be transported via an approximately 140-mile transmission line to the existing electric grid in northwestern New Mexico where it interconnects with the TEP transmission system at San Juan.

Figure 36 - Western Spirit Clean Line Project

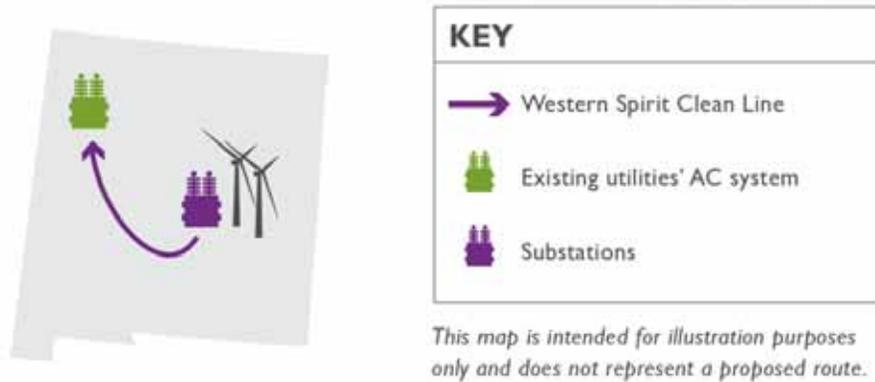

The project will begin near Corona, New Mexico and will terminate northwest of Albuquerque at the Public Utility of New Mexico's (PNM) Rio Puerco substation. Clean Line and RETA have worked with a wide range of interested parties to select a route, including federal, state and county agencies, environmental NGOs, and Native American tribes. Clean Line will meet with each landowner affected by the Western Spirit Clean Line and will take landowner feedback into consideration when determining structure placements and possible route adjustments.

Energy Imbalance Markets

Energy imbalance on an electrical grid occurs when there is a difference between real-time demand, or load consumption, and generation that is prescheduled. Prior to the emergence of renewable energy technology on the grid, balancing occurred to correct operating limits within 30 minutes. Flows are often managed manually by system operators and typically bilaterally between power suppliers. The intermittent characteristics of wind and solar resources have raised concerns about how system operators will maintain balance between electric generation and demand in smaller than thirty minute increments. EIMs create a much shorter window market opportunity for balancing loads and resources. An EIM can aggregate the variability of resources across much larger footprints than current balancing authorities and across balancing authority areas. The sub hourly clearing, in some cases down to 5 minutes potentially provides economic advantage to participants in the market. EIMs propose to moderate, automate and effectively expand system-wide dispatch which can help with the variability and intermittency of renewable resources. EIMs boast to create significant reliability and renewable integration benefits by sharing resource reserves across much larger footprints.

CAISO – Energy Imbalance Market EIM

On November 1, 2014, the CAISO welcomed PacifiCorp into the western EIM. Nevada-based NV Energy began active participation in the EIM on December 1, 2015. Recently Arizona based Arizona Public Service and Washington based Puget Sound Energy entered into the real-time market on October 1, 2016. This voluntary market service is available to other grids in the West. Several Western utilities have committed to join the EIM. Portland General Electric has filed their intent to join in October of 2017. Idaho Power has announced their intent to join the western EIM in April of 2018. In December of 2016, Seattle City Light signed an agreement to join the market in April of 2019. And Mexico grid operator CENACE has formally agreed to explore participation of its Baja California Norte grid in the market.

Participants in the EIM expect to realize at least three benefits:


- ▶ Produce economic savings to customers through lower production costs
- ▶ Improve visibility and situational awareness for system operations in the Western Interconnection
- ▶ Improve integration of renewable resources

TEP contracted with the energy consulting firm E3 to perform a study to evaluate the economic benefits of TEP participating in the energy imbalance market. E3 evaluated the EIM benefits to TEP based on a set of study scenarios defined through discussions with TEP to reflect TEP system information, including loads, resources, and potential transmission constraints for access to markets for real-time transactions. The project analysis began in February 2016 and was completed in December, 2016.

Results of the study place approximately two-thirds of any estimated saving occurring 7% of the time from extreme real-time pricing. With the size of TEP's generation fleet combined with 40% of TEP's generation limited from EIM participation due to system restrictions, TEP estimates an annual benefit of approximately \$2.5 million. It is expected that this benefit will diminish over time.

TEP has started the process of determining the relevant costs associated with joining the CAISO EIM market as well as evaluating what other western EIM market options may be available, if any. It is estimated that the cost analysis will be completed sometime during the summer of 2017.


Map 15 - CAISO EIM Map

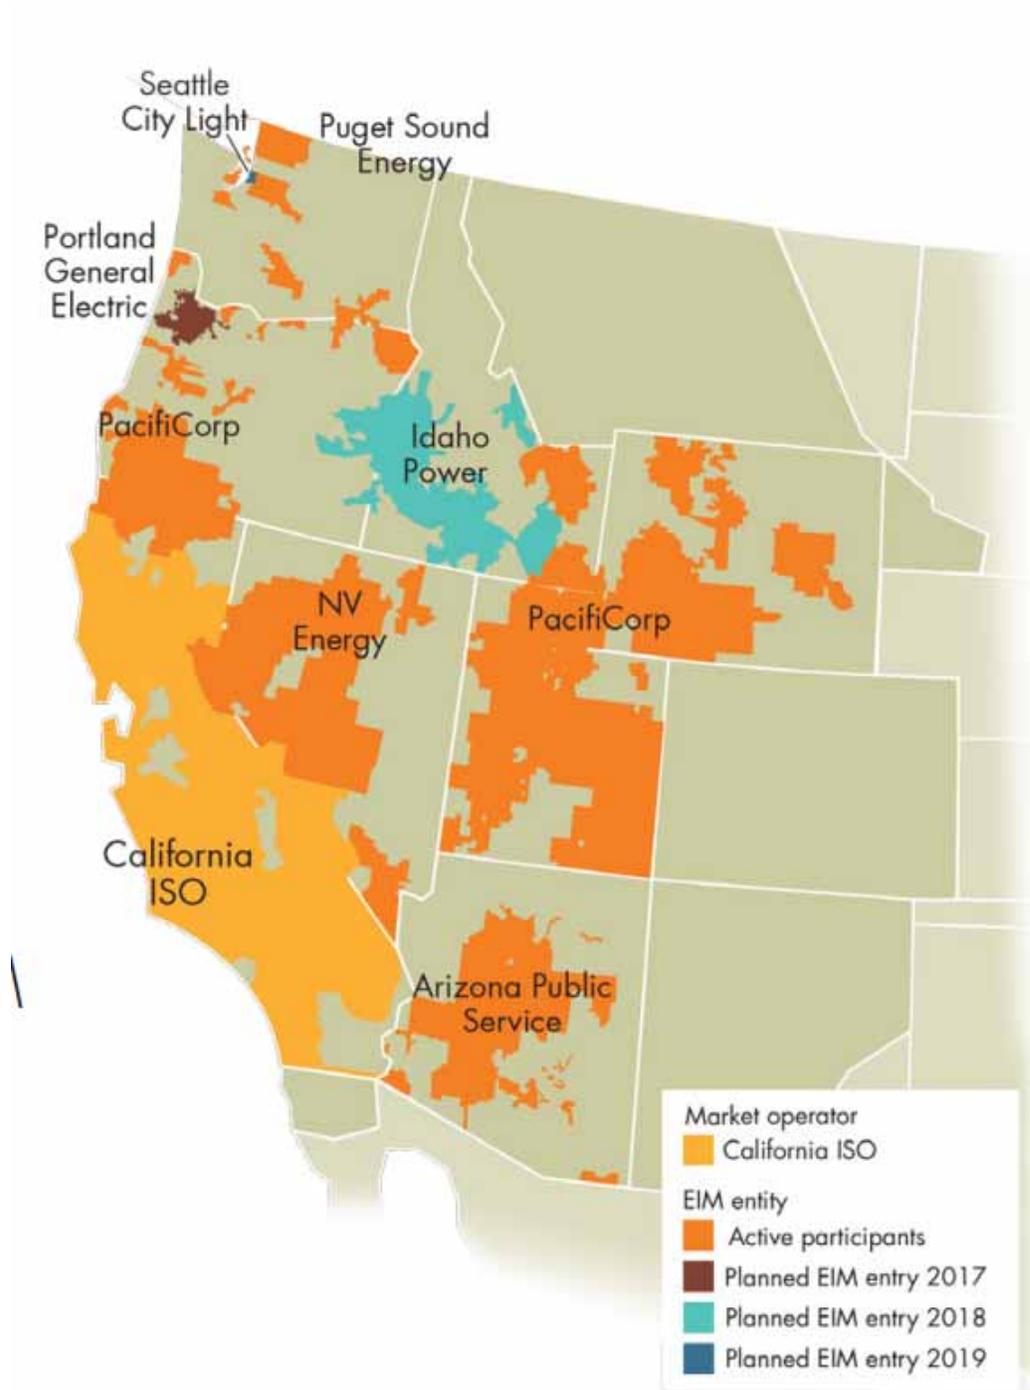

Regional Transmission Organizations (RTOs)

A group consisting of investor owned utilities, cooperative power providers and public power entities was formed to consider and analyze potential alternatives to joining the CAISO EIM. The group, known as the Southwest Regional EIM Alternatives Working Group (“Working Group”) was formed in order to evaluate the potential regional synergies and opportunities of joining or forming a regional market. Based on the recent expansion of the CAISO EIM, both in terms of participants and market opportunities, the Working Group recognized the need to evaluate the merits of the CAISO EIM and alternative market structures. The working group also recognized the need to evaluate the implications for existing bi-lateral markets and potential impacts to regional grid operations in the Southwest

Map 16 - WestConnect Subregional Planning Groups

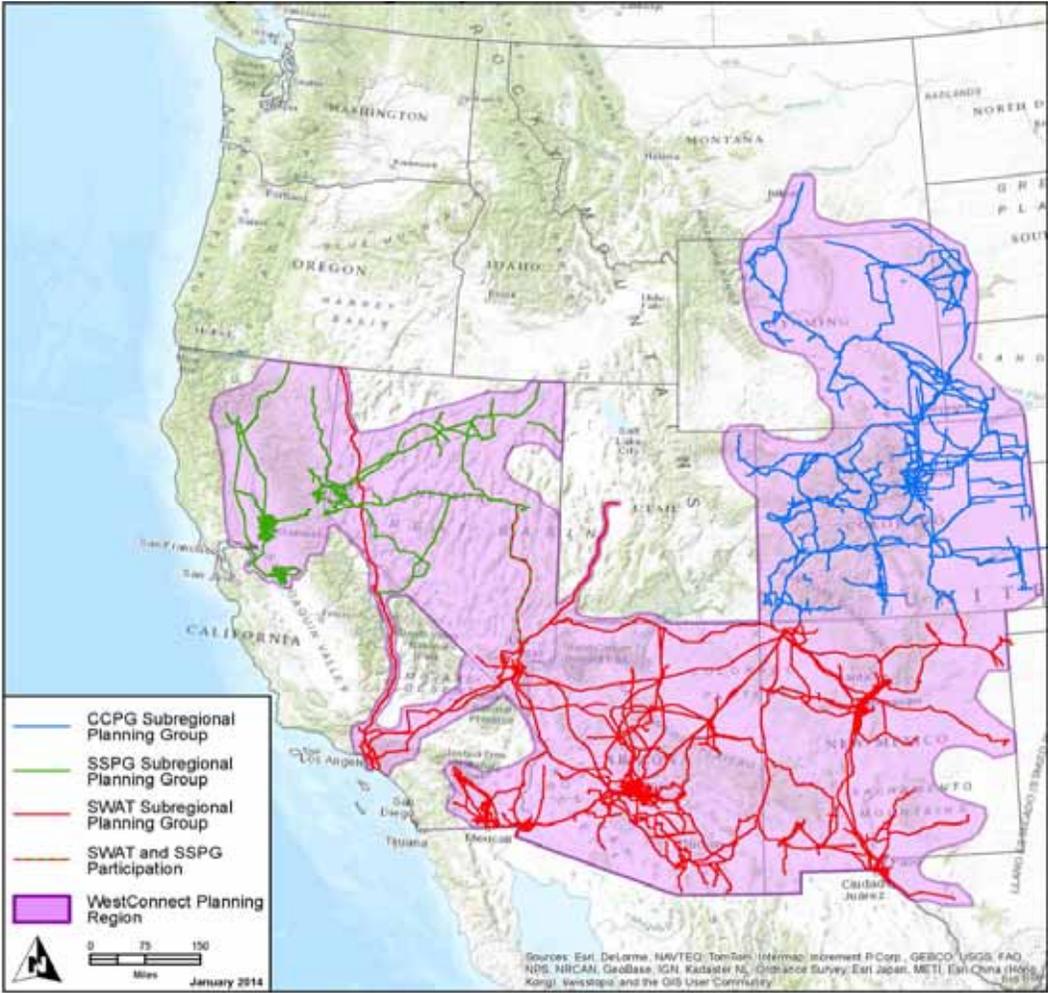

The Working Group includes AEPCO/ACES Energy Management; El Paso Electric Company (EPE); Public Service Company of New Mexico (PNM); SRP; Tri-State Generation and Transmission Association (“Tri-State”); TEP; UNSE; and WAPA. The objectives of the Working Group are as follows:

- ▶ Determine economic benefits of potential alternatives and weigh opportunities for market participation,
- ▶ Determine if the CAISO EIM and regulated markets in the Midwest and Mountain west offer certain economic benefits related to more efficient utilization of generating assets and transmission infrastructure,
- ▶ Evaluate operational benefits especially as they relate to renewable resource integration and system regulation,
- ▶ Establish if EIM/Regulated Markets and certain alternatives may offer reliability benefits related to the grid operations, and
- ▶ Consider governance structure and implications for resource control.

The Working Group evaluated the costs and benefits of various regional market options including 1) establishing a regional market by joining an existing market, 2) establishing its own regional market or 3) a hybrid of the two options (i.e. using resources of an existing market operator to establish and operate a nascent southwest market). The Working Group discussed various options with the CAISO, the Southwest Power Pool, and the Mountain West Transmission Group. At this point there is recognizable value to establishing a regional market as well as potential benefits. However, the cost of joining or establishing a regional market have yet to be determined and fully evaluated. TEP will continue to engage with market operators to determine the best path forward for its customers.

CHAPTER 9

TEP EXISTING RESOURCES

TEP's Existing Resource Portfolio


This section provides an overview of TEP's existing thermal generation, renewable generation, and transmission resources. For the thermal generation resources it provides details on each station's ownership structure, fuel supply, environmental controls, historical emissions, and a brief future outlook. For the renewable generation resources, it provides capacity and technology information as well as certain details on the construction of the facilities. Information on connections to the bulk electric system is provided in the transmission section. In addition, this chapter highlights its current use of the wholesale power market for firm capacity resources.

TEP's existing thermal resource capacity is 2,649 MW. In addition, the Company also relies on the wholesale market for firm capacity PPAs to meet its summer peak obligations. Table 18 below provides a summary of TEP's existing thermal resources.

Table 18 - TEP Existing Thermal Resources


Generating Station	Unit	Fuel Type	Net Nominal Capability MW	Commercial Operation Year	Operating Agent	TEP's Share %	TEP Planning Capacity
Springerville	1	Coal	387	1985	TEP	100	387
Springerville	2	Coal	390	1990	TEP	100	406
San Juan	1	Coal	340	1976	PNM	50	170
San Juan	2	Coal	340	1973	PNM	50	170
Navajo	1	Coal	750	1974	SRP	7.5	56
Navajo	2	Coal	750	1975	SRP	7.5	56
Navajo	3	Coal	750	1976	SRP	7.5	56
Four Corners	4	Coal	785	1969	APS	7	55
Four Corners	5	Coal	785	1970	APS	7	55
Sundt Steam	1-4	Gas	422	1958-1967	TEP	100	422
Luna Energy Facility	1-2	Gas	555	2006	PNM	33.3	184
Gila River	3	Gas	550	2003	TEP	75	413
Combustion Turbines		Gas/Oil	219	1972-2001	TEP	100	219
Total Planning Capacity							2,649

Map 17 - TEP System Map

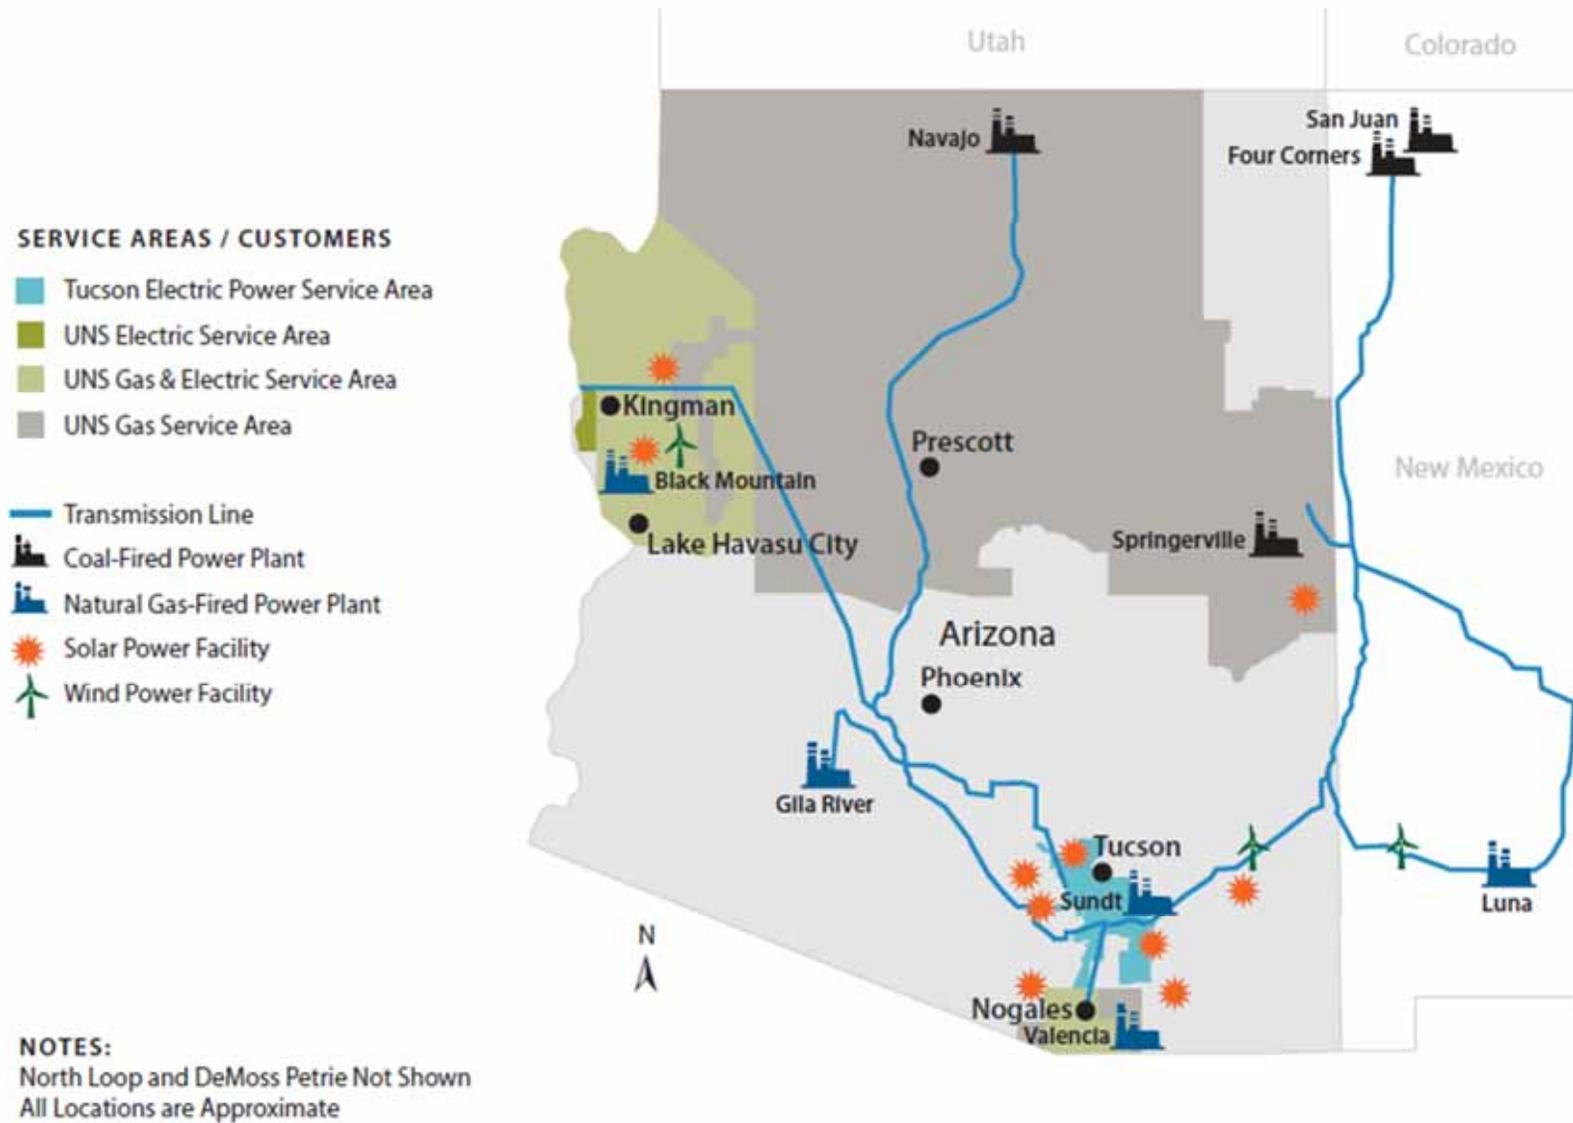

Coal Resources

Map 18 - Map of Coal Generation and Primary Fuel Sources

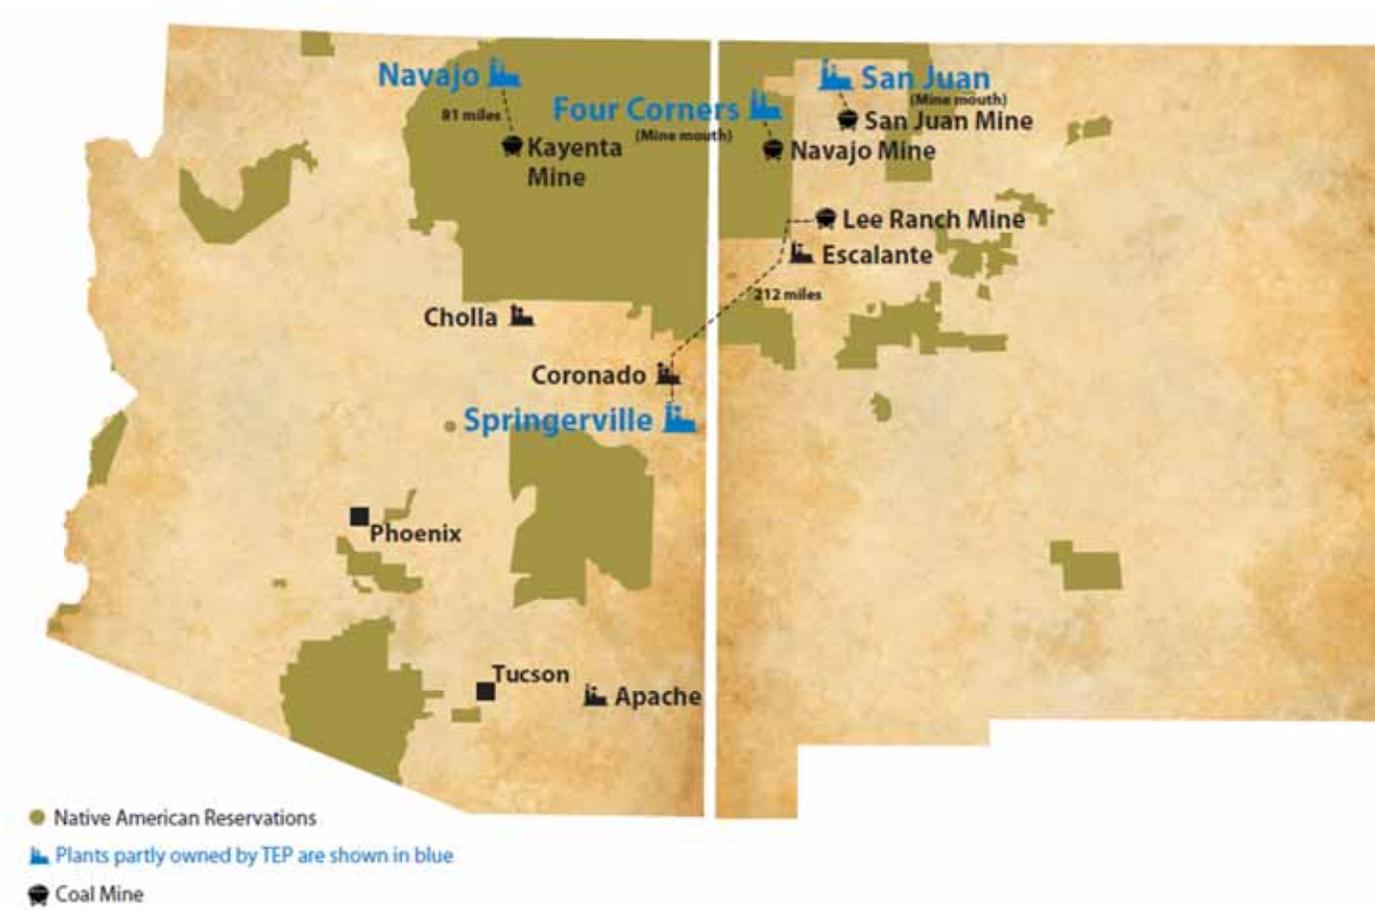


Springerville Generating Station

Springerville Generating Station

Springerville Generating Station (“Springerville”) is a four unit, base-load coal-fired steam electric generating station located 15 miles northeast of Springerville, Arizona. TEP operates all four units. Units 1 and 2 are owned by TEP. Tri-State Generation and Transmission owns Unit 3, and Salt River Project owns Unit 4.

Ownership Structure:

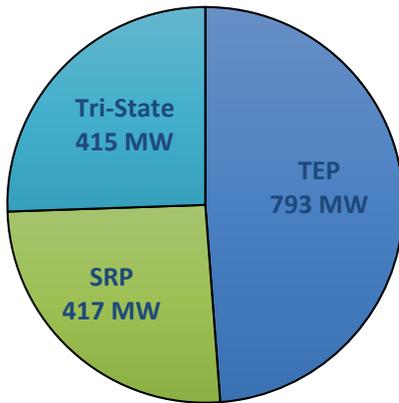


Pollution Controls:

Unit	SO ₂	NO _x	PM	Hg
1	SDA	LNB SOFA	FF	ACI, CaBR ₂
2	SDA	LNB SOFA	FF	ACI, CaBR ₂
3	SDA	SCR	FF	ACI, CaBR ₂
4	SDA	SCR	FF	ACI CaBR ₂

SDA – Spray Dry Absorber
 FF – Fabric Filter (Bag house)
 LNB SOFA – Low NO_x burners – Separated overfired air
 SCR – Selective catalytic reduction
 CaBR₂ – Calcium bromide (added to coal)
 ACI – Activated carbon injection

Units	Capacity (MW)	In-Service Date	Planned Retirement
Unit 1	387	1985	Not Planned
Unit 2	406	1990	Not Planned
Unit 3	415	2006	Not Planned
Unit 4	417	2009	Not Planned

Historical Emissions, TEP Share

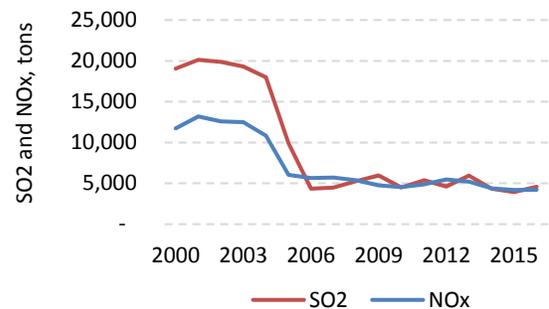

Participation Agreement:

Expires January 1, 2078

Coal Supply:

Agreement signed June 17, 2003 with Peabody Energy sourced from El Segundo / Lee Ranch, expires December 31, 2020.

Outlook:

Units 1 and 2 will be subject to “Reasonable Progress” provisions of the Regional Haze rule, which could mandate emission reductions in the 2025 to 2027 timeframe. Given current controls and recent reductions at other regional plants, TEP does not believe additional controls are likely.


San Juan Generating Station

San Juan Generating Station

San Juan Generating Station (“San Juan”) is a four unit, coal-fired base-load steam electric generating station located 17 miles west of Farmington, New Mexico. Public Service Company of New Mexico (PNM) is the operating agent for all four units. Units 1 and 2 are owned by TEP and PNM. Units 2 and 3 will be retired at the end of 2017. Remaining owners will include TEP, PNM, the City of Farmington New Mexico, the County of Los Alamos, New Mexico and the Utah Associated Municipal Power System (UAMPS)



Ownership Structure (after 2017):

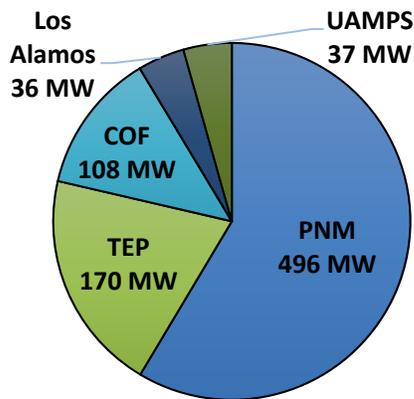

Pollution Controls:

Unit	SO ₂	NO _x	PM	Hg
1	FGD	SNCR	FF	ACI
2	FGD	LNB SOFA	FF	ACI
3	FGD	LNB SOFA	FF	ACI
4	FGD	SNCR	FF	ACI

FGD – Flue Gas Desulphurization-wet
 FF – Fabric Filter (Bag house)
 LNB SOFA – Low NO_x burners – Separated overfired air
 SNCR – Selective non-catalytic reduction
 ACI – Activated carbon injection

Units	Capacity (MW)	Entered Service	Planned Retirement
Unit 1	340	1976	2022 ⁽¹⁾
Unit 2	340	1973	December 2017
Unit 3	496	1979	December 2017
Unit 4	507	1982	Not planned

(1) TEP does not plan to extend its participation agreement for San Juan 1 beyond June 2022.


Participation Agreement:

Expires June 30, 2022

Coal Supply:

Agreement with Westmoreland Coal Company sourced from San Juan Mine is effective from January 2016 through June 2022.

Historical Emissions, TEP Share

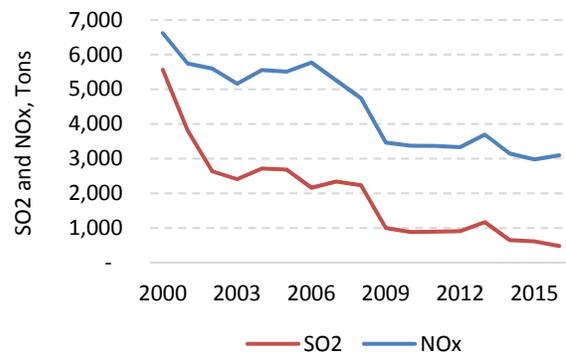

Outlook:


TEP intends to end its participation in San Juan at the end of June 2022, coinciding with the expiration of the plant participation agreement.

Navajo Generating Station

Navajo Generating Station

Navajo Generating Station (“Navajo”) is a three unit, coal-fired base-load steam electric generating station located five miles east of Page, Arizona. Salt River Project is the operating agent for all three units. Plant participants include TEP, SRP, US Bureau of Reclamation, Los Angeles Department of Water and Power, Arizona Public Service, and NV Energy.

Ownership Structure:

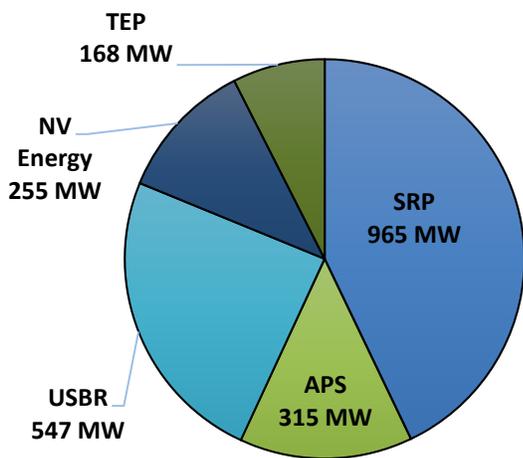

Units	Capacity (MW)	In-Service Date	Planned Retirement
Unit 1	750	1974	2019
Unit 2	750	1975	2019
Unit 3	750	1976	2019

Participation Agreement:

Extends to the expiration date of the plant’s lease with the Navajo Nation, which is December 20, 2019. In February 2017, TEP joined other Navajo owners in voting in to continue operations at the plant through December 2019 if a lease extension agreement can be reached with the Navajo Nation.

Coal Supply:


Agreement with Peabody Energy sourced from Kayenta Mine expires December 2019.

Pollution Controls:

Unit	SO ₂	NO _x	PM	Hg
1	FGD	LNB SOFA	ESP	ACI, CaBR ₂
2	FGD	LNB SOFA	ESP	ACI, CaBR ₂
3	FGD	LNB SOFA	ESP	ACI, CaBR ₂

FGD – Flue Gas Desulphurization-wet
 ESP – Electrostatic Precipitator
 LNB SOFA – Low NO_x burners – Separated overfired air
 ACI – Activated carbon injection
 CaBR₂ – Calcium bromide (added to coal)

Historical Emissions, TEP Share

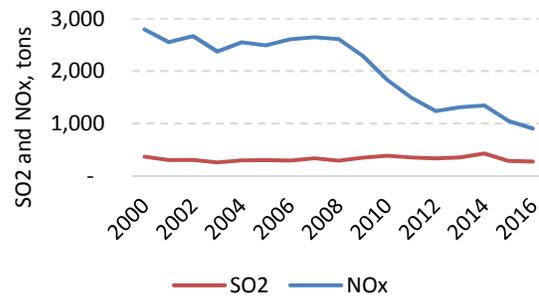

Outlook:

Final Regional Haze requirements for Navajo call for the retirement of one unit at the end of 2019, and the addition of Selective Catalytic Reduction on the remaining units by the end of 2030.


A lease extension would continue power production, maintain plant employment and preserve revenues for the Navajo Nation and Hopi Tribe, providing continued support for the area economy through 2019. Without the lease extension, the owners would be forced to cease power production in 2017 to allow for decommissioning work to be completed before the current lease expires. TEP has expressed its willingness to work with the Navajo Nation in search of long-term solutions for Navajo that balances the needs of the plant’s many stakeholders and serves the best interests of TEP’s customers.

Four Corners Power Plant

Four Corners Power Plant

Four Corners Power Plant (“Four Corners”) is a two unit, coal-fired baseload steam electric generating station located 18 miles west of Farmington, New Mexico. APS is the operating agent for both units 4 and 5. Plant participants include TEP, APS, SRP and PNM.

Ownership Structure:

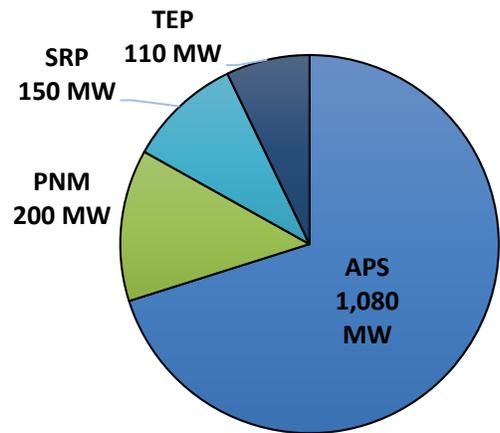

Units ⁽¹⁾	Capacity (MW)	In-Service Date	Planned Retirement
Unit 4	770	1969	2031
Unit 5	770	1970	2031

(1) APS shut down units 1-3 in December 2013 to comply with Regional Haze BART requirements.

Participation Agreement:

Co-tenancy agreement expires July 2041.

Coal Supply:

Agreement with Navajo Transitional Energy Company sourced from the Navajo Mine expires July 2031.



Pollution Controls:

Unit	SO ₂	NO _x	PM	Hg
4	FGD	SCR (1)	FF	WFGD, FF, CaBR ₂
5	FGD	SCR (1)	FF	WFGD, FF, CaBR ₂

(1) Required by end of July 2018 to comply with Regional Haze BART requirements


FGD – Flue gas desulfurization-wet

FF – Fabric Filter (Bag house)

SCR – Selective catalytic reduction

CaBR₂ – Calcium bromide (added to coal)

Historical Emissions, TEP Share

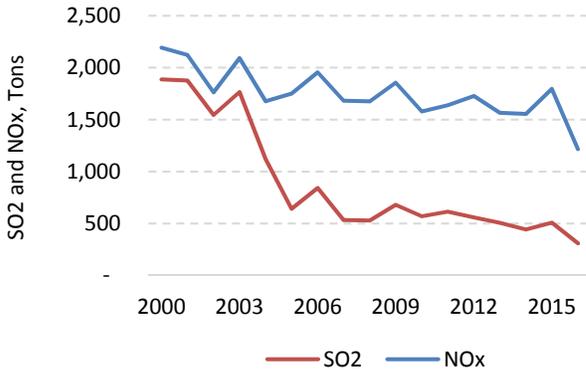

Outlook:

TEP anticipates that the plant will close after expiration of current coal supply contract in 2031. TEP will continue to evaluate the long-term viability of its coal operations at Four Corners in subsequent IRP planning cycles.

H. Wilson Sundt Generating Station

H. Wilson Sundt Generating Station

Sundt Generating Station (“Sundt”) is a four unit, peak and intermediate-load, steam electric generating station located in Tucson, Arizona. Units 1, 2, and 3 are gas or oil burning generating units and Unit 4 fires natural gas and landfill gas.

Ownership:

Sundt Generating Station is 100% owned and operated by TEP.

Units	Capacity (MW)	Entered Service	Planned Retirement
Unit 1	81	1958	2020
Unit 2	81	1960	2022
Unit 3	104	1962	2030
Unit 4	156	1967	Not Planned

Fuel Supply:

The primary fuel at Sundt Generating Station is natural gas. The station is supplied by gas purchased on the spot market and through gas hedging agreements that are consistent with TEP’s hedging policy. Natural gas is delivered through the Kinder Morgan natural gas pipeline which is located adjacent to the Sundt property.

Pollution Controls:

Unit	SO ₂	NO _x	PM	Hg
1	NA	LNB	NA	NA
2	NA	LNB	NA	NA
3	NA	LNB	NA	NA
4	NA	LNB SOFA	NA	NA

LNB SOFA – Low NO_x burners – Separated overfire air

NA – Not Applicable



Outlook:

In 2015, the depletion of the Company’s existing coal inventory at the Sundt Generation Station and low natural gas prices supported the permanent transition of Sundt Unit 4 from coal to natural gas two and one half years ahead of the December 2017 deadline in its agreement with the EPA. This transition to natural gas has reduced TEP’s near-term fuel supply costs for customers and marks the end of Sundt’s 27 years of operations on coal.


Luna Energy Facility

Luna Energy Facility

Luna Energy Facility (“Luna”) is a 555 MW natural gas-fired power plant consisting of a single 2 on 1 combined cycle power block. The power block utilizes two GE 7FA gas turbines, two heat recovery steam generators (HRSGs), and a GE D11 steam turbine. The facility is located three miles north of the town of Deming, New Mexico.

Ownership:

Luna ownership shares are divided by one-third PNM, one-third TEP and one-third Samchully Co. Ltd. PNM is the plant operator.

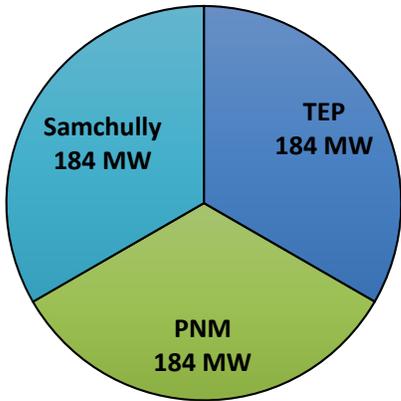

Pollution Controls:

Luna Energy Facility is a natural gas-fired combined cycle combustion turbine with dry LNB and SCR for NO_x control. As a greenfield site, a Prevention of Significant Deterioration (PSD) permit was obtained prior to construction. A PSD permit requires that Best Available Control Technology (BACT) be applied for control of SO₂ and NO_x, and the facility must comply with the Acid Rain program limits for SO₂ and NO_x.

Unit	SO ₂	NO _x	PM	Hg
1	NA	SCR	NA	NA
2	NA	SCR	NA	NA

SCR – Selective Catalytic Reduction
 NA – Not Applicable

Units	Entered Service	Planned Retirement
Power Block 1	2006	Not Planned

Outlook:

Luna’s fast ramping capabilities provide TEP with low-cost, intermediate load resource to support the integration of renewables.

Fuel Supply:

Each Luna participant manages its own gas supply. TEP purchases natural gas on the spot market and through hedging contracts that are consistent with the UNS Energy Hedging policy.


Gila River Generating Station

Gila River Generating Station

Gila River Generating Station (“Gila River”) is a 2200 MW four block, 2 on 1 natural gas-fired combined cycle electric generating station located three miles north of the town of Gila Bend, in Maricopa County, Arizona.

Ownership:

Units 1 and 2 are owned by Beal Bank, Unit 3 is owned 75% by TEP and 25% by UNSE. Unit 4 was purchased in 2016 by Salt River Project. Under that agreement, Salt River Project will take ownership of the unit in 2017.

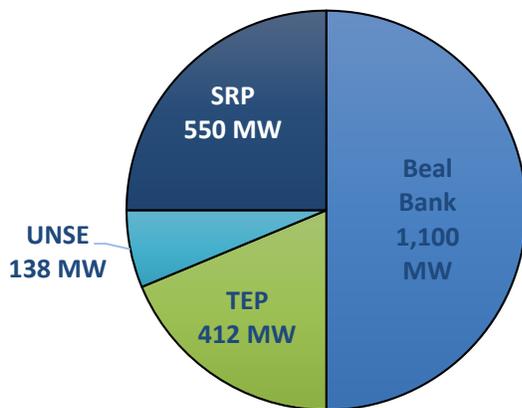

Pollution Controls:

Block	SO ₂	NO _x	PM	Hg
1	NA	SCR	NA	NA
2	NA	SCR	NA	NA
3	NA	SCR	NA	NA
4	NA	SCR	NA	NA

SCR – Selective Catalytic Reduction
 NA – Not Applicable

Outlook:

Low natural gas prices make Gila River Block 3 one of lowest cost generation assets for both TEP and UNSE. Gila River’s fast ramping capabilities, along with its real-time integration into TEP’s balancing authority, provide both TEP and UNS Electric with an ideal resource to support the integration of future renewables.

Units	Capacity (MW)	Entered Service	Planned Retirement
Power Block 1	550	2006	Not Planned
Power Block 2	550	2006	Not Planned
Power Block 3	550	2006	Not Planned
Power Block 4	550	2006	Not Planned

Fuel Supply:

Each Gila River participant manages its own gas supply. TEP and UNSE purchases natural gas on the spot market and through hedging contracts that are consistent with the UNS Energy Hedging policy.

Combustion Turbines

Combustion Turbines

The Company has 219 MW of gas or oil fired combustion turbines for peaking capacity. This capacity is comprised of 6 units at three locations, 50 MW split between two units at Sundt, 94 MW split between four units at North Loop, and one 75 MW unit at DeMoss Petrie. All locations are in or around Tucson and are all operated from the Sundt Station.

Ownership:

The combustion turbines are 100% owned by TEP.



North Loop Generating Station

Units	Capacity (MW)	Entered Service	Planned Retirement
Sundt CT Unit 1	25	1972	2027
Sundt CT Unit 2	25	1973	2027
DeMoss Petrie Unit 1	75	2001	Not Planned
North Loop Unit 1	25	1972	2027
North Loop Unit 2	25	1972	2027
North Loop Unit 3	23	1972	2027
North Loop Unit 4	21	2001	Not Planned

Fuel Supply:

The Company purchases natural gas for its combustion turbines on the spot market. Natural gas for the units at North Loop and DeMoss Petrie is delivered through Southwest Gas. Natural gas for the two Sundt turbines is delivered from TEP's Sundt connection to the Kinder Morgan pipeline.

Future Plan to Move to Cycling Operations

TEP is well on its way to achieving a 30% renewable target by 2030. In Chapter 3 of this document, we discuss the challenges characteristic of high solar PV penetration, as it pertains to the summer peak demand. Chapter 3 deals primarily with the topic of resource adequacy; the task of securing or acquiring resources to meet the summer peak demand. This chapter also presents a discussion of operations and intrahour dispatch. As TEP moves forward to achieving its renewable target, the issue of coal generation minimums and potential thermal unit cycling arises, especially on clear-sky, winter months.

Chart 38 - Typical Winter Load and Dispatch Operations

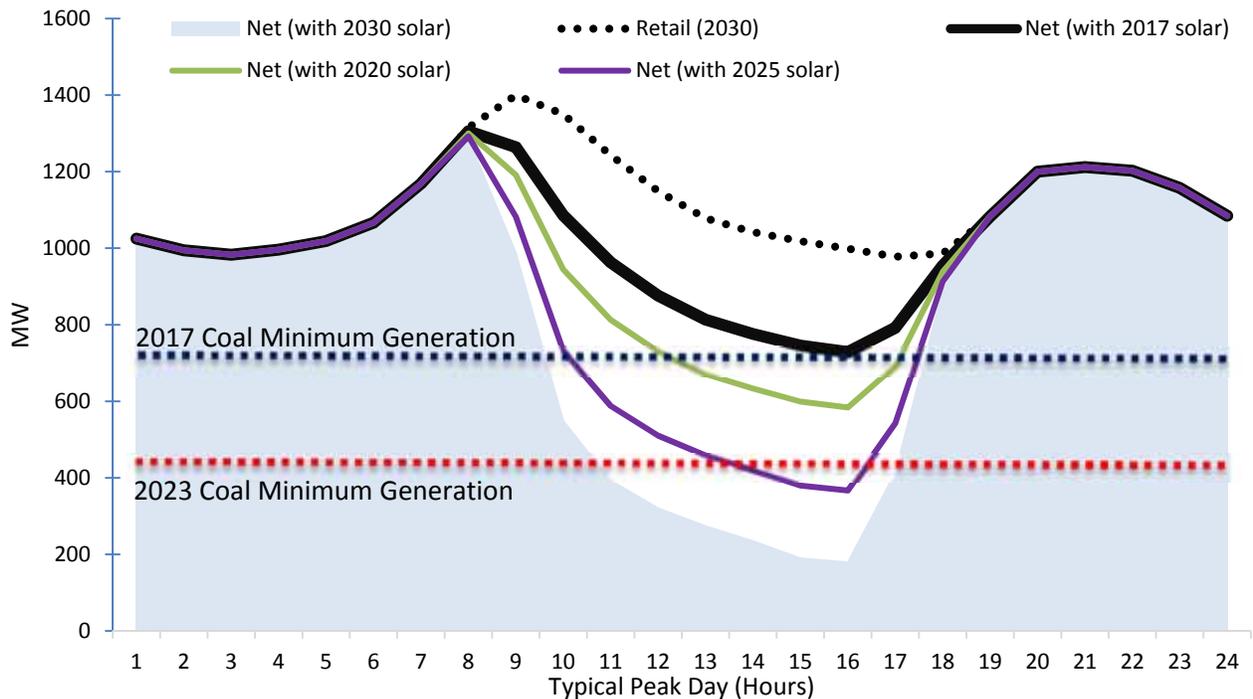


Chart 38 above illustrates a typical winter day, with a dual peak and a progressing ‘duck curve’ with a deeper belly through the years. The topmost shape (dotted) represents a typical 24-hour winter retail demand projected for 2030. The thick black line represents retail demand that is adjusted for solar PV (utility-scale and DG). We immediately observe that the belly of the ‘Net (with 2017 solar)’ curve is intersecting with the aggregate coal unit minimum generation (for 2017). This is not yet a problem as TEP makes system sales that keep total load above this minimum.

In this IRP, however, TEP assumes that it divests itself of the Navajo and San Juan coal plants, with Springerville and Four Corners remaining. The minimum coal generation for 2023 drops to approximately 400 MW and remains at that level until 2031. TEP will continue to push against its generator minimums with additional solar generation by 2030. TEP is beginning to explore solutions at its power plants for modifications to generating units that will allow for lower minimums and/or potential cycling capabilities. If a plant is capable of cycling during the day, larger measures such as seasonal shut-downs may be avoided.

Existing Renewable Resources

Over the last several years, TEP has constructed or entered into purchased PPAs for solar and wind resources to provide renewable energy for its service territory. This is part of TEP's commitment to meeting the Arizona RES requirement of serving 15% of its retail load with renewable energy by 2025. Table 19 below lists TEP's existing solar and wind renewable resources.

Table 19 – TEP's Existing Solar and Wind Renewable Resources

Project Name	Owned or PPA	Location	Operator	Completion/Estimated Date	Capacity MW _{dc}
Fixed Photovoltaic					
Springerville	Owned	Springerville, AZ	TEP	Dec-2010	6.41
Solon UASTP II	Owned	Tucson, AZ	TEP	Jan-2012	5
Gato Montes	PPA	Tucson, AZ	Astrosol	Jun-2012	6
Solon Prairie Fire	Owned	Tucson, AZ	TEP	Oct-2012	5
TEP Roof tops	Owned	Tucson, AZ	TEP	Dec-2012	0.55
Ft Huachuca I	Owned	Sierra Vista, AZ	TEP	Dec-2014	17.2
Ft Huachuca II	Owned	Sierra Vista, AZ	TEP	Jan-2017	5
Single-Axis Tracking Photovoltaic					
Solon UASTP I	Owned	Tucson, AZ	TEP	Dec-2010	1.6
E.ON UASTP	Owned	Tucson, AZ	TEP	Dec-2010	6.6
FRV Picture Rocks	PPA	Tucson, AZ	Macquire	Oct-2012	25
NRG Solar Avra Valley	PPA	Tucson, AZ	First Solar	Oct-2012	34.41
E.ON Valencia	PPA	Tucson, AZ	Areva	Jul-2013	13.2
Avalon Solar I	PPA	Sahuarita, AZ	Avalon	Dec-2014	35
Red Horse Solar	PPA	Willcox, AZ	Torch	Sep-2015	51.25
Avalon Solar II	PPA	Sahuarita, AZ	Avalon	Feb-2016	21.53
Cogenera	PPA	Tucson, AZ	SunPower	Dec-2015	1.38
Concentrated Photovoltaic					
Amonix UASTP II	PPA	Tucson, AZ	Amonix	Apr-2011	2
White Mountain	Owned	Springerville, AZ	TEP	Dec-2014	10
Concentrated Solar Power					
Areva Solar	Owned	Tucson, AZ	TEP	Dec-2014	5
Wind					
Macho Springs	PPA	Deming, NM	Element Power	Nov-2011	50.4
Red Horse Wind	PPA	Willcox, AZ	Torch	Sep-2015	30

Notes: PPA – Purchased Power Agreement - Energy is purchased from a third party provider

Fixed PV – Fixed Photovoltaic – Stationary Solar Panel Technology

SAT PV – Single Axis Tracking Photovoltaic

CPV – Concentrated Photovoltaic

Not listed is the Sundt's Landfill Gas project. Its capacity is estimates at 4 MW, representative of capacity that would have been utilized by Sundt Unit 4 if burning conventional natural gas

Existing Fixed Axis Solar PV Projects

Springerville Solar

TEP currently has 6.4 MWdc of solar at the Springerville site. The solar project is a fixed PV facility located on the property of the Springerville Generating Station, 12 miles north of Springerville, Arizona. TEP expanded its 4.6 MW solar facility in Springerville at the end of 2010 by adding an additional 1.8 MW solar field adjacent to the current site. The combined systems generate enough electricity to power about 1,350 homes.

Picture 2 - Springerville Solar



The system produces the most power capacity during the cooler months of the year when the sun is near latitude angle. The system operates as an unmanned site and is monitored continuously via an Internet based communications channel. The Springerville location has room for expansion. Technologies of various types for any future expansion are being considered, including Fixed Tilt PV and SAT PV. TEP will continue to evaluate these technologies and their relative performance over time to aid in future design considerations.

Solon / TEP UASTP II

SOLON II is a 5 MWdc fixed PV system designed and built by SOLON Corporation, and installed at University of Arizona Science and Technology Park (UASTP). The fixed tilt array sits on 34 acres and is powered by twenty-one thousand high efficiency modules.

Picture 3 - Solon II Solar



Gato Montes

Gato Montes is a 6 MWdc PV system designed and built by Astroenergy, and installed at the UASTP. Duke Energy now owns the Gato Montes site. The solar PV thin film, amorphous silicon technology used in this project is a first in the Duke Energy Renewables Fleet. This technology makes the solar modules extremely thin compared to other polycrystalline modules. It began operation in December 2012 and consist of over 48,000 panels which produces enough energy to power over 1,200 homes. Duke Energy sells its output to TEP through a 20-year PPA.

Picture 4 - Gato Montes Solar



Solon Prairie Fire

Prairie Fire is a 5 MWdc solar facility located in Pima County off Valencia Road east of Kolb Road in Tucson. The PV technology used is a crystalline fixed system module. The plant consists of 17,604 panels. Prairie Fire began providing power to TEP customers in late December 2012. TEP owns and operates this system, and will continue to manage operations, monitoring and maintenance.

Picture 5 - Solon Prairie Fire Solar



Ft. Huachuca – Phase I

Fort Huachuca Phase I is owned by TEP. Phase I is a 17.2 MWdc fixed PV system installed at the Ft. Huachuca Army base in Sierra Vista, Arizona. The fixed tilt array is sited on 300 acres and is powered by 57,600 high efficiency modules manufactured by BYD Company Limited. This project began providing power in December of 2014 and is the largest single site owned by TEP.

Picture 6 - Ft. Huachuca Phase I



Ft. Huachuca Phase-II

Phase II is a 5 MWdc fixed PV system powered by 46,480 Frist Solar 107.5 Watt modules. Phase II was commissioned in January of 2017 bringing Fort Huachuca’s total solar plant capacity to 22.6 MWdc.

Picture 7 - Ft. Huachuca Phase II



Existing Single Axis Tracking Projects

Cogenera

Cogenera is a 1.38 MWdc SAT system that uses the Cogenera proprietary Dense Cell Interconnect technology of 72 cell solar modules, which can deliver 15% more power than conventional solar modules covering the same area. The Cogenera is installed at the UASTP and is owned by Washington Gas and Electric.

Picture 8 - Cogenera DCI Technology



Solon UASTP I

Bringing solar power to Tucson residents, SOLON Corporation designed and installed this turnkey, 1.6 MW single-axis tracking system in 2010 for TEP's Bright Tucson Community Solar Program at the UASTP.

Picture 9 - Solon UATSP I Solar



E.ON UASTP

This 6.6 MW single-axis tracking plant is located in the Solar Zone at the UASTP. The project represents E.ON’s first solar project in the U.S. The project consists of over 23,000 crystalline PV modules installed on a single-axis tracker, situated on 37-acres. TEP purchases power generated at the plant through a 20-year PPA.

Picture 10 - EON UATSP Solar



Picture Rocks

This 25 MWdc single-axis tracking system is located on a 305-acre site owned by Tucson Water just west of Tucson. The project deploys over 89,000 poly-crystalline modules which are mounted on horizontal-axis trackers that rotate with the sun’s position in order to optimize electricity production.

Picture 11 - Picture Rocks Solar



E.ON Valencia

The 13.2 MWdc EON Valencia project is located near Valencia road and the I-10 freeway in Tucson, Arizona. E.ON owns this SAT system that utilizes more than 47,500 poly-crystalline modules. E.ON sells its output to TEP through a 20-year PPA.

Picture 12 - EON Valencia Solar



Avalon Solar I and II

Avalon Solar I and Avalon Solar II are adjacently located near the Asarco LLC Mission Mine 12 miles south of Tucson, Arizona and both are single axis tracking PV system. Avalon I is a 35 MW plant and Avalon II is a 21.5 MW plant. The plants use similar single-axis-tracking technology with Avalon I deploying over 116,000 polycrystalline solar modules and Avalon II over 71,000. Combined, the plants produce just under a 100 GWh of energy or enough energy to power 12,000 homes. Both plants were developed by Idaho based Clenera, LLC and constructed by Swinerton Renewable Energy.

Picture 13 - Avalon Solar I



Avalon Solar I was commissioned in December of 2014 and was sold to Coronal Energy. Avalon Solar II was commissioned in March of 2016, and Clenera retained ownership. TEP will buy power from these project under a 20-year PPA.

Picture 14 - Avalon Solar II



Red Horse Solar II

At this unique renewable energy project in Wilcox, Arizona, a 51.3 MW PV solar array is complemented by a 30 MW wind farm. Solar and wind components are fairly close together, with the wind turbines on a mountain ridge next to the solar field (for more information on the wind farm please see the Wind Assets section below). Red Horse II deploys over 170,000 polycrystalline solar modules mounted on a single-axis-tracker to maximize production. The project was developed by DE Shaw and TEP purchases electricity generated from the project through a PPA.

Picture 15 - Red Horse II



NRG Solar

The 34.4 MWdc NRG Solar project is a SAT PV system located on 320 acres on the Lupari Farm in Avra Valley, Arizona about 20 miles northwest of Tucson. The facility will produce clean, renewable electricity that will be sold to TEP under a 20-year PPA. At full capacity, the Avra Valley Solar Project will generate enough power to supply approximately 7,300 homes.

Picture 16 - NRG Solar



Existing Concentrating PV Projects

Amonix UASTP II

Amonix UASTP II is a 2 MWdc CPV system designed and built by Amonix, Inc., and installed at the UASTP. The project consists of 12 acres lined with 34 dual-axis trackers that reach up to 50 feet off the ground on pedestals that track the sun horizontally and vertically. Amonix will sell its output to TEP through a 20-year PPA.

Picture 17 - Amonix Concentrating PV System



White Mountain

White Mountain Solar, also located at the Springerville site, is a combination of Single Axis Tracking CPV and fixed tilt PV. The 10 MW plant consists of two types of technology. An innovative 7.3 MW low-concentrated PV single-axis tracking system uses multiple mirrors to reflect and concentrate sunlight onto a row of PV cells. Produced by SunPower, this is the third array of its kind in use in the United States. The second system includes 2.83 MWs of SunPower's T5 rooftop panels mounted on a specialized rack and angled to maximize production.

Picture 18 - SunPower T5 Technology



Picture 19 - SunPower C7 Technology



Existing Concentrating Solar Power Projects

Areva Solar

Areva Solar is TEP's first use of solar thermal technology to augment existing steam generation at the Sundt Generating Station. Named the Sundt Solar Boost Project, the project is a 5 MW equivalent renewable resource. Integrated with the existing Sundt Unit 4, the Areva addition is expected to boost peak capacity of the unit by 5 MW.

Areva's Compact Linear Fresnel Reflector technology uses mirrors to concentrate sunlight to directly create steam power. Rather than using trough- or dish-shaped mirrors common to other concentrating solar systems, Areva's technology uses a system of nearly flat mirrors, arranged in louver like arrays and motorized to track the sun, to heat up water passing overhead through a linear absorber. The Areva system also is designed to heat water directly, compared with other systems that generate steam indirectly with heat-transfer fluids such as oil or molten salt.

Picture 20 - Areva Solar – Sundt Generating Station



Existing Wind Resources

Macho Springs

Macho Springs Wind Farm, located in Luna County, New Mexico commenced operation in November 2011. The wind farm is located approximately 20 miles northeast of Deming, NM, and is owned by Capital Power. The 50 MW wind farm, consisting of 28 Vestas V100-1.8 MW wind turbines, will generate enough clean energy to provide electricity for more than 20,000 homes.

The project is situated on approximately 1,900 acres of privately owned land. Each of the 28 turbines is installed on an 80-meter (264 feet) tower, and has a rotor diameter of 100-meters (328 feet). The energy output from the project is contracted to TEP through a long term PPA. The project's output is delivered via El Paso Electric's existing transmission line that runs through the project area.

Picture 21 – Macho Springs Wind Farm in New Mexico (50 MW Project)



Red Horse 2 Wind Project

The Red Horse Wind project is a 30-megawatt wind farm including fifteen 2 MW wind turbines sited on 220 acres. Each turbine stands more than 450 feet high and is owned by Red Horse 2 LLC which was formed by Torch Renewables Energy. The project, located at Allen Flat, about 20 miles west of Wilcox, Arizona, achieved commercial operation in August of 2015. TEP buys power from this project under a 20-year PPA.

Picture 22 - Red Horse 2 Wind Project



Existing Biomass Projects

Sundt Biogas

TEP uses methane gas from the Los Reales Landfill in Tucson and pipes it 3.5 miles to TEP's Sundt Generating Station to co-fire with pipeline natural gas in the Unit 4 boiler. Methane gas is a byproduct of decay in landfills, and it has a Global Warming Potential that is 22 times more than carbon dioxide.

Picture 23 - Los Reales Landfill



The Los Reales Landfill covers approximately 370 acres in Tucson, Arizona and is owned and operated by the city of Tucson's Department of Environmental Service.

TEP's Energy Storage Projects

The primary advantage of an Energy Storage System, in the context of a large utility, is often in its ability to very rapidly change power output levels, much faster than the proportional governor response rate of any conventional thermal generation system. This naturally leads to the usage cases of an ESS being centered on short term balancing-type activities. An additional strength is that operating costs of an ESS are generally fixed and independent of usage. In contrast, gas turbine systems have a limited number of start and stop cycles and therefore have an appreciable cost to activate, and they are not necessarily on line when needed.

In the spring of 2015, TEP issued a request for proposals for design and construction of a utility-scale energy storage system. TEP sought a project partner to build and own a 10 MW storage facility under a 10-year agreement. TEP was looking for a cost-effective, proven energy storage system that would help integrate renewable energy into its electric grid.

Figure 37 – Lithium Ion Battery Storage Plant




The aggressive nature of the bidding companies far exceeded expectations. In its solicitation TEP received a total of 21 bids; 20 bids for battery technology and one bid for flywheel technology. Within the battery category, there were seven different battery types proposed. Ultimately, TEP was able to select two winning bids. One including a 10 MW, Lithium Nickel-Manganese-Cobalt battery; and a separate one including a 10 MW, Lithium Titanate battery together with a 2 MW solar facility. With these projects, TEP will be able to assess the operational impacts of two of the predominant Lithium technologies available today. Both systems were commissioned during the early months of 2017.

Distributed Generation Resources

Distributed Generation resources are small-scale renewable resources sited on customer premises. The Renewable Energy Standard requires that a portion of renewable energy requirements be obtained from residential and commercial DG systems. The required DG percentage in the Arizona RES is 30% of the total renewable energy requirement.

By the end of 2016, TEP had approximately 190 MW of rooftop solar PV. DG is expected to supply at least 342 GWh of energy in 2017. Only a very small portion of this generation is attributable to the TEP-owned rooftop solar program that was initiated in 2015.

Map 19 - TEP's Distributed Solar Resources Sites

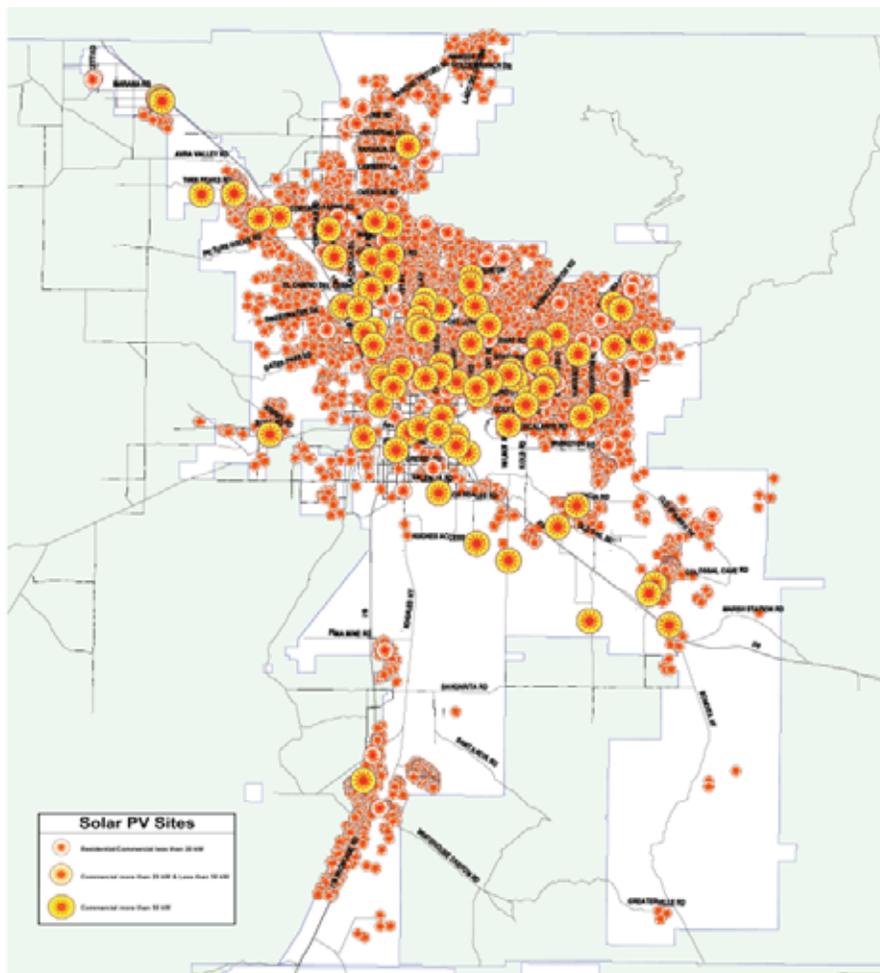

Davis Monthan Air Force Base Distributed Generation Project

The February 2014 completion of a 16 MW solar addition at Davis Monthan Air Force Base (DM) has expanded the total solar resources for the base to 21 MWs making DM the site of the Department of Defense’s largest solar facility. The 2014 addition is comprised of over 57,000 fixed tilt panels on 170 acres. Owned by SunEdison, it is contracted to supply the Air Force base with power over the next 25 years for an expected taxpayer savings of \$ 500,000 per year.

Picture 24 – Davis Monthan Air Force Base Distributed Generation Project



Transmission


Overview

Transmission resources are a key element in TEP’s resource portfolio. Adequate transmission capacity must exist to meet TEP’s existing and future load obligations. TEP’s resource planning and transmission planning groups coordinate their planning efforts to ensure consistency in development of its long-term planning strategy. On a statewide basis, TEP participates in the ACC’s BTA which produces a written decision by the ACC regarding the adequacy of the existing and planned transmission facilities in Arizona to meet the present and future energy needs of Arizona in a reliable manner.

TEP’s Existing Transmission Resources

TEP’s existing transmission system was constructed over several decades to support the delivery of the base load coal generation resources in northern Arizona and New Mexico. Today, TEP owns approximately 473 miles of 46kV lines, 405 miles of 138 kV lines, and is owner and part owner of 1,110 miles of 345 kV lines and 655 miles of 500 kV lines. As shown in Map 20 the Tucson service territory area is interconnected to the Western Interconnection Bulk Electric System (BES) via 345 kV interconnections at the South Loop and Vail substations, and a 500 kV interconnection at the Tortolita substation. These three substations interconnect and deliver energy from the EHV transmission network to the local TEP 138 kV system.

Map 20 - TEP’s Existing Transmission Resources (includes rights on other systems)

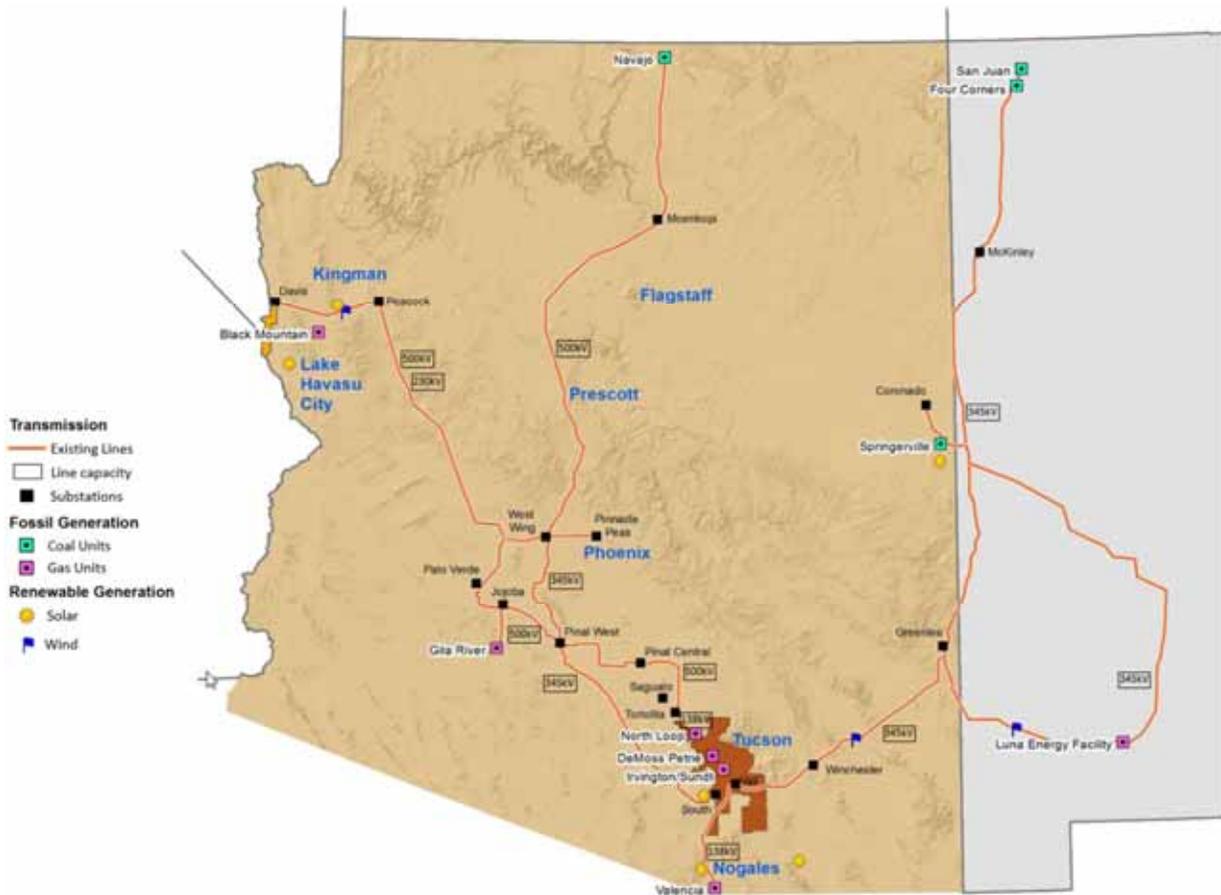


Pinal Central to Tortolita 500 kV Transmission Upgrade



In November 2015, TEP energized its newest 500 kV transmission expansion project that interconnects at the 500 kV Pinal Central Switchyard. The Pinal Central to Tortolita 500 kV line adds a second extra high voltage (EHV) transmission connection between Tucson and the Palo Verde wholesale power market. This line ties in at the existing Salt River Project Southeast Valley transmission project that extends from Palo Verde to Pinal Central into Tortolita. This new transmission interconnection improves TEP’s access to a wide range of renewable and wholesale market resources located in the Palo Verde area while improving TEP’s system reliability.

Map 21 - Pinal Central - Tortolita 500kV Project

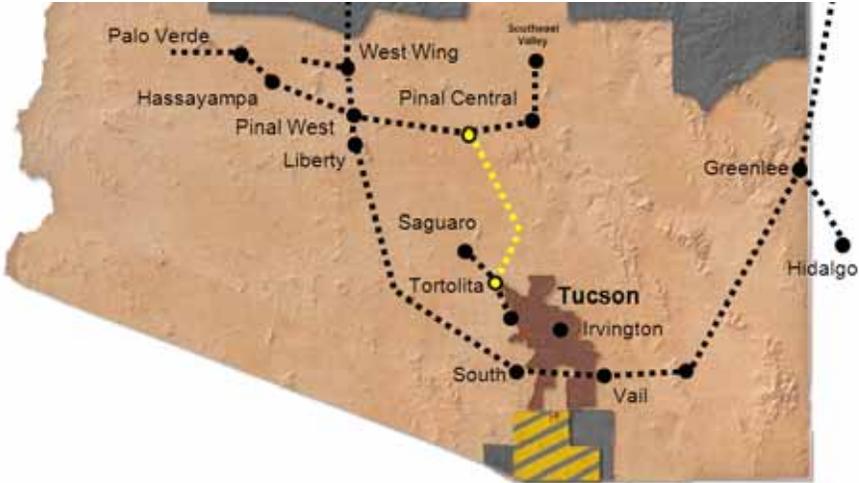

Pinal West to South Upgrade Project

The Pinal West to South 345kV line is undergoing equipment replacement that will increase the thermal rating of the line. This is expected to increase the Total Transfer Capability of the line, which will allow TEP to schedule more power to the TEP load pocket from remote resources.

CHAPTER 10**FUTURE RESOURCE REQUIREMENTS****Future Energy Efficiency Assumptions**

TEP's EE programs will continue to comply with the Arizona EE Standard that targets a cumulative energy savings of 22 % by 2020. For this IRP, EE is modeled as a resource and is dispatched to meet load based on the EE shape described in Chapter 5. The energy savings reflected in our reference case forecast through 2020, represent an estimate of the energy savings needed to meet the standard, excluding savings associated with program credits³⁷. From 2021 through the end of the planning period, the estimated annual savings are based on an assessment of "achievable potential" in energy savings from EE programs conducted by EPRI³⁸. This "achievable potential" represents "an estimate of savings attainable through actions that encourage adoption of energy efficient technologies, taking into consideration technical, economic, and market constraints³⁹." Market constraints include both market acceptance factors such as transactional, informational, behavioral, and financial barriers, as well as program implementation factors which account for recent utility experience with EE programs⁴⁰.

TEP will pursue a range of cost-effective and industry-proven programs to meet future EE targets. TEP's proposed EE portfolio, in addition to maintaining compliance with the Arizona EE Standard, is also expected to be compliant ready under the provisions of the CPP. Given the uncertainty around the status of the CPP, TEP notes that EE is an effective compliance tool under virtually any policy aimed at reducing carbon emissions. Under a mass-based approach, EE aids in compliance by displacing actual fossil generation and the associated emissions. Under a rate-based approach, similar to the CPP, EE measures that undergo appropriate, Evaluation, Measurement and Verification (EMV), can be used to reduce the emission rate of affected fossil-fired generators. By 2032, this offset to future retail load growth is expected to reduce TEP's annual energy requirements by approximately 1,894 GWh and reduce TEP's system peak demand by 318 MW.

³⁷ Arizona Administrative Code, R14-2-2404 C.- G.

³⁸ *U.S. Energy Efficiency Potential Through 2035*, Electric Power Research Institute, dated April 2014.
<http://www.epri.com/abstracts/Pages/ProductAbstract.aspx?ProductId=00000000001025477>

³⁹ *Ibid*, p. v

⁴⁰ *Ibid* p. 2-20


Future Renewable Energy Assumptions

In the Company's most recent general rate case proceeding, TEP committed to diversifying its generation resource portfolio with a goal of serving 30% of its retail load with cost-effective renewable resources. The state's renewable requirement remains at 15% by 2025, and the Company expects to achieve 15% by the end of 2020. As of the end of 2016, the Company has nearly 400 MW of combined utility scale renewable generation capacity on its system, and supplied approximately 10% of its retail sales with renewable resources. The Company anticipates adding approximately 800 MW of renewable energy capacity by 2030, based on current technology and cost projections, in order to achieve its' desired 30% renewable target.


TEP recently signed a 100 MW wind PPA with NextEra Energy Resources, scheduled for completion by early 2019. TEP is also evaluating responses from a 100 MW solar RFP, also scheduled for completion in early 2019. Immediately beyond these significant additions, TEP expects to focus on the introduction of large scale storage facilities and fast response thermal generation to facilitate the addition of the next tranche of large scale renewable systems.

TEP's 2017 Reference Case Plan – Portfolio Energy Mix


2017 Portfolio Energy Mix

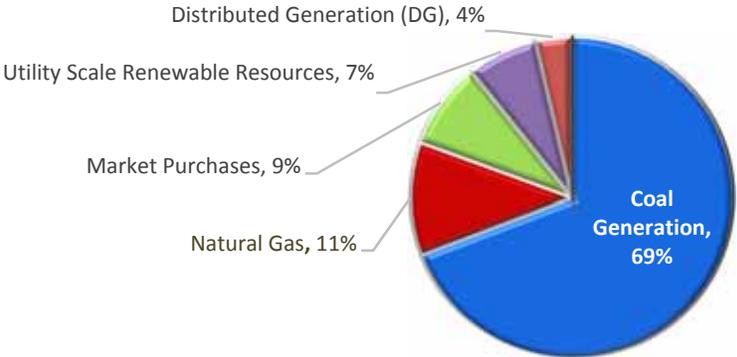

2023 Portfolio Energy Mix

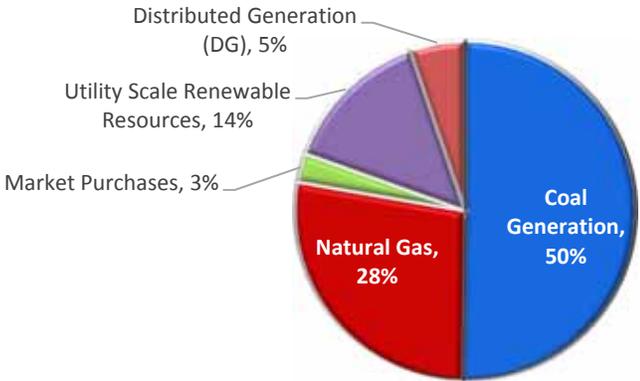

2032 Portfolio Energy Mix

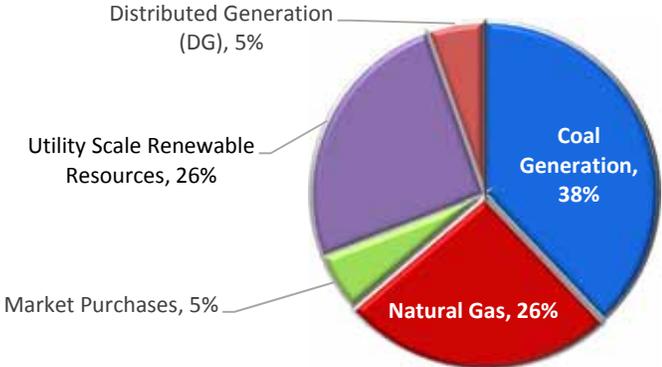

The portfolio energy charts shown above represents the energy resource mix to serve TEP’s retail customers. Wholesale market sales are excluded from these results. By 2030, TEP’s retail customers will be served from 30% renewables. This is based on a combination of utility-scale and distributed generation resources.

Technology Considerations

In order to achieve the Company's stated goals, the Company continues to evaluate on an on-going basis, the most cost-effective renewable energy options currently available. This evaluation includes the most current market costs of renewable technology such as wind and solar, system integration availability and associated technologies to facilitate greater renewable penetration, as well as existing and planned transmission availability for regions located outside the Company's service territory. As expected with the current technology cost declines, current tax incentive policies, and solar insolation values in southern Arizona, utility-scale PV solar is the least cost resource on an energy-only basis, followed closely by higher-capacity wind resources located in central eastern portions of Arizona and western region of New Mexico.

Although the Company expects to have a higher percentage of solar resources within its service territory, primarily due to favorable production curves, low costs, and lack of available transmission to import other resources, this will ultimately result in operational challenges as discussed above in Chapter 3, including the Company's ability to manage its own "duck curve". These integration issues, including the addition wind resources, will require new technologies to manage the variability of these resources. The Company sees this challenge as an opportunity to both explore and utilize newer, fast-acting storage technologies to mitigate system variability due to the intermittent nature of these resources.

Diversity of Resources

As the Company has previously discussed, the potential impact on grid operations due to increased renewable penetration is expected to dramatically alter the Company's traditional resource portfolio, requiring greater flexibility and newer fast-acting generation resources. In order to minimize the impact of variable generation resources and their impact on operations, the Company must maintain a mix of variable renewable generation resources. These technologies will focus on those technologies readily available to the Company with the capability to be delivered to the consumer.

This mix of technologies will primarily be large scale wind resources in eastern Arizona and western New Mexico that are able to utilize existing transmission facilities and capacity, including expected available capacity from planned plant retirements, and multiple solar resources. The solar resources will be a mix of fixed PV and tracking PV, in the scale of 25-100 MW, which can be more easily interconnected with the Company's sub-transmission and distribution systems. The Company has chosen not to pursue PV or solar technologies that have a high consumption of water, such as concentrating solar thermal.

Utility Scale Project Ownership

TEP has had a long-standing policy of utility investment in large scale solar resources. This policy is based on the concept of the utility owning and operating utility scale solar resources in order to provide a balance of contracted versus owned facilities, as well as provide greater operational flexibility by having the ability to regulate and curtail operations as necessary. Historically, the Company has strived for approximately 25% owned (solar) facilities and 75% contracted through PPA's. The Company believes this is an appropriate balance to maintain some system operational control while providing the industry an opportunity to support solar development in southern Arizona.

While the Company firmly believes it should maintain a percentage of renewable ownership, it also recognizes the challenges associated with its renewable energy development targets. As previously noted, significant integration of solar resources into the Company's generation portfolio will create a considerably more pronounced "TEP duck curve". Due to the significantly lower PPA prices associated with solar and wind, the concept of curtailable resources while ensuring the third party owner remains economically unharmed is in

many cases one of the least-cost options for mitigating the impacts of excessive generation during periods of high penetration.

Future Grid Balancing Resources

As described in Chapter 3, it is critical for TEP to maintain adequate resources that can balance load and generation, especially as increased use of renewable energy leads to greater intermittency of generation and greater ramping requirements of non-renewable energy resources. This section of the IRP describes the addition of new grid-balancing and load-leveling resources assumed in the Reference Case Plan.

Energy Storage

In addition to the 20 MW of battery ESS installed in 2017, the Reference Case Plan assumes the implementation of three battery ESSs: one each in the years 2019, 2021, and 2031. The systems in 2019 and 2021 would each be 50 MW with a storage capacity of 50 MWh. The system in 2031 would be 100 MW x 100 MWh.

The primary purpose of the 2019 and 2021 systems is to facilitate the integration of more renewable energy into TEP's resource mix. Specifically, the systems would provide ancillary power services such as frequency response and regulation and voltage support, which are more challenging for traditional power sources to maintain under the demands of a system with high levels of renewable energy penetration. The system in 2019 would correspond with the largest addition of renewable energy capacity to TEP's system over the planning period (180 MW). The system in 2021 would further support renewable energy integration (e.g., as more DG comes on line) while providing more time to gain experience with battery ESSs and for such systems to further decline in cost. Finally, these ESSs would provide energy capacity value. In the Reference Case Plan, it is assumed that half of their capacity (50 MW) would be available if necessary under peak demand.

By 2031, substantially more renewable energy is expected to be on line. Thus, the Reference Case Plan assumes another ESS (100 MW x 100 MWh) to be implemented by then. Again, the primary purpose would be to provide grid-balancing and load-leveling resources. It is assumed these resources would be provided throughout most of the year (e.g., when ramping requirements are high in the non-summer months), but that this system would provide primarily energy capacity services in the summer (100 MW).

Although the Company has had considerable discussion regarding the location of the initial storage facilities, and the appropriate voltage level at which to obtain the maximum system benefits, it was ultimately determined that they would interconnect at the distribution system level. There were advantages to siting the storage facilities inside company owned substations, as well as the R&D advantages of siting one project at the University of Arizona Science and Tech Park. Additionally, being the first of their technology within our system, jurisdictional siting and permitting policies had to be determined through close collaboration with the City of Tucson and Pima County.

In the future, the siting of larger scale storage facilities will depend on a number of circumstances, including:

- ▶ Primary purpose of facility (distribution or transmission level voltage support, frequency response, generation smoothing and ramping, etc.)
- ▶ Secondary and tertiary ancillary services available from facility relative to its location
- ▶ Engineering studies
- ▶ Size of facility
- ▶ Interconnection feasibility
- ▶ Company or third-party owned facility

Although a number of instability issues have been identified as a result of future wind and solar penetration on the grid, actual transmission and distribution system operations will determine the actual location and timing of any planned storage additions to the system.

The Company is closely following the technology advances in large scale energy storage, specifically as it relates to the development of large-scale (>10 MW), long duration (>4 hrs.), energy storage. The Company's first utility scale storage facilities have been lithium-ion based chemistry, and this chemistry is making significant advances towards longer-term, higher capacity energy storage. Additionally, the Company is tracking advancements that have been made in flow-based energy systems, particularly Vanadium, Iron, Zinc, and Redox Flow technologies. Also, TEP is closely monitoring the progress of pumped hydro storage projects in the West. Although these technologies are still on the high end of the cost curve, their potential to provide long term, high capacity energy storage with long life cycles holds significant promise for the utility industry.

Fast Response Thermal Generation

As renewable penetration increases, fast responding resources will be needed to smooth out the oft-occurring variability of solar and wind generators. Additionally, a certain level of thermal resources with mechanical inertia will have to be maintained in order to help balance the electric system. RICEs are fast to respond to renewable variability but can also provide 100% ELCC during peak periods. The units are only degraded by run-time hours and can withstand multiple start-ups within a day. The units are also capable of running at 30% of their designed capacity. A 10 MW unit can idle down to 3 MWs and spin or stand ready to react to disturbances or renewable generation reductions.

In its fleet of generating resources, TEP has targeted two aging gas-steam generating units for retirement at Sundt Generating Station. Units 1 and 2 are each 81 MW units that are increasingly requiring more O&M and capital expenditures. These 1960's vintage units have high heat rates and are often only run for summer reliability contingency mitigation. Sundt Units 1 & 2 are not well suited to respond or participate in mitigating renewable generator intermittency. TEP performed an internal study to determine the economic and operational benefits of replacing these units. The recommendation made is that Sundt Units 1 and 2 should be retired in 2020 and 2022 respectively and replaced in those years with 100 MWs of RICE.

The study showed that RICE bettered each Sundt unit by a LCOE difference of approximately \$26/MWh. The capital expended on RICE overcame the Sundt units because RICE is more efficient and it performs at higher capacity factors. As mentioned above, cycling RICE has no impact on O&M and the 3 to 5 minute start times are not equaled by any existing generator in the TEP fleet. The RICE units will equally provide summer peaking capability but more importantly, these fast, responsive and efficient units are a better fit with renewable energy. Reliability is increased as well because the probability of outages is spread across multiple units.

Demand Response

TEP currently implements a voluntary DLC program for larger commercial and industrial customers in TEP's service territory. During peak hours (late afternoon and evening) of the summer months, commercial and industrial load represents a total of approximately 22% of system demand. Controls for chillers, rooftop AC units, lighting, fans, and other end uses are modified to allow for curtailment of load, thus reducing power demand from customers at specified times. Participating customers voluntarily reduce their electricity consumption during times of peak electricity demand or high wholesale electricity prices (when alerted by TEP). Customers are compensated with incentives for their participation at negotiated levels that will vary depending on multiple factors including the size of the facility, amount of kW under load control, and the frequency with which the resource can be utilized.

The program has had slower growth than originally expected due to the small industrial based customer load in Tucson. TEP uses a third-party vendor to administer the DLC program and is targeting enrollment of enough customers by 2020 to reach 42 MW of summer peak demand reduction, available for up to 80 hours per year, with a typical load control event lasting 3-4 hours. For planning purposes, TEP assumes approximately 4% annual growth in DR capacity after 2020 resulting in 67 MW available in 2032 with 2% annual increase in fees needed to achieve that level of growth. These growth assumptions would likely require expanding DLC beyond the Commercial and Industrial sectors.

Comparing the cost of TEP's current DLC program to short-term capacity market prices, TEP does not anticipate that DR will be an economically feasible option for short-term capacity prior to 2022, and beyond that time, TEP does not project a significant need for short-term capacity. Therefore, TEP intends to shift toward designing DLC programs that are capable of cost-effectively addressing periods of significant ramping, anticipated with high penetration of renewable resources.

Future Transmission

Transmission resources are a key element in TEP's resource portfolio. Adequate transmission capacity must exist to meet TEP's existing and future load obligations. TEP's resource planning and transmission planning groups coordinate their planning efforts to ensure consistency in development of its long-term planning strategy. On a statewide basis, TEP participates in the ACC's BTA to develop a transmission plan that ensures that Arizona's transmission organizations are coordinated in their efforts to maintain system adequacy and reliability.

Ten-Year Transmission Plan

On an annual basis, TEP develops and submits to the Commission a ten year transmission plan for its EHV and local transmission networks. This plan reflects planned and conceptual projects on the EHV transmission network used to bring power from remote resources into the Tucson load pocket and the local 138kV local network used to deliver power to the local distribution substations. TEP's EHV and 138kV transmission system is planned to meet performance requirements of the NERC Transmission System Planning Performance Requirements (TPL-001-4) standard and the WECC Transmission System Planning Performance (TPL-001-WECC-CRT-3.1) criteria. This plan includes new or reconductored transmission projects, transformer capacity upgrades, and reactive power compensation facility additions at 115kV or above. This plan ensures that TEP has sufficient load serving capability and Total Transfer Capability to provide service to its customers under normal conditions and following outages as specified in the NERC standards and WECC criteria.

TEP's 2016 ten year transmission plan included the following:

- ▶ 1 planned EHV transmission line project
- ▶ 7 conceptual EHV transmission line projects
- ▶ 0 EHV planned or conceptual EHV reactive compensation projects
- ▶ 13 planned 138kV transmission line projects
- ▶ 5 conceptual 138kV transmission line projects
- ▶ 4 planned 138kV reactive compensation projects
- ▶ 0 conceptual 138kV reactive compensation projects


Transmission Substation Reconfiguration Projects

To improve system reliability and maintainability of the transmission system and meet new requirements of the NERC Planning Standards, TEP is converting four substations from a ring bus to a breaker-and-a-half configuration. The Greenlee (Phil Young) and South Loop 345kV substation conversions will take place in 2018. The Irvington and DeMoss Petrie 138kV conversions will take place in 2020 and 2021, respectively.

Conceptual Future Local Area 345 kV EHV Transmission Projects

The Irvington-Vail, Irvington-South Loop 345 kV projects are two conceptual projects that were analyzed as possible long term transmission scenarios to improve local area transmission capacity. These are two phase projects that are part of a larger EHV reach-in strategy to serve the growing load in Tucson without requiring EHV lines across the central metro area. In addition, these projects are coordinated with the potential build out of local generation resources at Sundt Generating Station. In Phase 1, a new 26 mile 345kV line would be constructed between the Irvington and South Loop Substations. Phase 2 of this project would complete a new 10 mile 345 kV line interconnecting the Irvington and Vail Substations. Phase 1 would be expected to precede Phase 2 by several years. New Phase 1 facilities would include a 345 kV termination at Vail and a 345/138 kV substation at Irvington.

Map 22 – Local Area Conceptual 345 kV EHV Projects

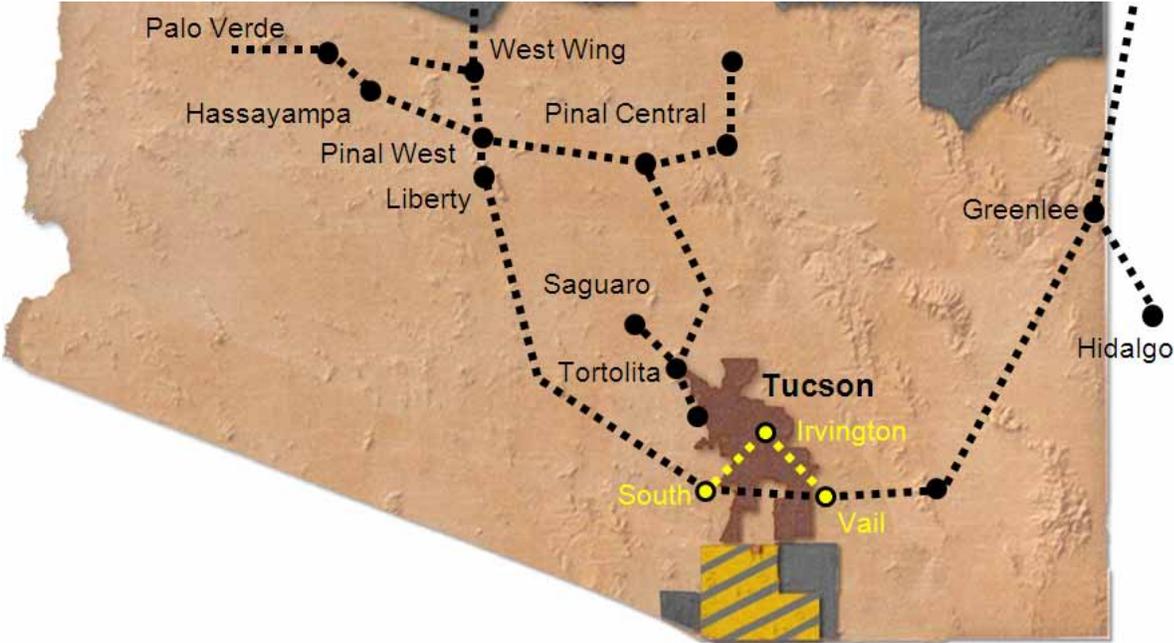

Transmission Resources Needed for New Generating Resources

Additional transmission resources will be needed for specific generation interconnections. For purposes of this resource plan, the resource planning group developed a set of transmission cost assumptions based on the list of potential generation resources. These generation resource options include the additional costs associated with any transmission improvements that would be required to connect the resources to the transmission system.

For example, some of the larger base load resource options are expected to be constructed far from the TEP service territory and would require significant transmission infrastructure improvements with the construction of the generation facility. Smaller generation facilities such as gas turbines would likely be constructed within the Tucson metro area and would require a much smaller interconnection investment. Finally, in addition to construction capital, the resource plan also includes the costs of the on-going O&M that is required to maintain these transmission facilities.

CHAPTER 11**ALTERNATIVE FUTURE SCENARIOS AND FORECAST SENSITIVITIES**

Modeling the performance of a resource portfolio involves making assumptions about future conditions such as economic growth, fuel and wholesale power markets, regulatory conditions (e.g. emission prices), and the pace of technological development. TEP seeks to identify a reference case portfolio that provides solid performance under the assumptions selected while maintaining optionality to make course adjustments in response to actual emerging conditions. Due to the inherent uncertainty about these future assumptions, it is necessary to test the performance of each resource portfolio against a range of future conditions to better assess whether a portfolio is robust under varying conditions. Because certain market conditions do not move independently of each other, alternative future scenarios must be identified that capture a range of future conditions, yet represent plausible outcomes in terms of the relative movement of different market forces.

PACE Alternative Future Scenarios

TEP hired PACE to develop a base case set of assumptions and two alternative future scenarios for modeling the performance of each resource portfolio. These three future states of the world are characterized by discrete scenarios with varying economic drivers that represent three separate forecasts of forward market conditions (See Appendix A).

These scenarios are defined as:

1. Base Case Scenario
2. High Technology Scenario
3. High Economy Scenario

The Base Case Scenario features existing regulations, gradually rising mid-term gas prices (in real terms), continuing technological growth, low load growth and generally moderate market outcomes. Power market participants are able to adapt and adjust in a timely manner to changing market forces.

The High Technology Scenario is characterized by significant advances in energy storage technology, renewable energy deployment, emissions reduction and CO₂ removal technology, high efficiency natural gas-fired generation, and also natural gas extraction productivity improvements. These conditions tend to subdue fuel prices, power prices and capital costs, and put pressure on coal plant economics, resulting in additional retirements. However, there are also significant developments in technologies that improve EE, which helps to mitigate load growth that might otherwise be expected in a “high technology” scenario with robust economic growth.

The High Economy Scenario is characterized by a robust and growing U.S. economy that keeps upward pressure on all of the major market outcome categories, including load growth, fuel costs, power prices, and capital costs. This growth is in the absence of a major technological breakthrough. Existing generation resources are needed to maintain this economic expansion, limiting the number of retirements while accelerating the number of capacity additions. While this scenario shares many of the attributes of the previous “High Technology” scenario, the pace of technological innovation is not as dynamic and therefore beneficial to keeping prices and costs in check.

Under the High Technology and High Economy Scenarios, key market indices such as fuel prices, emission prices, and retirements move in opposite directions relative to the base case, thereby providing the range of outcomes desired for portfolio modeling.

The table below represents trends for each variable in the “Base Case Scenario” and the directional shift in trend relative to the base case outlook in “L”, “H”, and “M” under the “High Economy Scenario” and the “High Technology Scenario”. The “L” symbol represents a decline or a reduction in trend compared to the base case projection, whereas the “H” symbol represents an increase or a rise relative to the base case projection for the corresponding period. Finally, the “M” symbol represents identical movement to the base case or a convergence to the base case for the specific period if the previous trend has caused the variable to go above or below the base case.

Table 20 – Summary of PACE’s Key Planning Drivers Scenarios

Key Planning Drivers	Base Case Scenario			High Economy Scenario			High Technology Scenario		
	Base Case Natural Gas Pricing			High Natural Gas Pricing			Low Natural Gas Pricing		
Planning Horizon	Short-Term	Mid-Term	Long-Term	Short-Term	Mid-Term	Long-Term	Short-Term	Mid-Term	Long-Term
Natural Gas Prices	B	Upward Trend	Level Trend	B	H	M	B	L	L
Coal Prices	B	Upward Trend	Upward Trend	B	H	H	B	L	L
Load Growth	B	Level Trend	Upward Trend	B	H	M	B	L**	L**
CO ₂ Compliance Prices	B	Upward Trend	Upward Trend	B	H	H	B	L	L
Wholesale Power Prices	B	Upward Trend	Level Trend	B	H	H	B	L	L
Capital Costs	B	Upward Trend*	Upward Trend*	B	H	H	B	L	L
Coal Plant Retirements	B	Upward Trend	Upward Trend	B	L	M	B	H	M
Resource Additions	B	Upward Trend	Upward Trend	B	H	M	B	H	M

Notes:

All scenarios are similar to the Base Case (B) in the short-term, then move low (L), high (H), or moderate (M) relative to the base case.

Planning Horizon: Short-Term = 2016-2018, Mid-Term = 2019-2025, Long-Term = 2026-2040


*Certain renewable technologies are on a downward capital cost trend as the technologies continue to mature

**Slightly lower

Natural Gas Prices

Chart 39 shows the Henry Hub natural gas price assumptions for the three PACE scenarios.

Chart 39 - Permian Basin Natural Gas Price Sensitivities

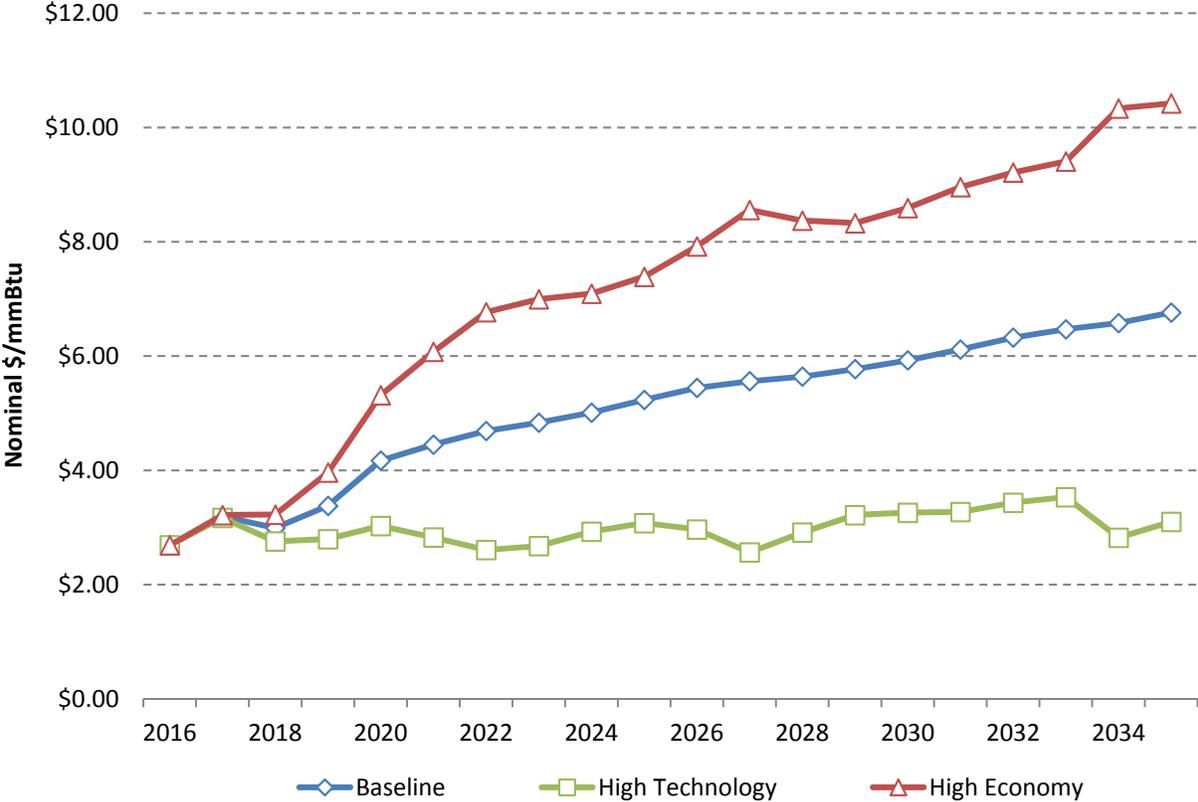


Coal Prices

TEP currently has ownership shares in four coal-fired power plants in Arizona and New Mexico, most of which are under long-term contracts for coal supply.

- ▶ **San Juan:** The plant is a mine-mouth facility that receives coal from the San Juan mine. It has recently signed a short-term contract through July 2022.
- ▶ **Springerville:** The plant has access to local coal from the El Segundo mine in New Mexico via rail deliveries. Springerville can burn both Western subbituminous coal as well as coal sourced from Powder River Basin.
- ▶ **Navajo:** The plant receives coal from the Kayenta mine, located 80 miles south of the plant, via a dedicated rail line. TEP is under a long-term coal supply agreement through 2030.
- ▶ **Four Corners:** The Four Corners Power plant is sourced from the Navajo Coal mine, which is mine-mouth facility, operated by the Navajo Transitional Energy Company. The Four Corners’ coal supply agreement runs through June 2031.

TEP’s assumptions for coal prices are based on contract indices and escalators that are driven by the PACE coal market outlook to establish coal price projections for the TEP fleet. Chart 40 reflects the TEP weighted average coal pricing for the three scenarios.

Chart 40 – TEP Coal Price Assumptions

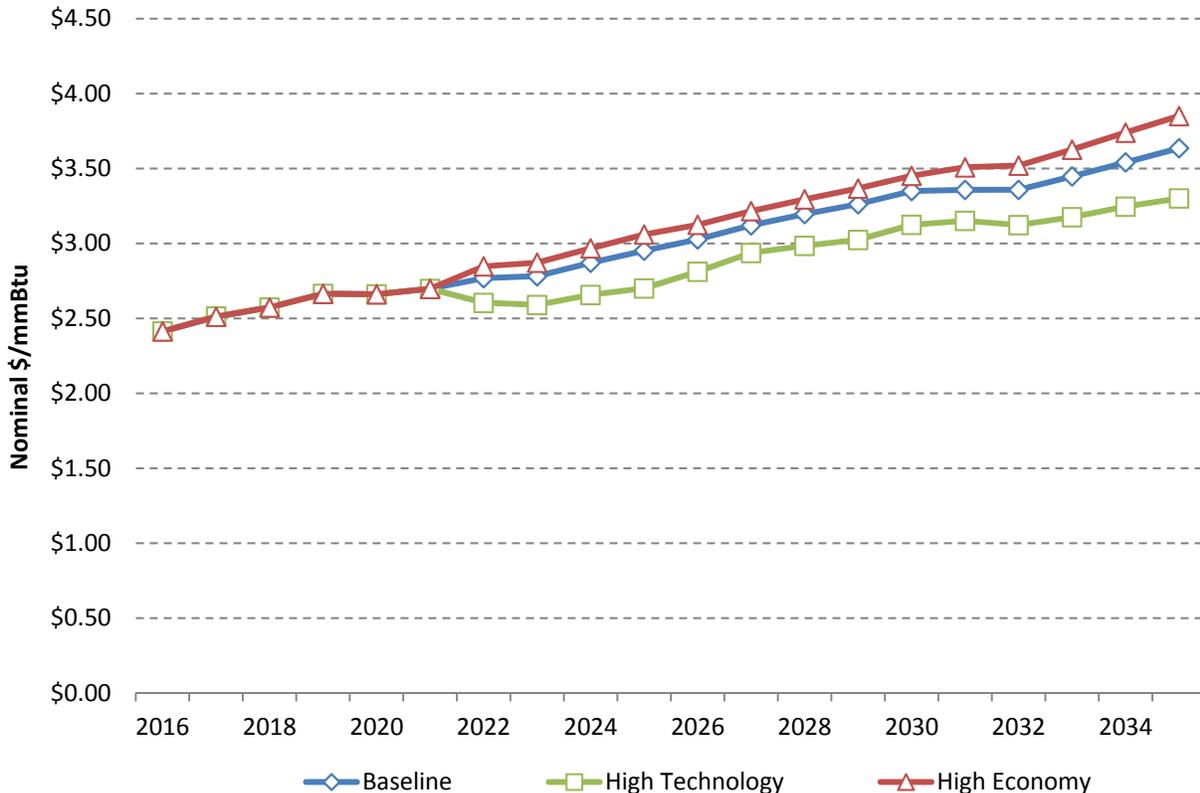

Capital Costs

The capital cost for new resources are based on the Lazard’s Levelized Cost of Energy Analysis v.10.0, which presents costs in 2016 dollars. Future nominal costs include an inflation adjustment as well as innovation adjustment developed by PACE to reflect that that installed costs of certain technologies are expected to decrease as the technology itself matures in addition to improvements in manufacturing and delivery processes and supply chain efficiencies. Chart 41 below presents the capital cost assumptions for the technologies representing the majority of future resource additions for each of the three scenarios.

Chart 41 – Capital Cost Assumptions, Solar Technology

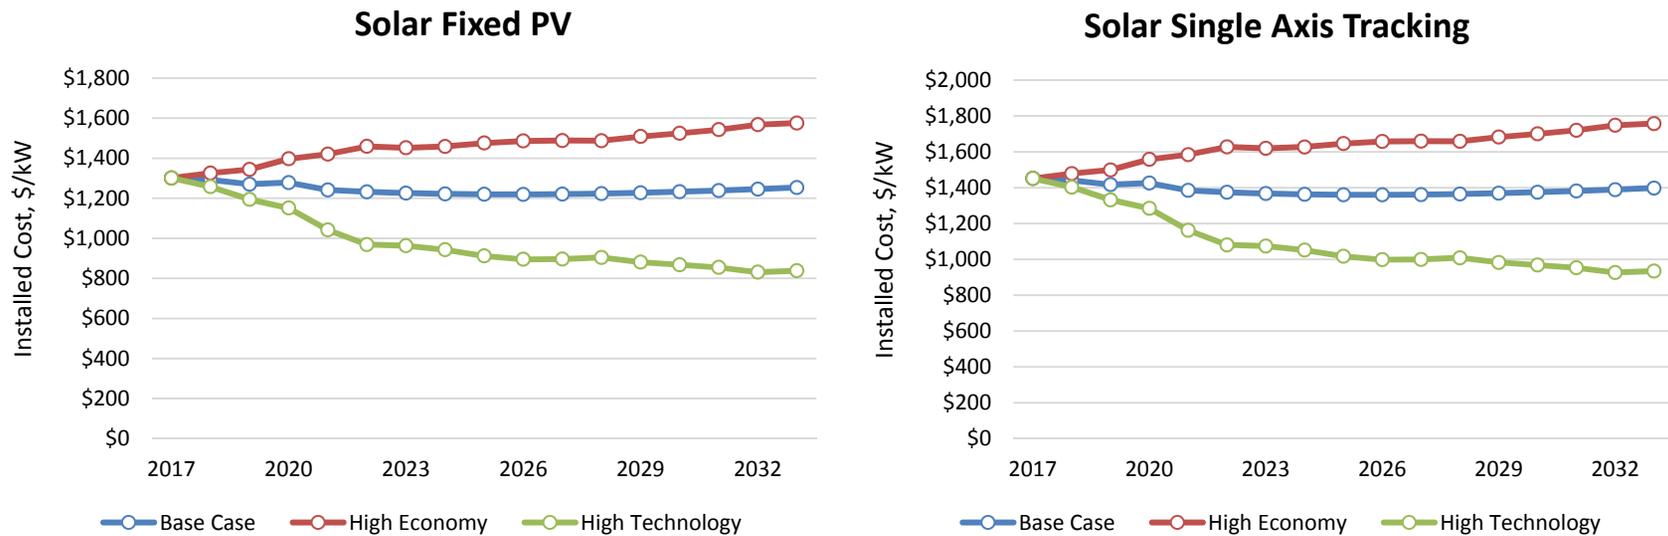


Chart 42 – Capital Cost Assumptions, Wind



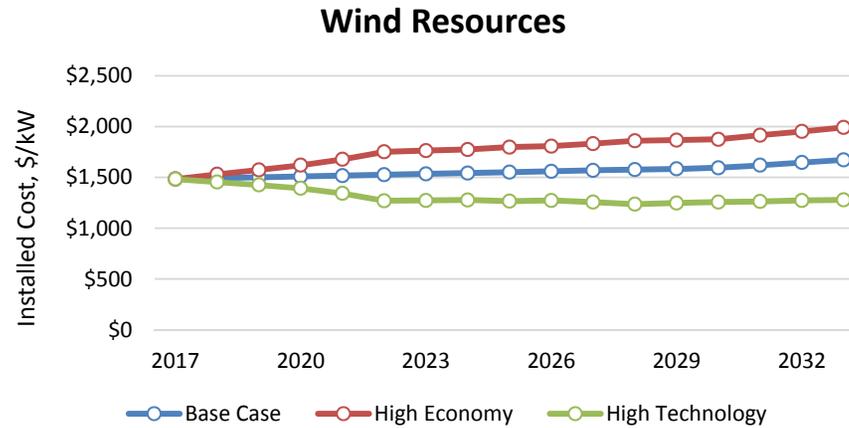



Chart 43 – Capital Cost Assumptions, Natural Gas Technology

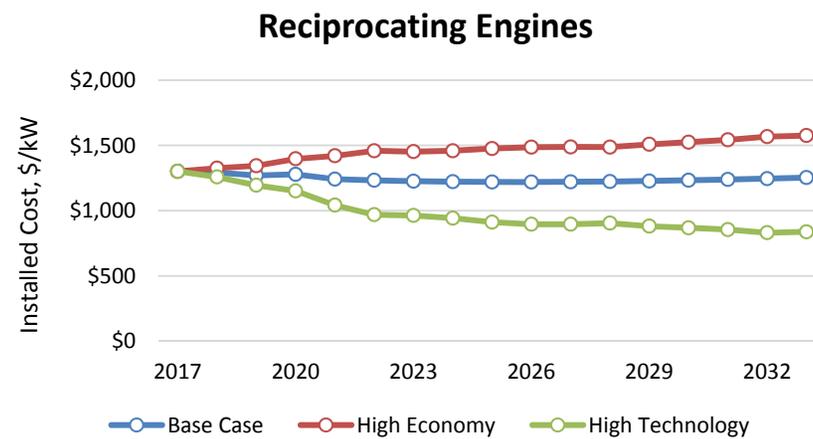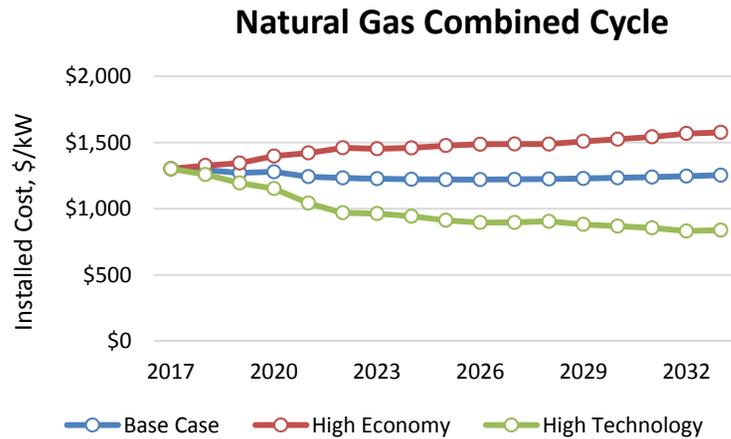

Palo Verde (7x24) Market Prices

Chart 44 shows the Palo Verde market price assumptions for the three PACE scenarios.

Chart 44 - Palo Verde (7x24) Market Price Sensitivities

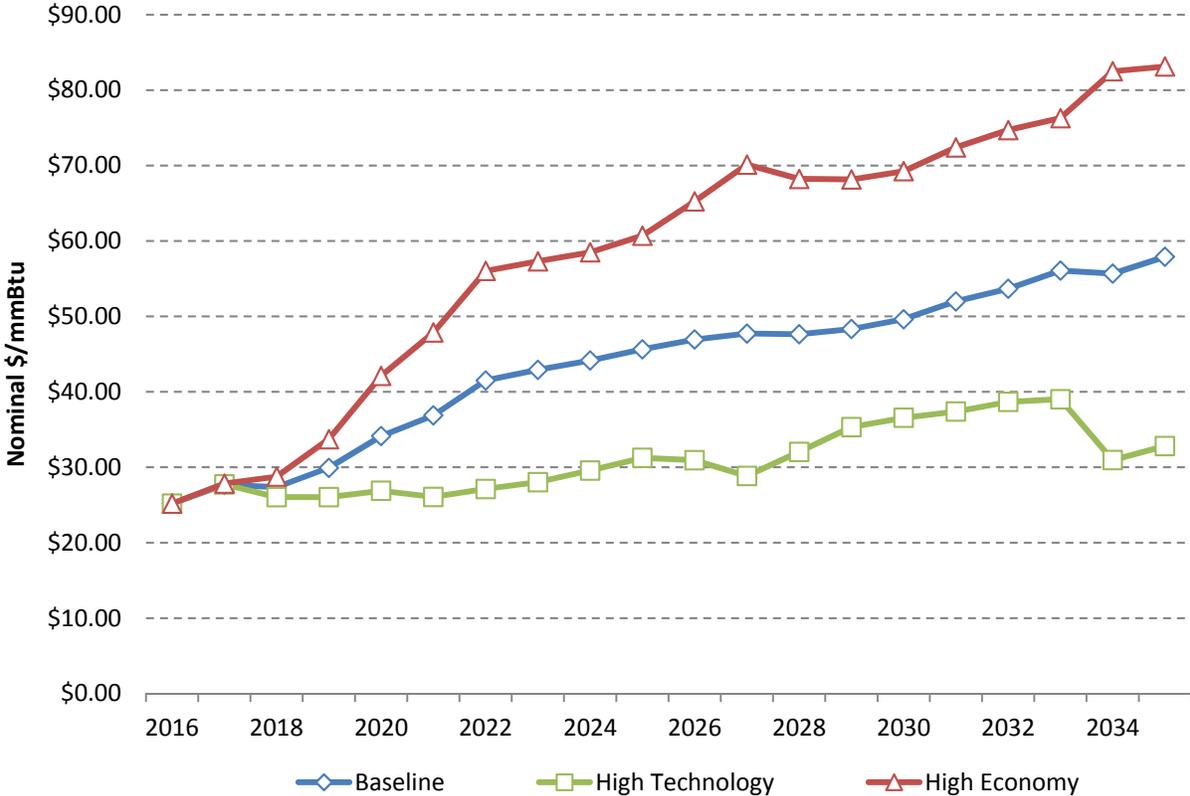

Load Growth Scenarios

Due to the need for comparability between alternative portfolios, the base case load assumption will be used for all alternative portfolios. Varying assumptions on load growth is analyzed against the Reference Case Plan portfolio only. The 2017 Reference Case Plan projects TEP peak demand growing approximately 0.7% per year between 2020 and 2030. This change in growth is highly influenced by the assumption of a significant mining expansion occurring by 2022. Other than this expansion, TEP doesn't forecast any significant increase in load from TEP's large industrial and mining customers. The 2017 Reference Case Plan also shows a steady decline in firm wholesale obligations as current contracts expire. For the load growth scenarios, these base case conditions will be modified to create a High Load and Low Load scenarios. The load growth scenarios are described below. Results of this scenario analysis along with changes that would be required in the Reference Case Plan are summarized in Chapter 12.

High Load Scenario

For purposes of testing the Reference Case portfolio against a scenarios in which energy use and demand are greater than in the base case, TEP assumed a continuation of firm wholesale contracts at levels consistent those in the near term. Under base case load, existing firm wholesale obligations are modeled according to their contract terms and are dropped upon the current contract expiration. It is likely that certain contracts will be extended or new long-term wholesale contracts will be entered into. Table 21 represents the firm wholesale obligations under the High Load Scenario.

Table 21 – High Load Firm Wholesale Obligations, System Peak Demand (MW)

Demand MW	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032
Base Case																
Firm Wholesale Demand	223	158	158	154	154	154	129	129	44	44	44	44	44	44	44	44
Reserve Margin, %	21%	15%	15%	15%	15%	15%	15%	15%	19%	20%	20%	21%	18%	18%	17%	17%
High Load Case																
Firm Wholesale Demand	223	158	158	154	154	154	160	160	160	160	160	160	160	160	160	160
Reserve Margin, %	21%	15%	15%	15%	15%	15%	15%	15%	16%	16%	17%	15%	16%	16%	15%	15%

Low Load Scenario

For purposes of testing the Reference Case portfolio against a scenario in which energy use and demand are lower than in the base case, TEP assumes no significant new large customer or mining expansions occur within the planning horizon. Under this assumption, there is an 80MW reduction in peak load beginning in 2022.

Fuel, Market and Demand Risk Analysis

TEP developed explicit market risk analytics for each portfolio through the use of computer simulation analysis using AuroraXMP⁴¹. Specifically a stochastic based dispatch simulation was used to develop a view on future trends related to fuel prices⁴², wholesale market prices, and retail demand. The results of this modeling was employed to quantify the risk of uncertainty and evaluate the cost performance of each portfolio. This type of analysis ensures that the selected portfolio not only has the lowest expected cost, but is also robust enough to perform well against a wide range of possible load and market conditions.

As part of the Company's 2017 resource plan, TEP conducted risk analysis around the following key variables:

- ▶ Natural Gas Prices
- ▶ Wholesale Market Prices
- ▶ Retail Load and Demand
- ▶ Delivered Coal Prices


⁴¹ AURORAxmp is a stochastic based dispatch simulation model used for resource planning production cost modeling. Additional information about AURORAxmp can be found at <http://epis.com/>

⁴² Both natural gas and coal.

Permian Natural Gas Prices

As part of 2017 IRP analysis, TEP ran one hundred risk simulations to quantify the risk of uncertainty related to Permian natural gas prices. Chart 43 below details PACE Global Base Case (Clean Power Plan) Scenario and the natural gas price simulations against which the portfolios were evaluated.


Chart 45 - Permian Basin Natural Gas Price Iterations (\$/mmBtu)

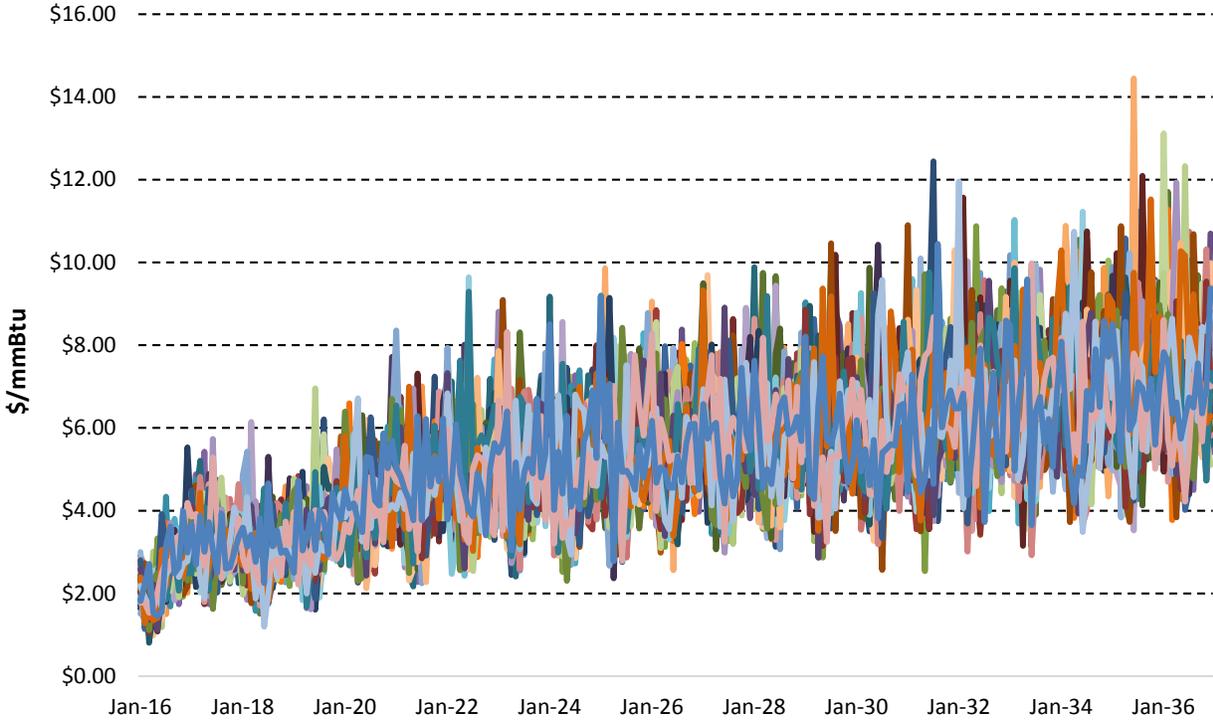

Permian Natural Gas Price Distributions

Chart 46 shows the expected price distributions for natural gas sourced from the Permian Basin. These distributions are based on the stochastic data simulations shown in Chart 45 shown above.


Chart 46 - Permian Basin Natural Gas Price Distributions (\$/mmBtu)

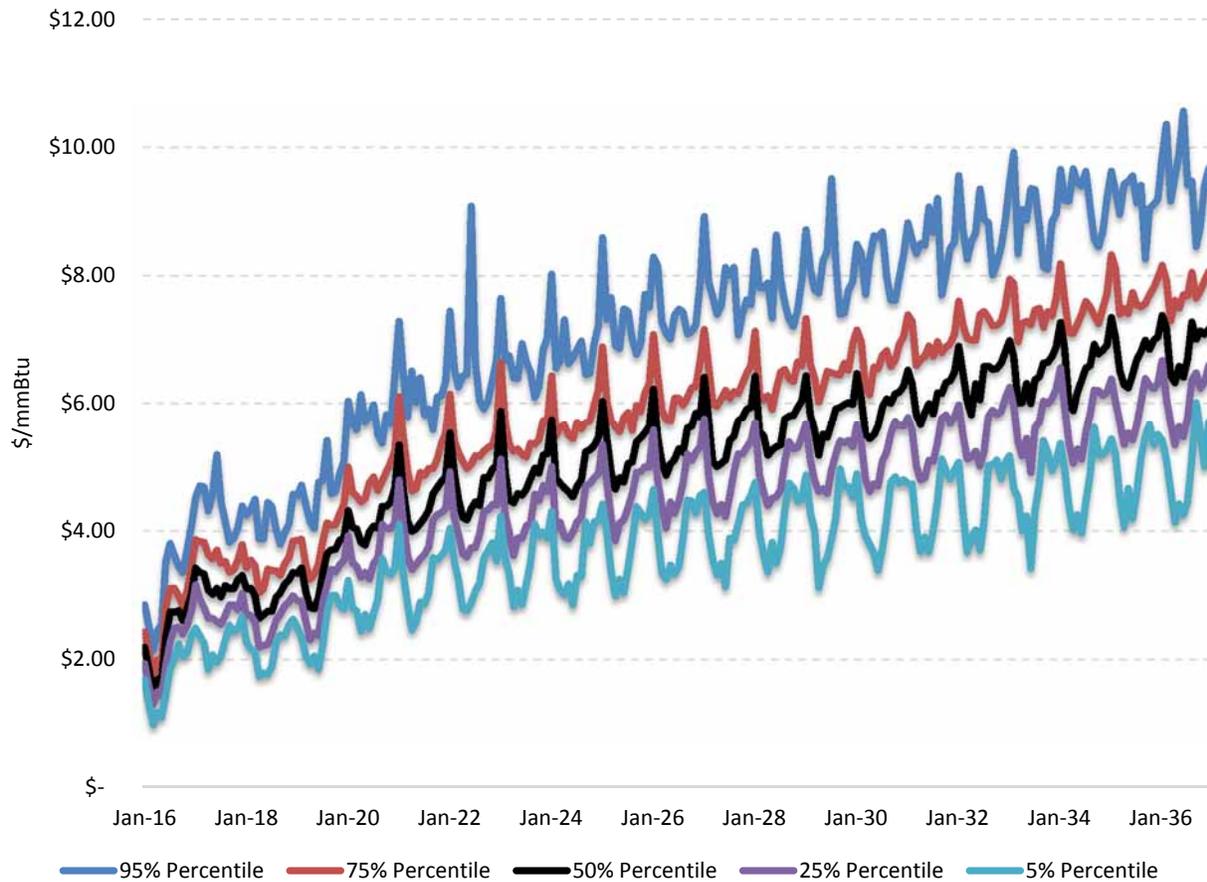

Palo Verde (7x24) Wholesale Power Prices

As part of the 2017 IRP analysis, TEP ran one hundred risk simulations to quantify the risk of uncertainty related to wholesale power prices. Chart 47 below details PACE Global Base Case (Clean Power Plan) Scenario and the wholesale power price simulations against which the portfolio were evaluated.


Chart 47 – Palo Verde Wholesale Power Price Iterations (\$/MWh)

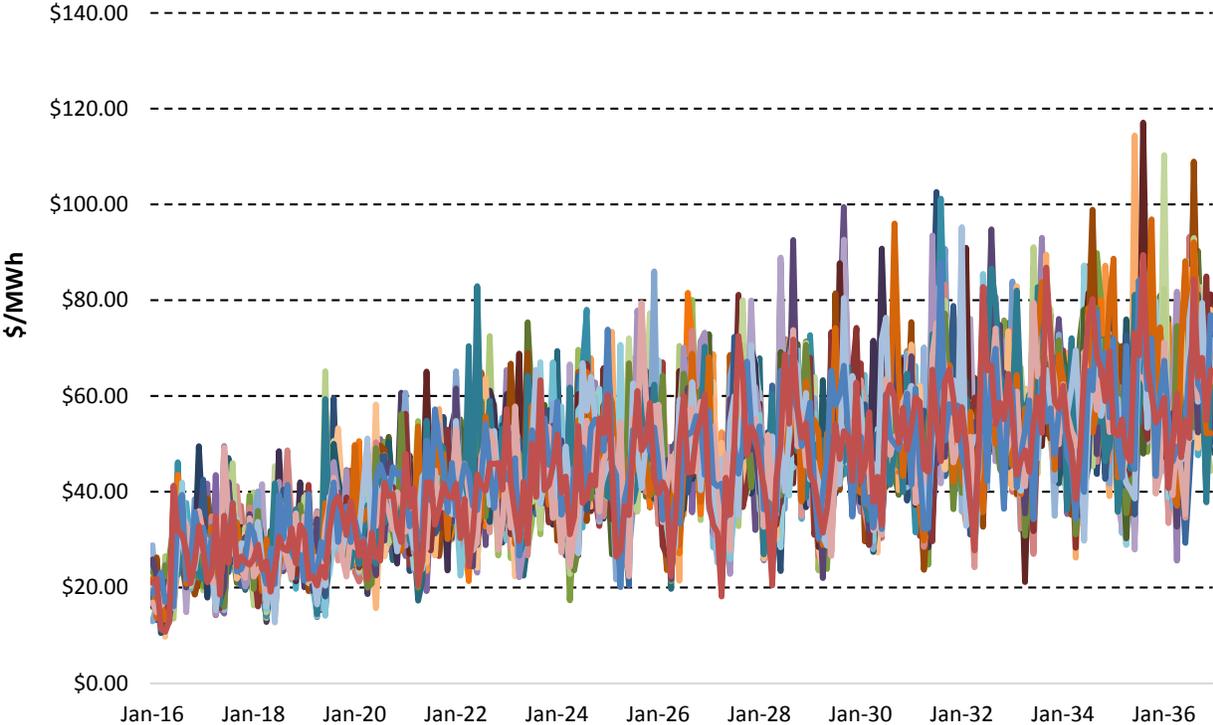

Palo Verde (7x24) Market Price Distributions

Chart 48 shows the expected price distributions for wholesale power sourced from the Palo Verde market. These distributions are based on the stochastic data simulations shown in Chart 47 shown above.


Chart 48 - Palo Verde (7x24) Market Price Distributions

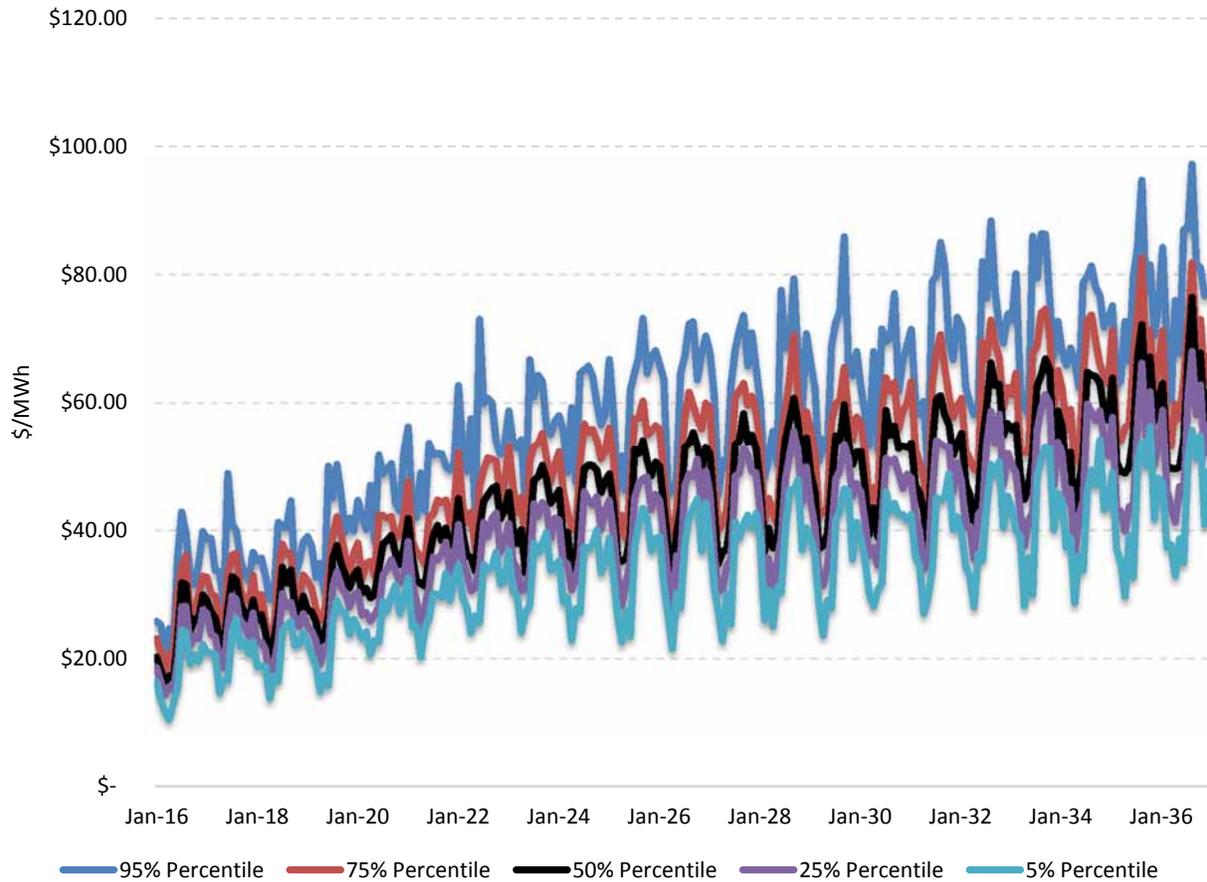

Load Variability and Risk

As outlined in the previous sections, load is also varied within each of the 100 simulations in accordance with the movement of natural gas and wholesale power prices. In this way, a wide variety of possible load growth scenarios are also considered in the simulation analysis and are therefore inherent in the resulting risk profiles.

Chart 49 - TEP Peak Retail Demand (MW)

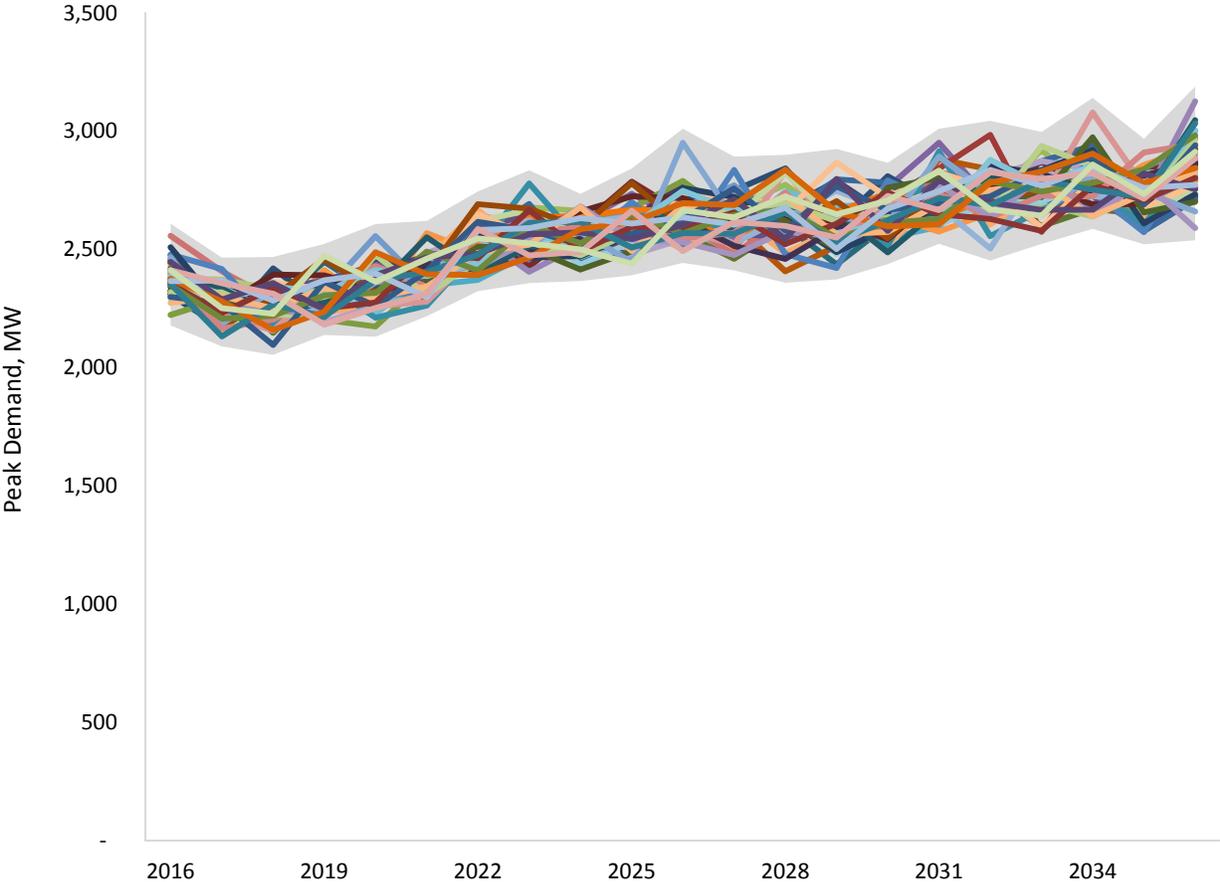

CHAPTER 12**REFERENCE CASE PLAN**

TEP's 2017 IRP Reference Case Plan continues the Company's long-term strategy of resource diversification by taking advantage of near-term opportunities to reduce its higher cost coal capacity, expanding the deployment of renewable energy resources with a target of serving 30% of its retail load using renewable energy by 2030, continuing development and implementation of cost-effective EE measures, and adding high-efficiency natural gas resources.

Resource Diversification


In September 2016, TEP acquired the remaining 50.5% share of Springerville Unit 1, bringing its total capacity at Springerville to 793 MW with full ownership and operational control of Units 1 and 2. As part of the 2017 IRP Reference Case Plan, TEP plans to make the following coal capacity reductions over the next five years. By 2018 TEP will reduce its coal capacity at the San Juan Generation Station from 340 MW to 170 MW with the retirement of San Juan Unit 2. TEP will further reduce its overall coal capacity by 169 MW assuming the Navajo Generating Station ceases operation at the end of 2019⁴³. Finally, TEP will exit San Juan entirely when the current coal supply agreement ends in July 2022.

The 2017 Reference Case Plan includes two large renewable energy projects coming online in 2019. These projects, consisting of 100 MW of wind and 80 MWAC of solar PV, are currently in procurement as PPAs. Further renewable energy is assumed to be added to the system between 2023 and 2030, consisting of a diversified mix of solar PV (fixed axis and SAT) and wind. To support the system in light of this high penetration of intermittent renewable energy, and to provide replacement capacity for the retirement of older, less efficient natural gas steam units at Sundt (Units 1 and 2), it is assumed that TEP installs approximately 192 MW of natural gas fired RICEs between 2020 and 2022. Additional renewable energy support and other ancillary services are to be provided with a number energy storage projects assumed to come on line between 2019 and 2021. These systems are assumed to be 50 MW projects with a storage discharge capacity of 50 MWh.

⁴³ The 2019 retirement date is dependent upon receiving an extension of the lease agreement to allow for plant decommissioning prior to expiration of the lease. Without an extension of the current lease, plant closure would need to take place as early as this year to allow for decommissioning by the end of 2019.

Loads and Resource Assessment

Chart 50 – TEP’s 2017 Loads and Resource Assessment

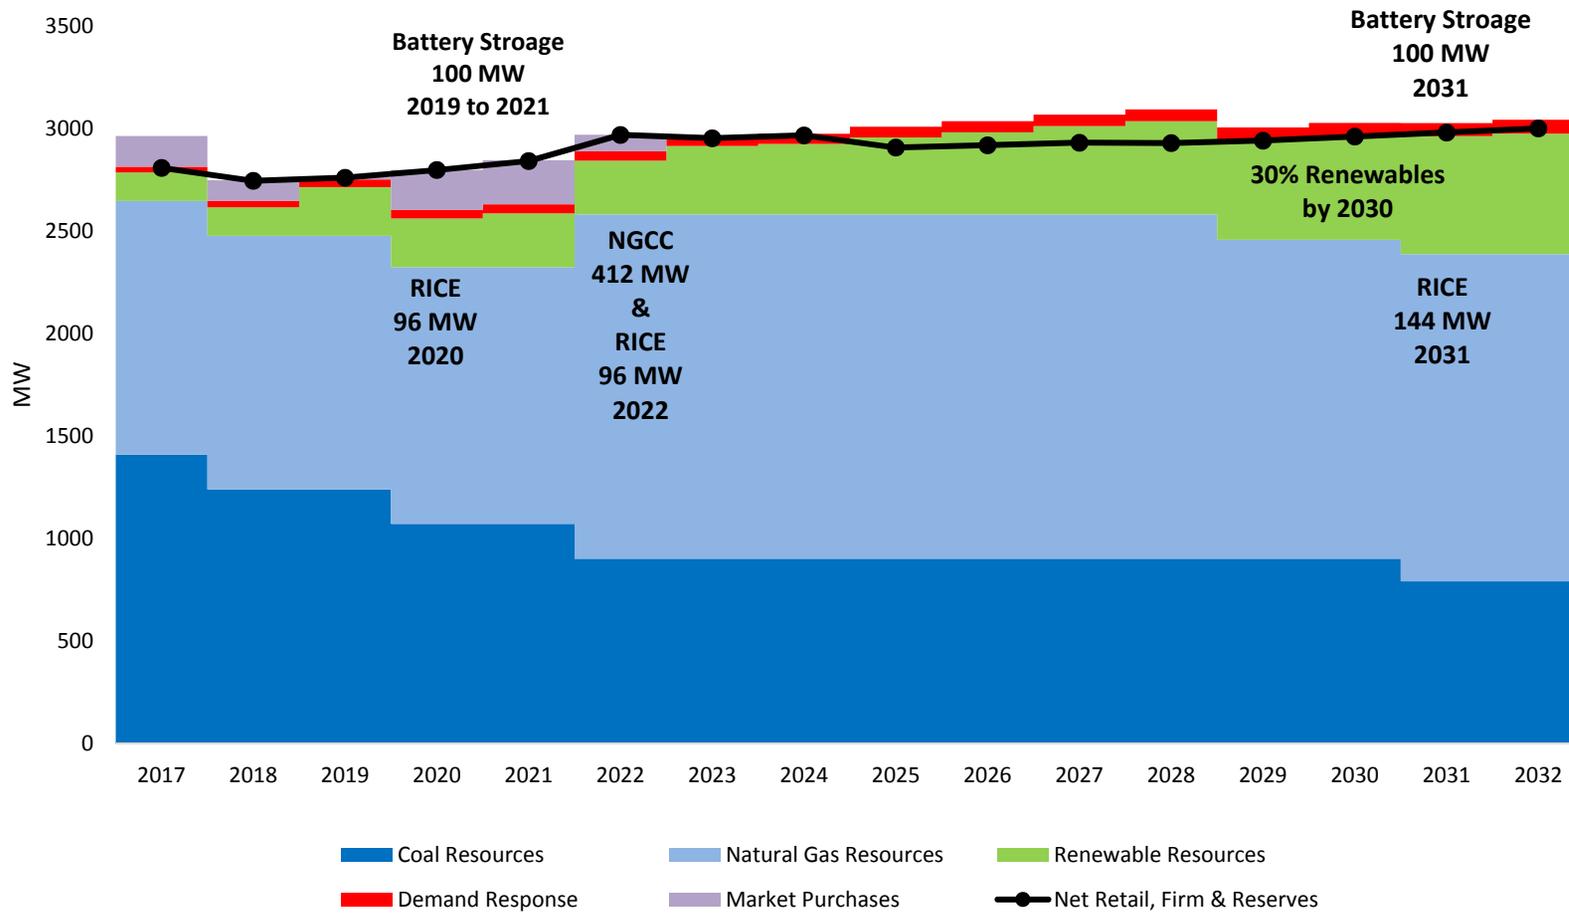

Addition of Resources to Meet System Requirements

In considering future resources, the resource planning team evaluates a mix of load serving and grid balancing technologies. This mix of technologies includes both commercially available resources and developing technologies that are likely to become technically viable in the near future. The IRP process takes a high-level approach and focuses on evaluating resource technologies relevant to the needs of the system, rather than focusing on specific projects. Candidate resource additions designed to meet planning reserve requirements are identified for modeling and through an iterative process, a specific configuration in terms of technology, timing and capacity is arrived at based on cost factors (capital expense and Net Present Value [NPV]), reliability needs, and environmental performance. This approach allows the resource planning team to develop a wide-range of scenarios and contingencies that result in a resource acquisition strategy that contemplates future uncertainties.

Addition of Load Serving Resources

To replace the near-term coal capacity reductions (508 MW between 2017 and 2022), TEP plans to add approximately 400 MW of NGCC capacity in 2022. NGCC is a high-efficiency intermediate to baseload resource, and given the current outlook on natural gas prices, represents the lowest LCOE among fully-dispatchable load-serving resources. NGCC units are also capable of load-following and, in the proper configuration, can provide fast ramping response.

Addition of Grid Balancing and Load Leveling Resources

An additional 150 MW of RICE capacity is assumed to commence operation in 2031 as the renewable energy capacity increases, and as older combustion turbine and natural gas steam units are retired, in addition to the retirement of Four Corners. The high efficiency of these units combined with their modular arrangement and fast start and fast ramp capabilities make them a highly-flexible, cost effective alternative for addressing renewable intermittency as well as peak capacity. In addition to the 120 MW of battery ESS installed by 2021, the 2017 IRP Reference Case Plan assumes the addition of energy storage in 2031. This system would be 100 MW x 100 MWh and could provide a combination of ancillary, peak capacity and load-leveling services.

Reference Case Plan Summary and Timeline

Chart 51 and Chart 52 show the Reference Case Plan resource capacity additions and retirements by year, respectively. Chart 51 gives an indication of the source of replacement and make-up power due to unit retirements and increasing load. Figure 38 details the significant resource planning decisions assumed for the 2017 IRP Reference Case Plan.

Chart 51 - Reference Case Plan - New Resource Capacity

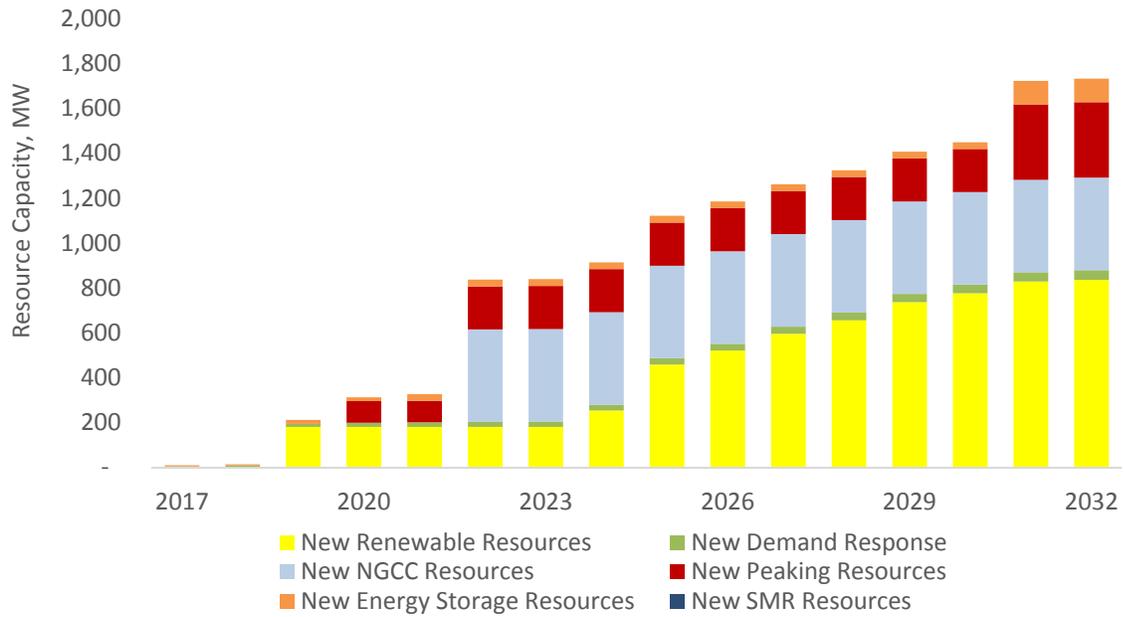


Chart 52 - Reference Case Plan - Resource Retirements


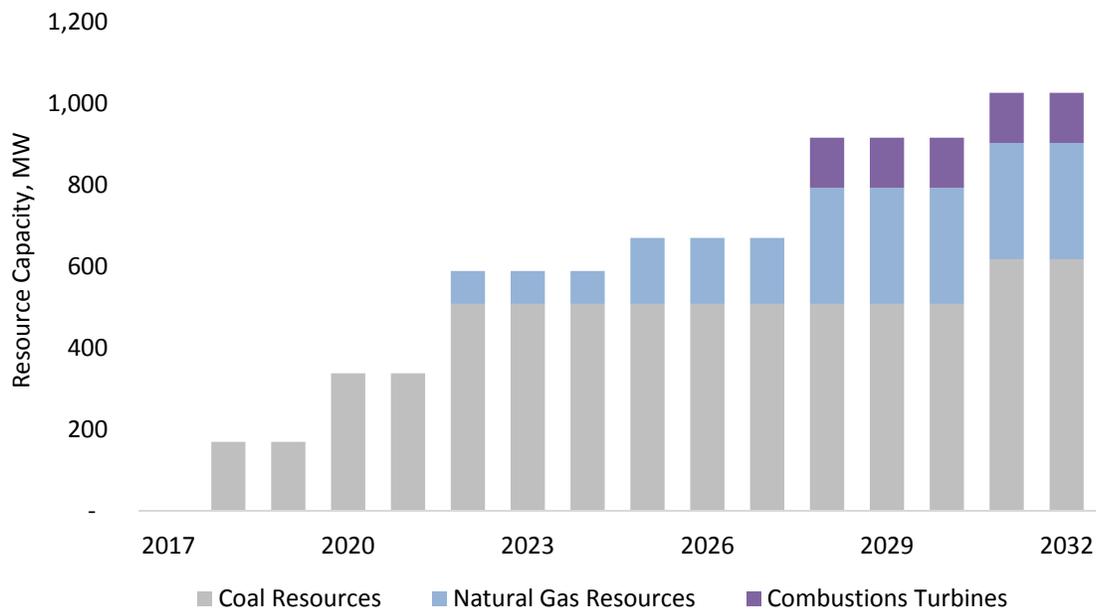


Figure 38 – 2017 IRP Reference Case Plan Resource Timeline

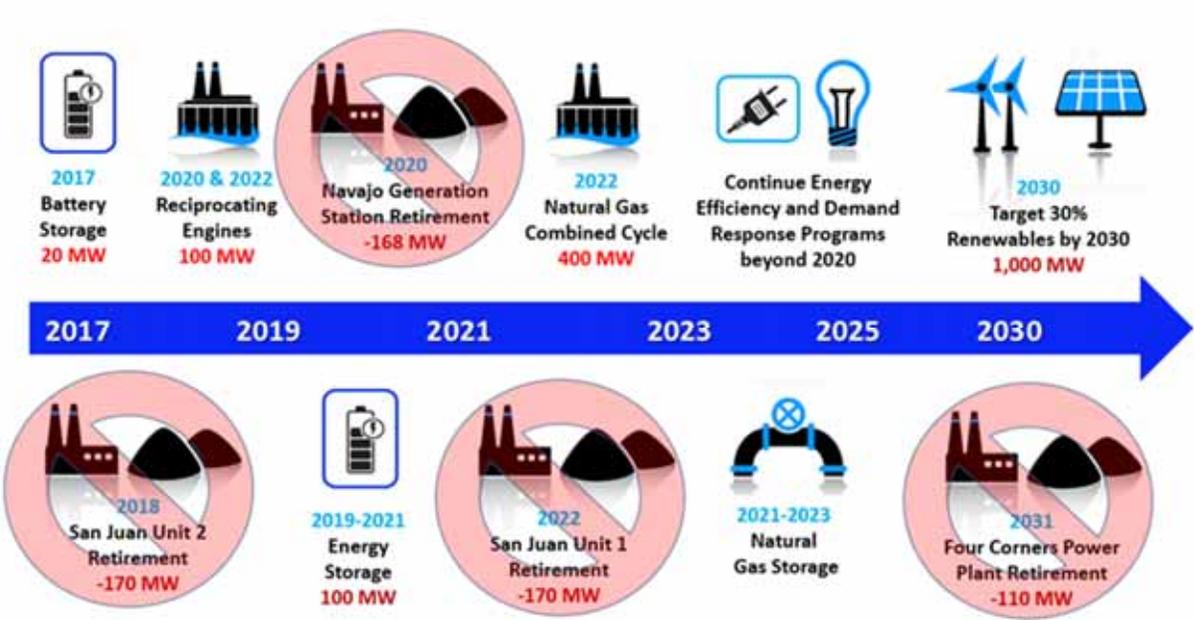

For modeling purposes, the 2017 IRP Reference Case Plan does not include any significant new transmission upgrades over the 15-year timeframe. The TEP Ten-Year Transmission Plan only includes one “Planned” project, which is a relatively small project anticipated for construction in 2018⁴⁴. Several “conceptual” projects were identified in the plan, however, the timing of these projects is expected to be determined through future transmission planning activities. TEP will update these conceptual project descriptions in future IRP filings as they are clarified.

⁴⁴ Hassayampa – Pinal West – project is a 500kV line loop-in of 3 spans or less to connect an existing line to the Jojoba Switchyard -

Reference Case Plan Attributes

The primary objective of the Reference Case Plan is to provide a portfolio of resources that reliably meets our customers’ energy needs at an affordable rate, while identifying and addressing potential risks to cost and reliability. TEP’s 2017 Reference Case Plan achieves both of these objectives. Chart 53 and Chart 54, below show the growing diversity in energy and peak capacity, respectively, over the planning period.

Chart 53 - Reference Case Plan, Annual Energy by Resource


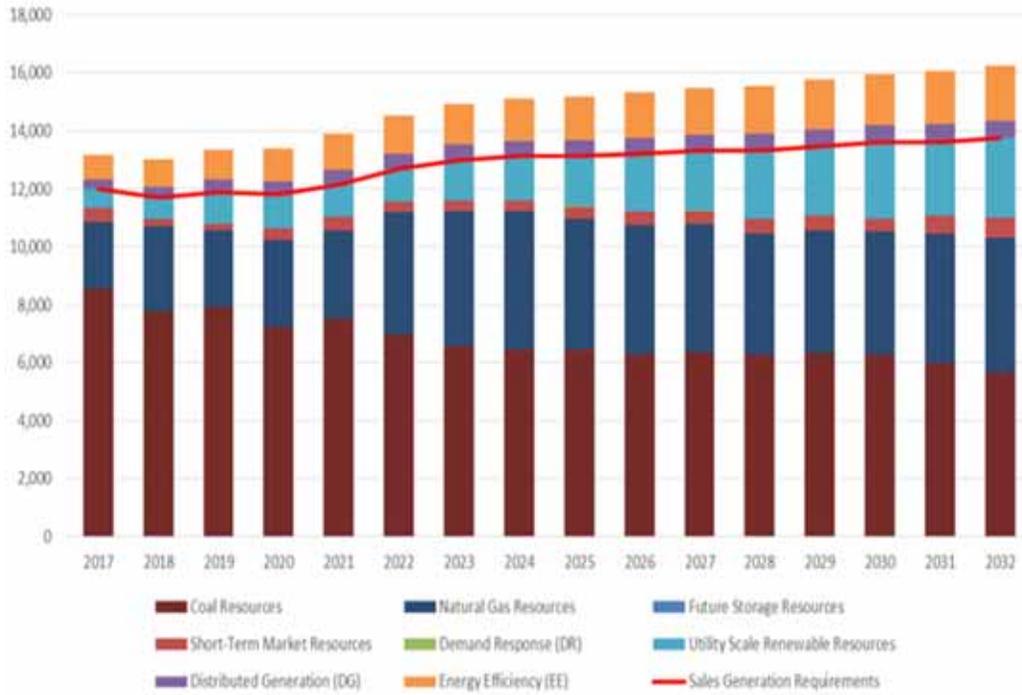


Chart 54 - Reference Case Plan, Total Coincident Peak Capacity

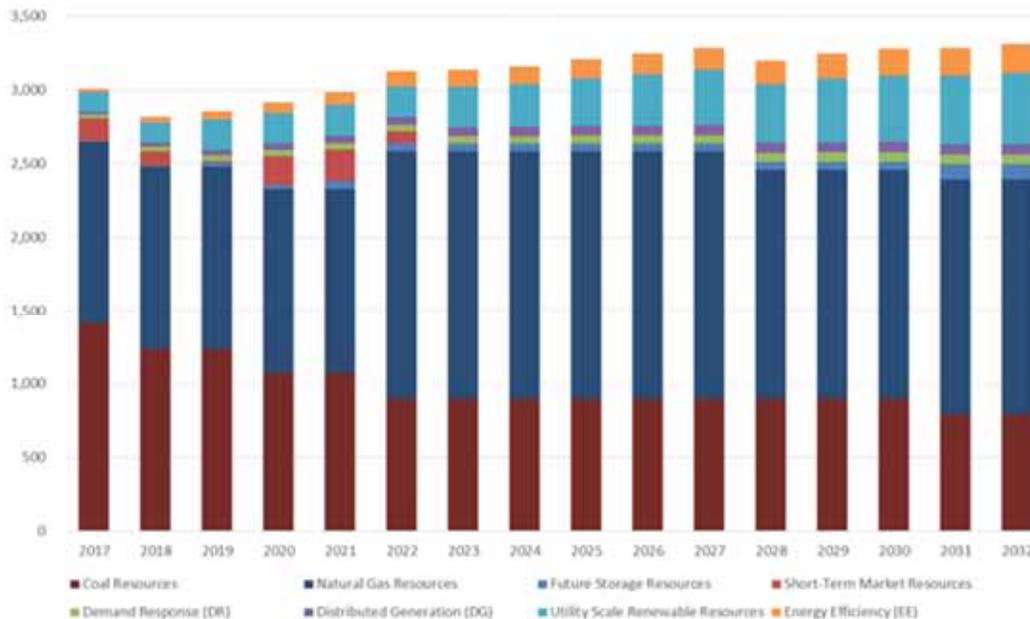

Existing Renewable Integration Requirements

TEP’s Reference Case Plan targets serving 30% of its retail load using renewable resources by 2030. These renewable resource additions result in a significant amount of new intermittent capacity, which requires a corresponding increase in Grid Balancing services to provide “back-up” capacity when those renewable resources are unavailable. As a measure of the ability to maintain reliability, Chart 57Chart 55, below shows TEP’s existing 10-minute ramping capacity in comparison to the Company’s projected reserve and ramping requirements. Chart 56 details TEP’s current 10-minute ramping capacity by resource.

Chart 55 - TEP’s Existing 10-Minute Ramping Capacity versus Projected Requirements


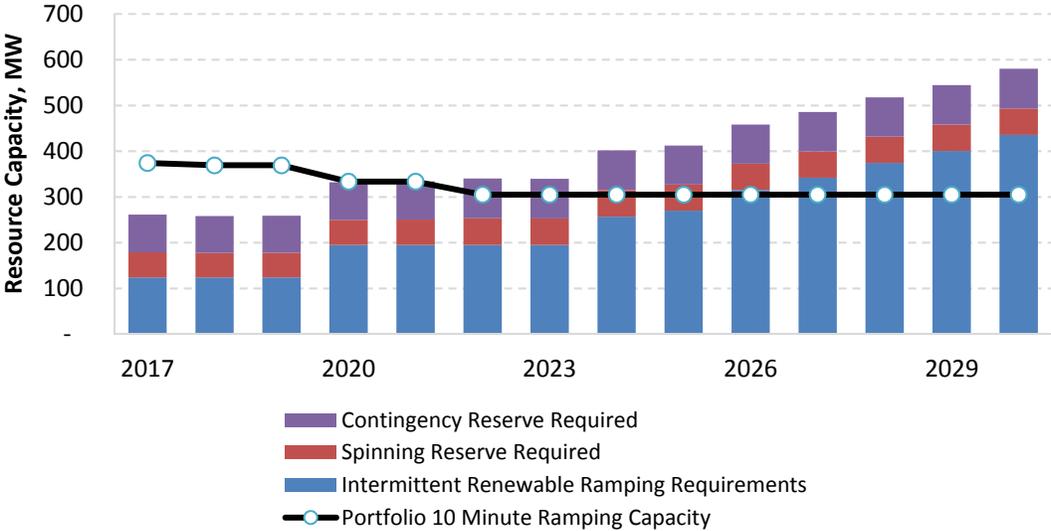


Chart 56 - TEP’s Existing 10-Minute Ramping Capacity by Resource

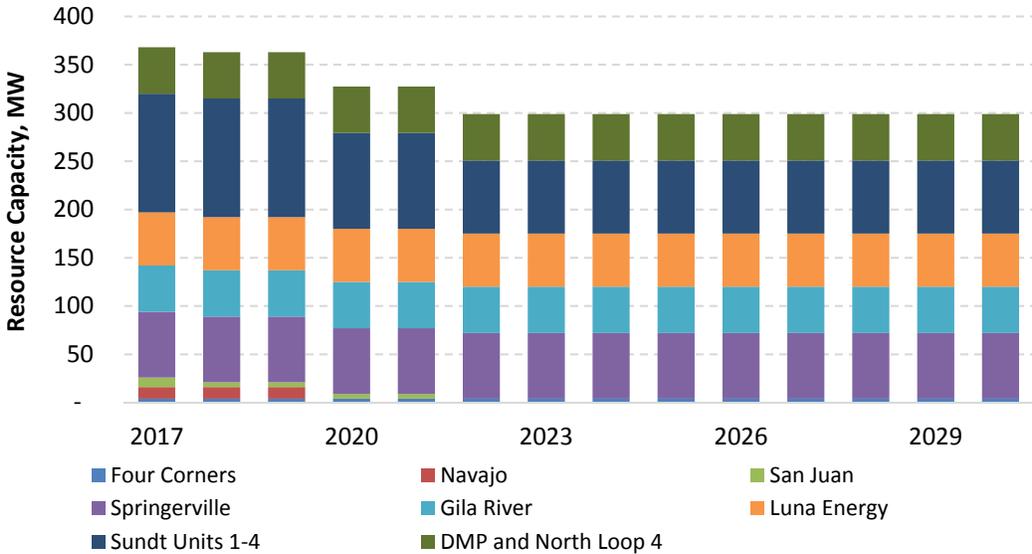

Reference Case Plan Renewable Integration Requirements

As shown on Chart 57 and Chart 58, TEP's Reference Case Plan portfolio additions of new reciprocating engines and battery storage in the 2020 timeframe will enable the Company to meet its near term and longer term 10-minute ramping requirements to reliability integrate the target of 30% renewable resources by 2030.

Chart 57 - TEP's Reference Case Plan 10-Minute Ramping Capacity versus Projected Requirements


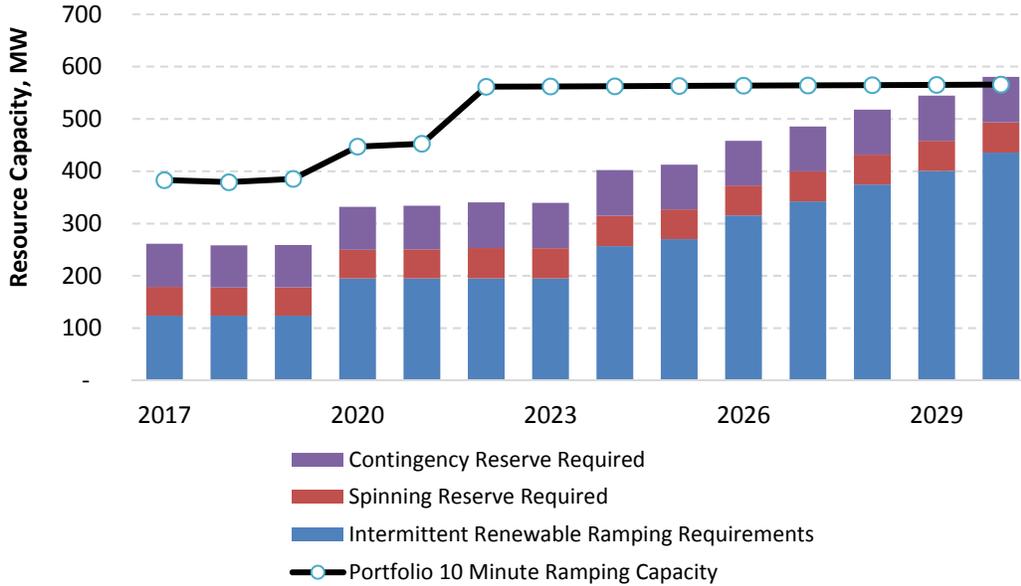


Chart 58 - TEP's Reference Case Plan 10-Minute Ramping Capacity by Resource

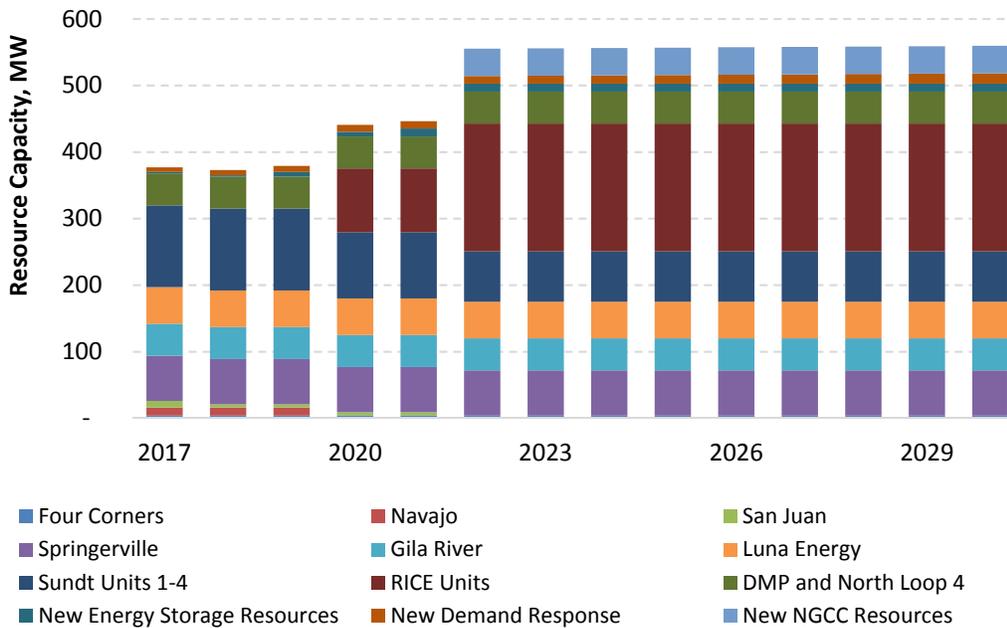

Clean Power Plan Compliance

As discussed in Chapter 3, TEP assumes that Arizona would adopt a subcategorized rate based approach for CPP compliance, while New Mexico and the Navajo Nation would adopt a mass-based approach. In addition, due to the economic advantages inherent in trading, TEP assumes that all three jurisdictions would enter a national trading pool. Chart 59 shows TEP’s compliance position in Arizona under the Reference Case Plan. TEP’s significant investment in renewable energy resources and continued EE deployment result in a surplus of ERC’s that would be available for sale or could be banked for future compliance periods.

Chart 59 - TEP Reference Case Plan CPP Compliance, Arizona


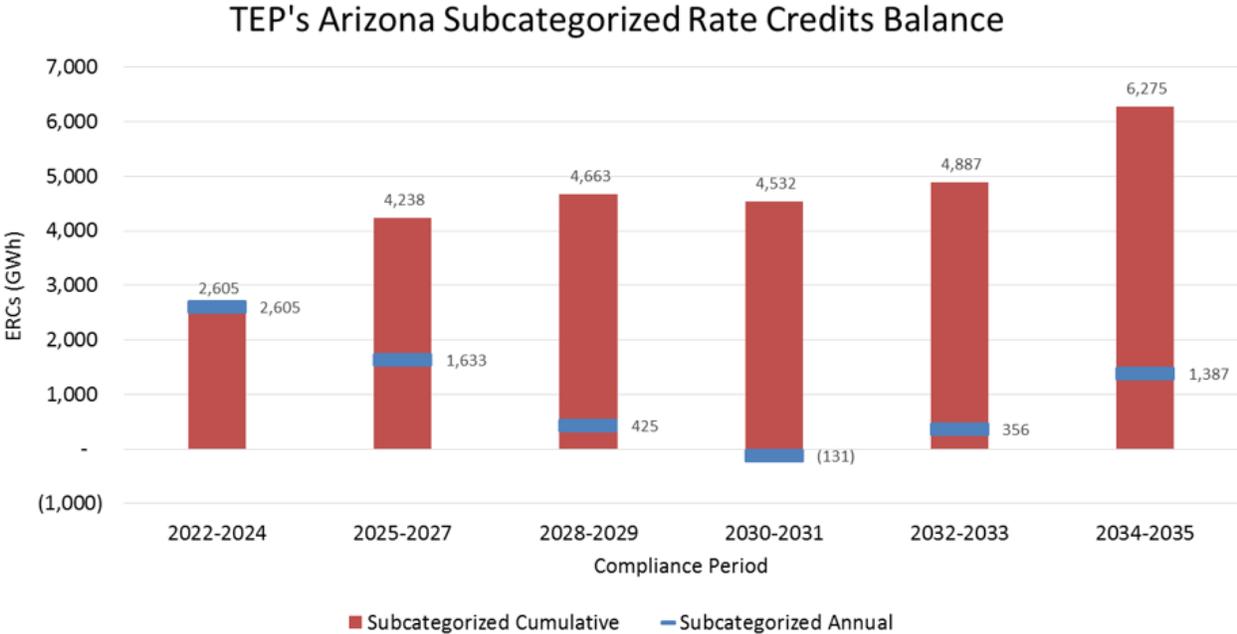


Chart 60 shows TEP's compliance position in New Mexico and the Navajo Nation, combined. The significant retirement of affected coal-fired units in these jurisdictions results in a surplus of emission allowances during each compliance period.

Chart 60 - TEP Reference Case Plan CPP Compliance, New Mexico and Navajo Nation

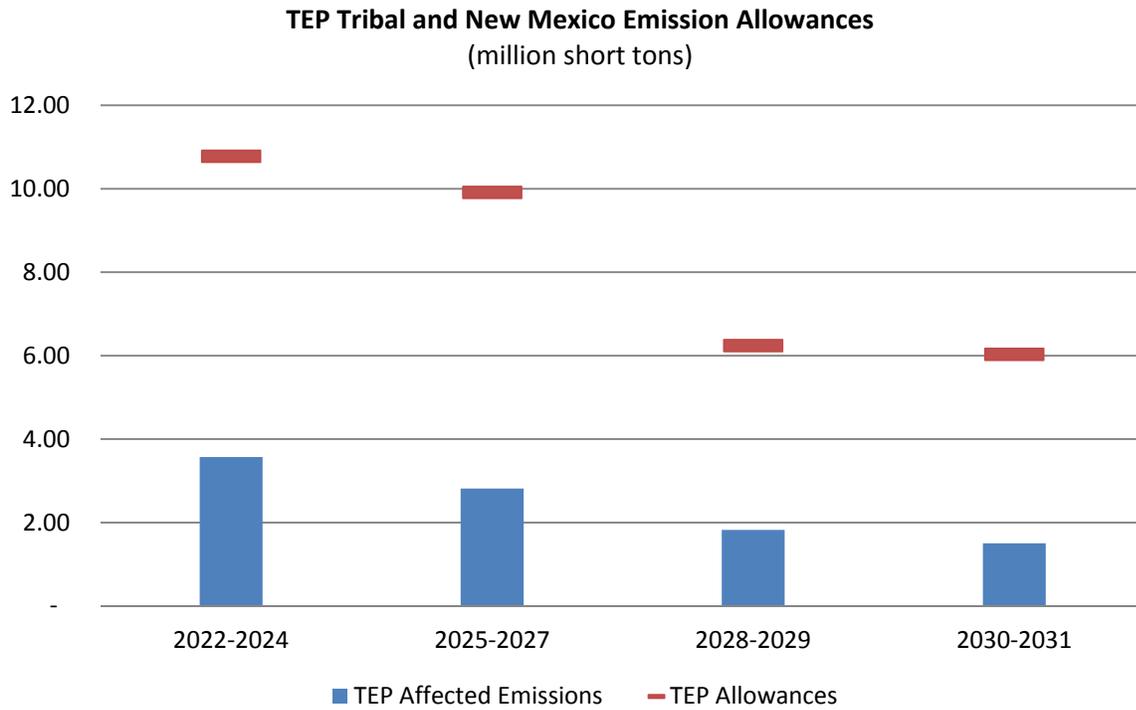





Reference Case Plan Risk Dashboard

While there are many risk factors directly or indirectly associated with each resource portfolio, they all stem from the fact that operating under a fully integrated electric utility model requires very large capital investments that generally need to be paid for over many years. Our goal is to develop a Reference Case Plan that provides optionality to make adjustments should there be a major change in future market and regulatory outcomes. Still, risk cannot be eliminate; therefore, key risk factors need to be identified and measured.

TEP developed a Risk Dashboard below as a means to bring attention to the primary risk factors effecting future resource decisions.

- **CO₂ Emissions** – While the Reference Case Plan is evaluated for compliance with the CPP as discussed above, the ultimate outcome of the CPP litigation is uncertain, and the current IRP planning horizon extends beyond the CPP implementation period. TEP believes that CO₂ emission reductions will eventually be required, though the timing and magnitude of those reductions remains uncertain. TEP believes that the Reference Case Plan CO₂ emission reductions (in excess of 30% by 2032) represents a balanced position in the event of a future CO₂ emission compliance requirement.
- **Water Consumption** – Water availability for power generation is an ongoing concern, especially in the Desert Southwest. Low surface water levels due to drought and changing weather patters suggest that a long-term goal to reduce surface water consumption is appropriate. Consumption of groundwater is much more site-specific. TEP believes that the 100% reduction in surface water consumption and nearly 30% reduction in water consumption overall by 2032 realized under the Reference Case Plan is a significant outcome in terms of managing future water supply risk.
- **Natural Gas Usage** – Over the past five decades, TEP’s resource mix has been dominated by coal-fired generation. While making a strategic effort to diversify its resource portfolio, which includes replacing coal-fired generation with natural gas and renewable resources, the Company is mindful of not going “too far”, thus creating an overreliance on natural gas. TEP believes the Reference Case Plan resource mix appropriately manages the risk of overreliance on one resource type.
- **Capital Expenditures** – A long-term resouce plan should provide the optionality to make course corrections to address uncertainties (market performance, technolgy development, regulatory changes, etc.) and well as unforeseen circumstances. That optionality can be lost due to large, near-term capital investments. The 2017 Reference Case Plan portfolio stages major capital investments fairly evenly over the 15-year planning period.

Chart 61 – Reference Case Plan Risk Dashboard

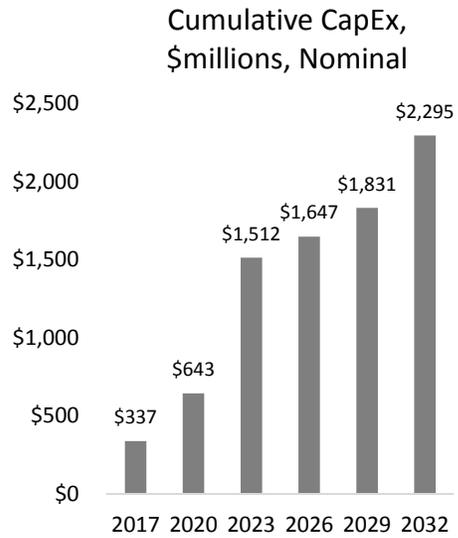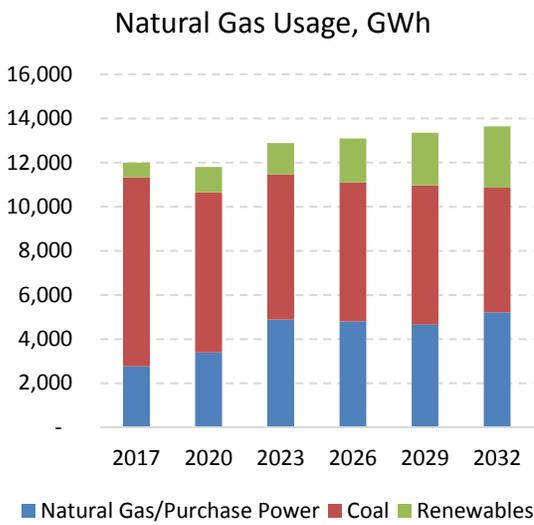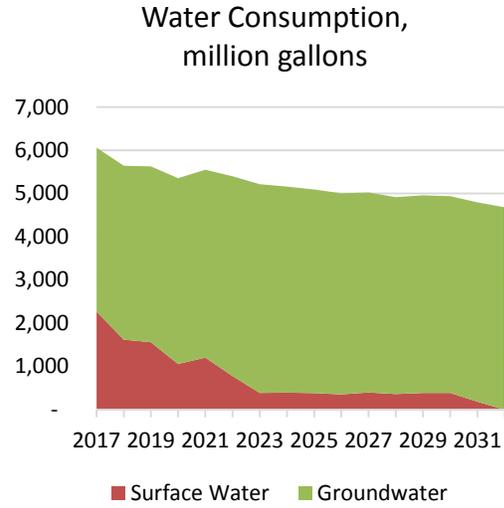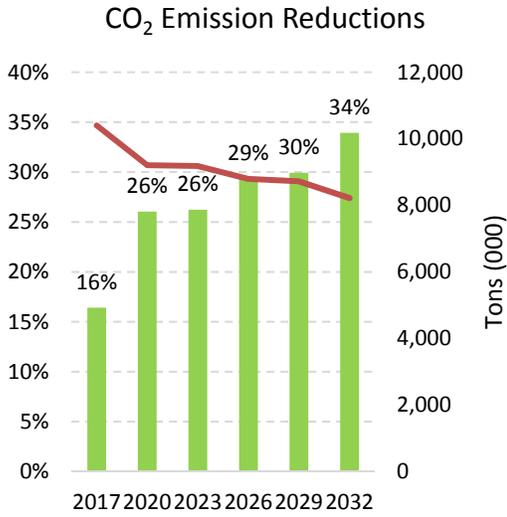


Load Growth Scenario Analysis

High Load Scenario

The high load growth scenario assumes a continuation of firm wholesale contracts at levels consistent with those in the near term. Under the Reference Case load, firm wholesale obligations remain steady through 2022 at just over 150 MW, then begin to decrease as current contracts expire. The high load scenario maintains firm wholesale obligations at 160 MW from 2023 through the end of the planning period, which results in an increase in peak demand ranging from 31 to 116 MW compared to the Reference Case Plan.

The Reference Case Plan has excess reserve beginning in 2025 due to the significant increase in renewable energy as well as the ramping resources needed with that high level of renewable penetration. Therefore, the capacity of additional resources needed under the high load scenario do not need to match the 116 MW increase observed between the Reference Case and the high load scenario in order to maintain an adequate reserve margin. Between 36 MW and 72MW of additional capacity was determined to be sufficient. The high load scenario utilizes RICE resources to fill this additional capacity need. Adjustments to the 2017 Reference Case Plan to meet the high load scenario are presented on Figure 39.

Figure 39 - High Load Scenario Adjustments to the 2017 Reference Case Plan

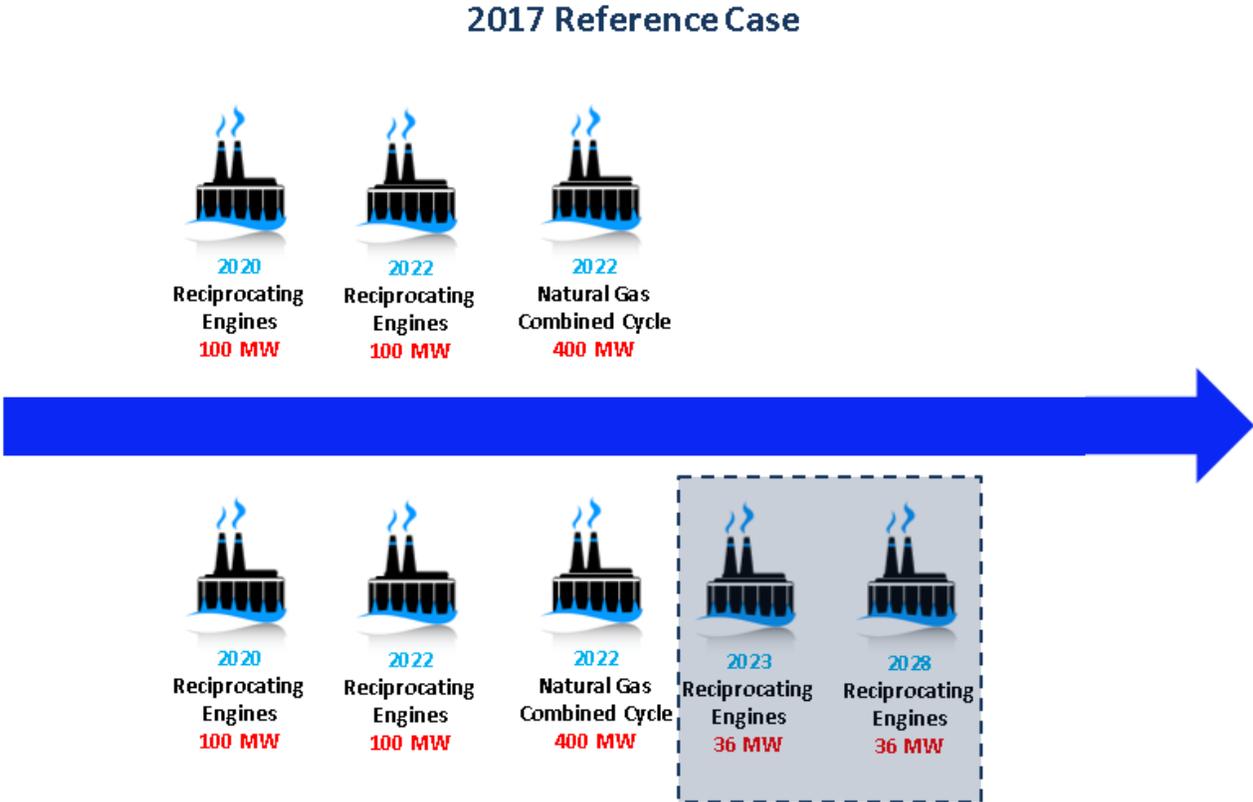


High Load Growth – Continued Firm Wholesale (+116 MW)

Low Load Scenario

The low load growth scenario assumes that there is no new mining expansions within the planning period, which results in a decrease in peak demand, and load, of approximately 80 MW compared with the Reference Case Plan, beginning in 2022, and extending through the end of the planning period. The timing of this decrease coincides with RICE and NGCC resource additions in the Reference Case Plan. Therefore, decreasing the amount of additional capacity is a logical approach for adjusting to this decrease in load. Given the nature of mining load (approximately 85% load factor), and the fact that the RICEs are intended to support increases in renewable energy resources, the low load scenario reduces the amount of additional NGCC capacity needed in 2022. Adjustments to the 2017 Reference Case Plan to meet the low load scenario are presented on Figure 40.

Figure 40 - Low Load Scenario Adjustments to the 2017 Reference Case Plan

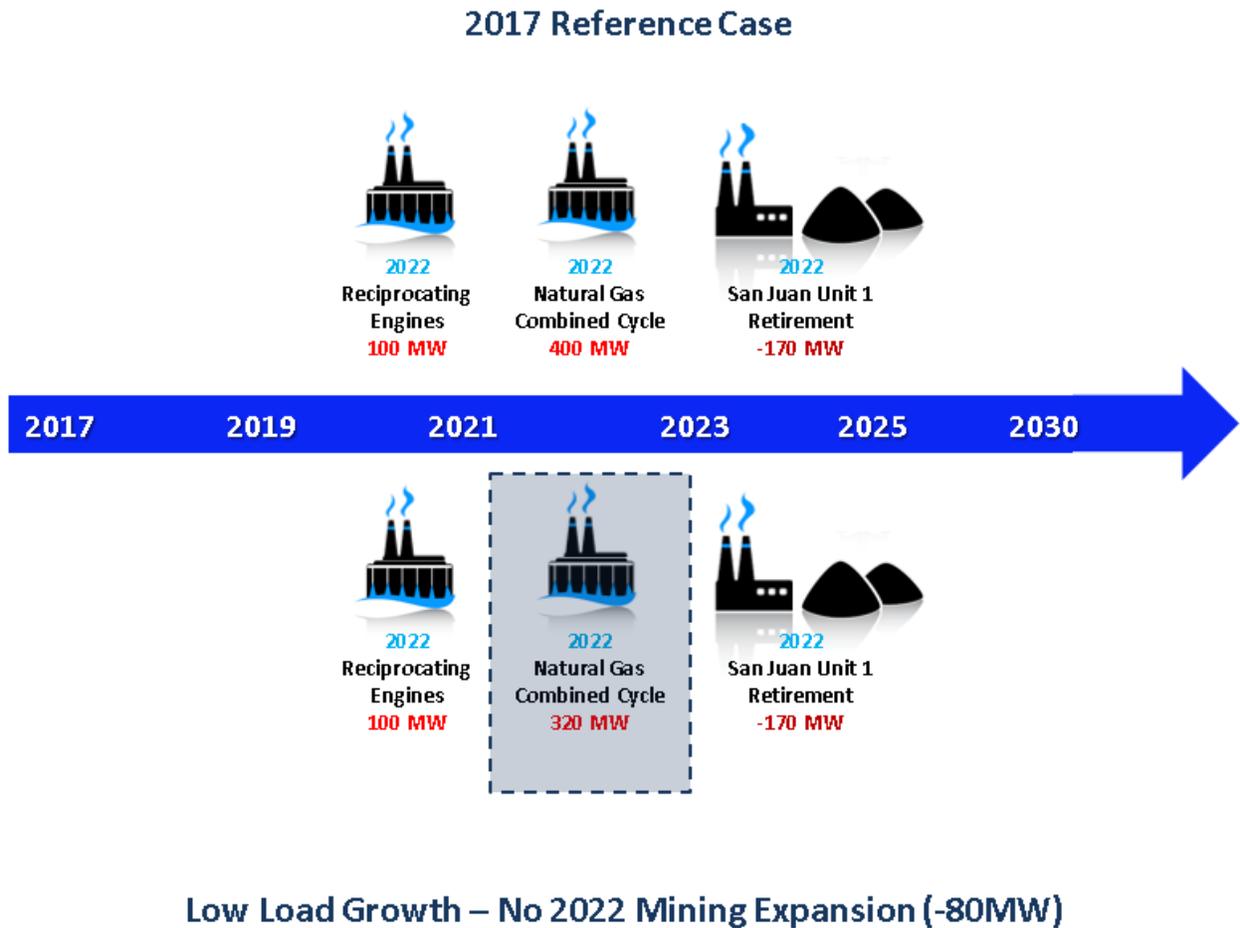

CHAPTER 13**ALTERNATIVE PORTFOLIOS**

The following sections present a description and the results of alternative portfolios analyzed as part of this IRP. The list of portfolios analyzed is presented below.

- ▶ Energy Storage Case Plan
- ▶ Small Nuclear Reactors Case Plan (combined with Full Coal Retirement)
- ▶ Expanded Energy Efficiency Case Plan
- ▶ High Solar Case Plan (substituted for the Expanded Renewables Case Plan)

This list of alternative portfolios varies slightly from the list presented in the March 2016 Preliminary Integrated Resource Plan. High load and low load growth scenarios were analyzed in the context of the Reference Case Plan in Chapter 12, where adjustments were made to the portfolio to account for those differing load assumptions. The Full Coal Retirement Case Plan was combined with the Small Nuclear Reactor Case plan based on the view that coal and nuclear resources provide the same service (fully dispatchable load serving resources), and as a means of maintaining some resource diversity in the absence of coal-fired generation. A Market-Based Reference Case Plan was not analyzed because under the Reference Case Plan, TEP has capacity in excess of the 15% reserve margin in all years beyond the five years where market purchases can be included in the portfolio. The Expanded Renewables Case Plan was substituted with a High Solar Case Plan as the Reference Case Plan portfolio already had high renewable energy assumptions. The High Solar Case Plan allows for analyzing the effects of lower diversity in the renewable energy mix.

Overview of the Energy Storage Portfolio

In the Expanded Energy Storage Portfolio, the 100 MW x 100 MWh ESS implemented in 2031 in the Reference Case Plan is replaced with a pair of “bulk energy” storage systems implemented in 2022 and 2025. Each bulk system is assumed to be 100 MW x 400 MWh. Unlike the ESSs included in the Reference Case Plan, which are intended to provide ancillary services, the bulk ESSs are intended to provide both ancillary and energy services, such as capacity, levelization of thermal-based electricity generation, and following of load.


Bulk storage systems can also reduce operating costs by storing energy when it is relatively inexpensive to generate and releasing it when it would otherwise be most expensive to generate, and such arbitrage opportunities are expected to become more common in the Southwest as the increased use of renewable energy creates greater intra-day wholesale electricity price variations.

The first bulk ESS in this portfolio is assumed to be operating by 2022. This coincides with the expected timing of greater arbitrage opportunities and the full retirement of the San Juan Generating Station, which would have the effect of reducing emissions associated with recharging the ESS. This ESS would also obviate the need for the five RICEs assumed to come on line in 2022 in the Reference Case Plan, which are therefore removed from the Energy Storage Portfolio.

The second bulk ESS is assumed to be operating by 2025, which coincides with the highest year of assumed renewable energy expansion after 2019. Implementing this second ESS in 2025, as opposed to implementing both in 2022, also provides more time for ESSs to improve in terms of performance and costs. In fact, analyses by Lazard and DNV GL suggest that by 2025 the cost of lithium-ion bulk ESSs will be approximately the same as pumped hydro energy storage, which may also be an energy storage option around that time. Finally, a 2025 implementation date would allow three combustion turbines at North Loop and two at Sundt to retire three years earlier than planned in the Reference Case Plan.

Both bulk ESSs in this portfolio are modeled as lithium-ion battery technology, partly because of their rapidly declining costs and partly because of the greater flexibility they provide over more traditional forms of energy storage in terms of modularity, scaling, siting, and multiple uses – e.g. energy services, ancillary services, and transmission and distribution cost deferral. However, the results of the analysis would likely hold for other forms of energy storage such as pumped hydro. Expanded Energy Storage Portfolio adjustments to the Reference Case Plan are presented on Figure 41.

Figure 41 - Expanded Energy Storage Adjustments to the Reference Case Plan

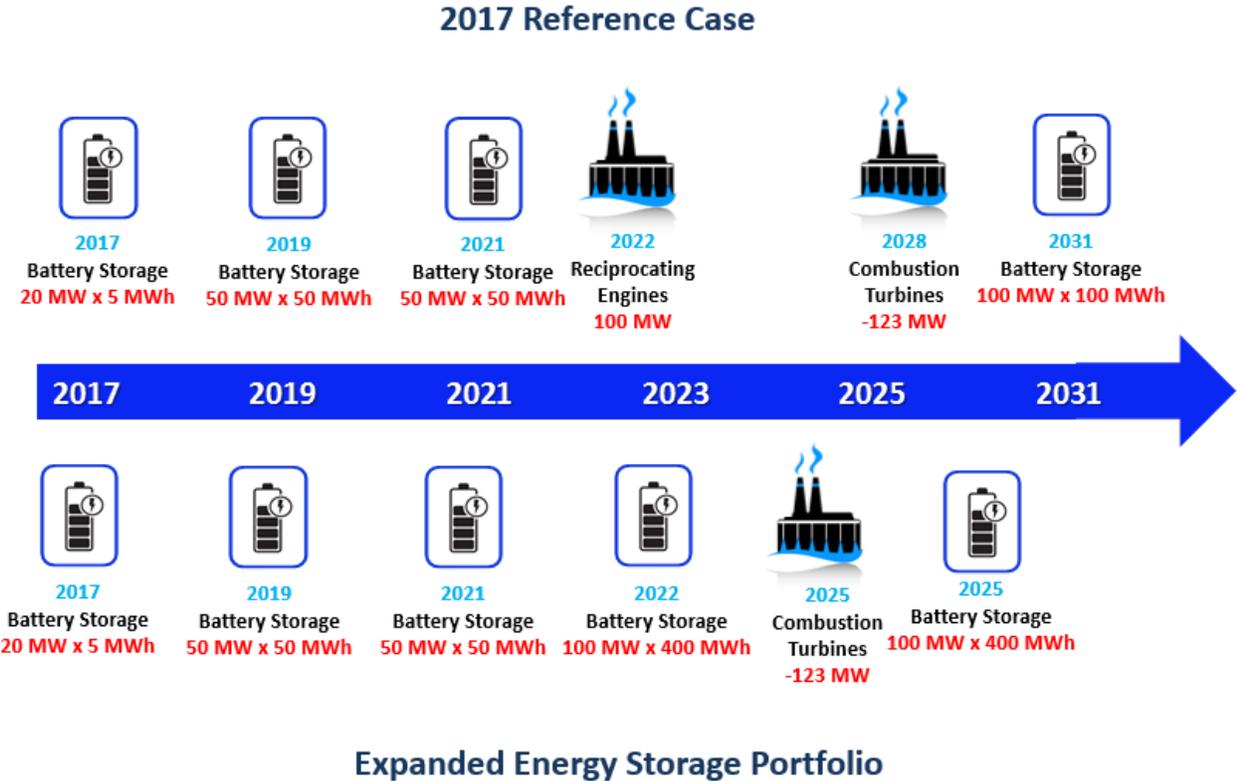

Overview of the SMR - Full Coal Retirement Portfolio


In Decision No. 75068, as a result of the 2014 IRP, the ACC requested that load-serving entities study a scenario that includes the addition of SMRs. As ordered by the ACC in the 2012 IRP, TEP generated a scenario called “Full Coal Retirement Case”. This case was studied in the 2014 IRP in anticipation of potential alternative outcomes resulting from EPA Regional Haze mandates. The Clean Power Plan further instigated a review of expanded coal retirements.

As TEP was analyzing and designing each of these scenarios, it was evident that any scenario involving SMR would assume a replacement of base-load generation. The full coal requirement would need base-load type replacement; it only made sense to merge these two scenarios.

Small Nuclear Reactors – Full Coal Retirement Case

Small Nuclear Reactors are a technology that can be utilized to lower CO₂ emissions, as well as other pollutants, while providing reliable, sustained and efficient power output. In this case, TEP studied the impact of SMRs as a resource to supplant retiring base load coal assets. This case was designed to fully meet the EE standards as well as exceed the renewable standard with the TEP 30% target as described throughout this document. The assumptions in the Reference Case Plan remain, except for the changes illustrated in Figure 42 below. In addition to the coal unit closures presented in the Reference Case Plan, the following closures were also assumed: Springerville Unit 1 in 2025, and Four Corners Units 4&5 in 2028. Replacement capacity is also shown in the figure below-- an additional 200 MW of RICE and 105 MW of NGCC is needed in 2026. The storage project assumed for 2031 in the Reference Case Plan, was advanced to 2028 in this scenario. The lead time for a nuclear project is over 10 years, this scenario assumes a commission date for 500 MWs of SMR in 2029.

Figure 42 – SMR & Coal Retirement Case Resource Timeline for Existing Resources

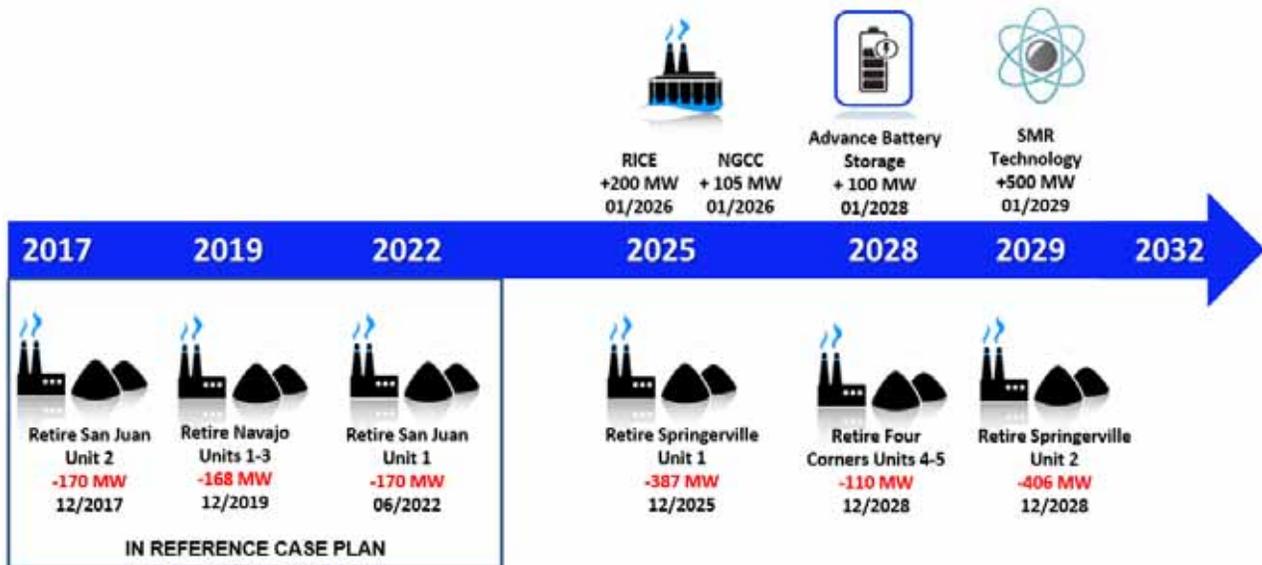

Overview of Expanded Energy Efficiency


For purposes of this portfolio, it is assumed that TEP realizes additional EE in the time period from 2021 through the 2032. The higher levels of EE assumed under this portfolio are based on the “*high achievable potential*” estimated by EPRI⁴⁵. In comparison with the “*achievable potential*” assumed in the Reference Case Plan, in which market constraints include both market acceptance factors as well as program implementation factors, the “*high achievable potential*” excludes program implementation factors.

Higher levels of energy savings will necessitate greater investment in DSM program activities. However, it is difficult to estimate the amount of additional DSM investment needed to attain a particular energy savings goal. Therefore, for this portfolio, TEP estimated no annual incremental DSM program cost escalation. In other words, the 1st-year \$/MWh cost is the same in the Expanded Energy Efficiency Case as it is in the Reference Case Plan. This likely underestimates that cost of achieving the savings assumed in the Expanded Energy Efficiency Case.

Under this portfolio, the total energy savings realized by the Company in 2032 is 2,140 GWh, compared with 1,894 GWh in the reference case (see Chart 62). Total DSM program investment for the period from 2021 through 2032 under the Expanded Energy Efficiency portfolio was \$584M compared with \$365M in the reference case. Combining system fuel savings with additional program expenses, the Expanded Energy Efficiency portfolio was \$35M net present value more expensive than the Reference Case Plan over the planning period. However, for programs in the latter part of the planning period, energy savings extending beyond the planning period are not captured in the net present value calculation.

The additional energy savings in this portfolio also provides a slight capacity benefit, as the average reserve margin from 2025 to 2030 is 19.6% compared with 18.4% in the reference case. However, for purposes of this portfolio, no deferrals in additional capacity or earlier retirement of existing capacity were deemed appropriate. Much of the excess reserve margin is associated with a ramp up in renewable energy starting in 2023, in combination with firm resources needed to balance the intermittency of that renewable energy.

Chart 62 - Projected Energy Savings (GWh)

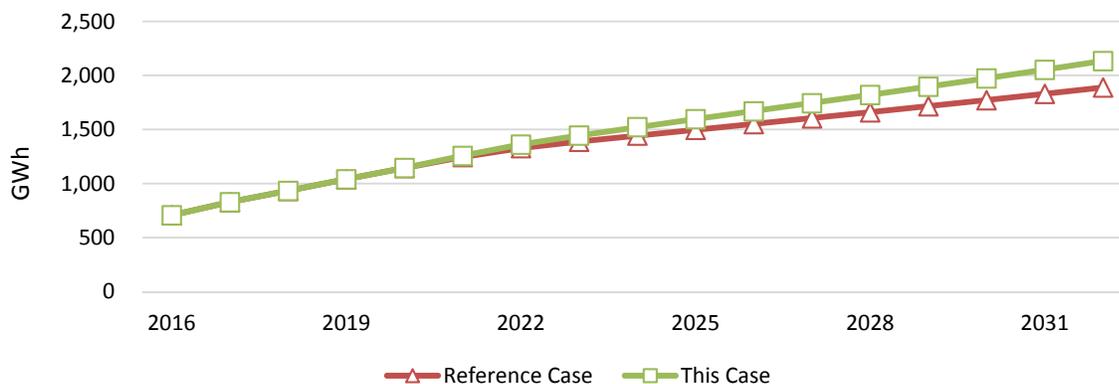

⁴⁵ U.S. Energy Efficiency Potential Through 2035, Electric Power Research Institute, dated April 2014.
<http://www.epri.com/abstracts/Pages/ProductAbstract.aspx?ProductId=00000000001025477>

Due to the uncertainty in estimating the DSM program investment needed to achieve the energy savings projected in the Expanded Energy Efficiency portfolio, it may be informative to divide the fuel savings resulting from the expanded energy savings (based on EPRI’s “*high achievable potential*”) by the total incremental energy savings, without considering any incremental DSM program costs. This provides a “target” investment for additional DSM programs as presented in Table 22 below.

Table 22 - Target Investment for Additional Energy Savings

Incremental NPV Fuel Savings	\$30,950,000
Incremental Energy Savings	1,286 GWh
Target Investment (2017\$)	\$24.07/MWh

As stated previously, TEP does not anticipate that DR will be an economically feasible option for short-term capacity prior to 2022, and beyond that time, TEP does not project a significant need for short-term capacity. Therefore, TEP did not incorporate expanded DR programs into this portfolio. TEP intends to shift toward designing DLC programs that are capable of cost-effectively addressing periods of significant ramping, anticipated with high penetration of renewable resources, and will evaluate higher levels of DR in future IRP planning cycles.

Overview of the Expanded Renewable Portfolio

The Reference Case Plan implements a diversified renewable portfolio that targets serving 30% of TEP’s retail load by 2030. The renewable portfolio under the Reference Case Plan is comprised of 60% solar resources and 40% wind resources. In comparison, the Expanded Renewable plan examines the long-term cost impacts of a heavy solar portfolio. Even though solar projects are projected to be less expensive and the solar output has a greater coincidence with TEP’s system peak (particularly single axis tracking), the heavy solar portfolio results in higher 10-minute ramping requirements. In comparison with the Reference Case Plan, the Expanded Renewable portfolio requires additional 100 MW of fast start reciprocating engines in 2026. The Expanded Renewable portfolio with a high concentration of solar resources is shown in Figure 43 below.

Figure 43 – Expanded Renewable Portfolio (Heavy Solar) vs. Reference Case Plan



Chart 63 shows how the 10-minute ramping requirements under the Expanded Renewable portfolio with a high concentration of solar resources increases beyond the 10-minute ramping requirements in the Reference Case Plan. Chart 64 shows the 10-minute ramping requirements for the Reference Case Plan.

Chart 63 – Expanded Renewable Portfolio 10-Minute Ramping Requirements


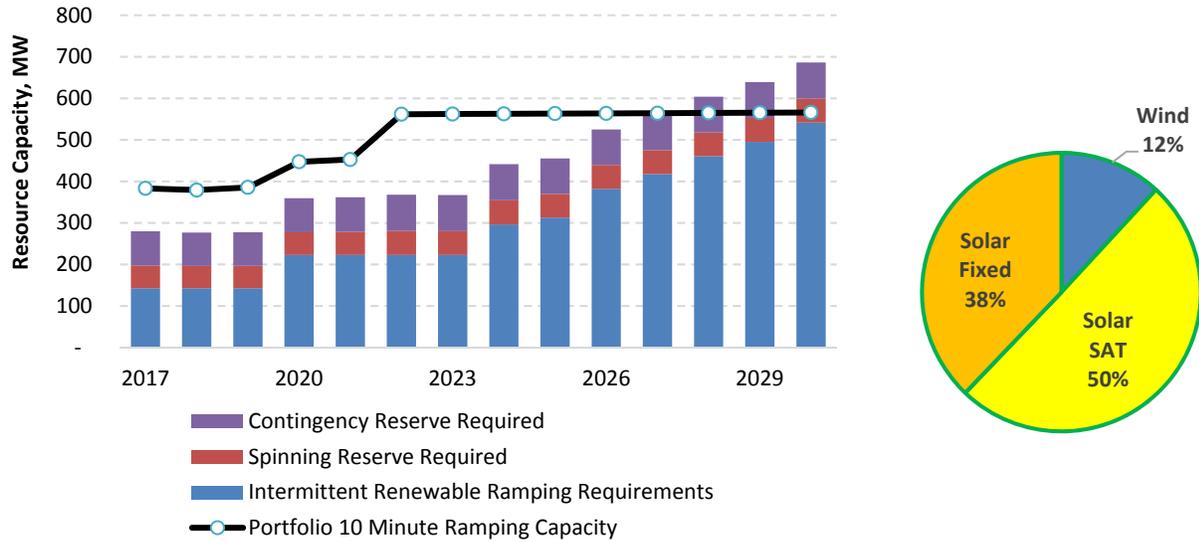


Chart 64 – Reference Case Plan 10-Minute Ramping Requirements

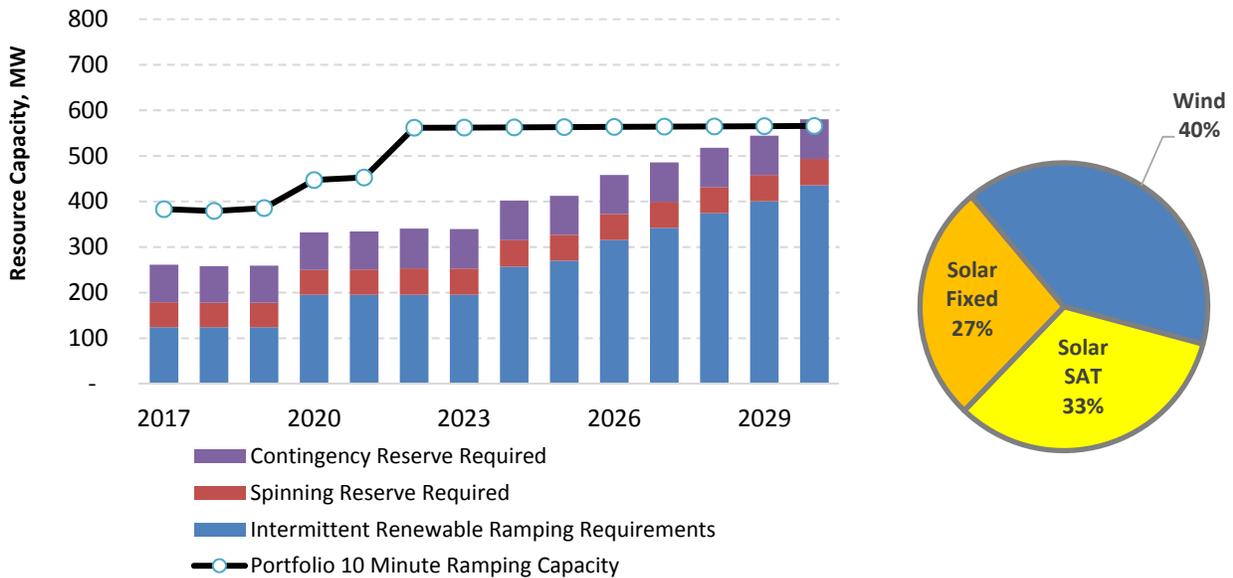

Overview of Major IRP Assumptions by Portfolio

Table 23 below summarizes the major assumptions and environmental upgrades that are included in each case.

Table 23 – Major IRP Assumptions by Case

Major Assumptions	Reference	Expanded Storage	Expanded Renewables	Expanded Energy Efficiency	SMR - Coal Retirement
Energy Efficiency	Fully compliant with the Arizona EE Standard (22% by 2020). From 2021 on, EE Programs based on EPRI's estimate of "Achievable" Savings.	Same as Reference Case Plan	Same as Reference Case Plan	Same as Reference Case Plan. From 2021 on, EE Programs based on EPRI's estimate of "High Achievable" Savings	Same as Reference Case Plan
Renewable Energy	Targets Serving 30% of Retail Load from both Utility Scale Renewables and DG by 2030. 60% Solar & 40% Wind (utility scale)	Same as Reference Case Plan	Targets 30% by 2030 Sourced from 90% Solar & 10% Wind	Same as Reference Case Plan	Same as Reference Case Plan
Storage Resources	220 MW 205 MWh In-Service by 2031	320 MW 905 MWh In-Service by 2025	Same as Reference Case Plan	Same as Reference Case Plan	Same as Reference Case Plan
Coal Capacity Reductions	36% by 2022 56% by 2032	Same as Reference Case Plan	Same as Reference Case Plan	Same as Reference Case Plan	63% by 2026 100% by 2032


Production Changes 2017 versus 2032	Reference Case Plan	Expanded Storage	Expanded Renewables	Expanded Energy Efficiency	SMR - Coal Retirement
Water Consumption	-17%	-17%	-17%	-17%	-33%
CO ₂ Emissions	-21%	-21%	-24%	-22%	-75%
NO _x Emissions	-40%	-40%	-40%	-40%	-90%
SO ₂ Emissions	-17%	-17%	-17%	-17%	-100%
Natural Gas Consumption	+91%	+91%	+78%	+84%	+136%

CapEx (Nominal \$millions)	Reference Case	Expanded Storage	Expanded Renewables	Expanded Energy Efficiency	SMR - Coal Retirement
CapEx 2017-2024	\$993	\$1,164	\$1,031	\$993	\$993
CapEx 2025-2032	\$480	\$641	\$851	\$480	3,892
Total CapEx	\$1,473	\$1,805	\$1,882	\$1,473	\$4,885

Summary of NPV Revenue Requirements by Scenario

Chart 65 below summarizes the net present value revenue requirements (NPVRR) for each of the PACE Global scenarios modeled in the 2017 IRP. The Reference Case Plan results in the lowest cost portfolio under the Base Case and the High Economy scenarios whereas the Expanded Renewable Case is the lowest cost portfolio under the High Technology scenario because capital costs for solar technologies decline at a faster rate than that of wind.

Chart 65 – NPV Revenue Requirements by Scenario

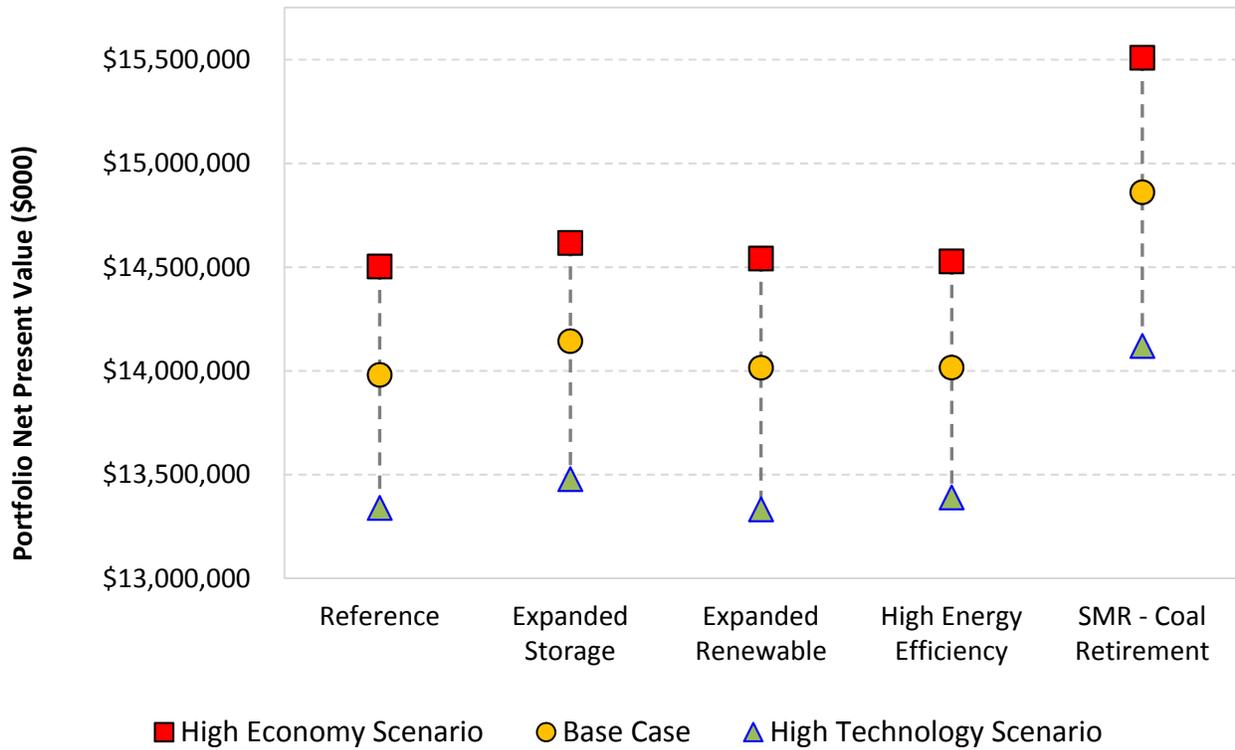

Summary of NPV Revenue Requirements – Base Case Scenario

Table 24 below summarizes the NPVRR for each portfolio under the Base Case scenario.

Table 24 – NPV Revenue Requirements – Base Case Scenario

Non Fuel Revenue Requirements, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Existing T&D Resources	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825
Existing Generation Resources	\$3,909,337	\$3,905,335	\$3,909,337	\$3,909,337	\$3,732,095
New Generation Resources	\$695,575	\$593,721	\$758,243	\$695,575	\$1,707,209
Storage Resources	\$140,203	\$454,732	\$140,203	\$140,203	\$149,131
New Renewable Resources	\$79,736	\$79,736	\$176,658	\$79,736	\$79,736
Total Non-Fuel Revenue Requirements	\$8,886,676	\$9,095,349	\$9,046,266	\$8,886,676	\$9,729,996
Existing Transmission Expenses	\$237,009	\$237,009	\$237,009	\$237,009	\$237,009
Total Non-Fuel Revenue Requirements	\$9,123,685	\$9,332,358	\$9,283,275	\$9,123,685	\$9,967,005
Fuel & Purchase Power, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Total PPAC Costs	\$4,133,336	\$4,074,618	\$3,955,869	\$4,102,386	\$4,170,264
Energy Efficiency and Renewables, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Energy Efficiency	\$285,450	\$285,450	\$285,450	\$351,404	\$285,450
Demand Response	\$39,714	\$39,560	\$39,532	\$39,665	\$39,803
Total Energy Efficiency	\$325,164	\$325,010	\$324,982	\$391,069	\$325,253
Total Renewables	\$400,139	\$400,139	\$451,998	\$400,139	\$400,139
Total Energy Efficiency and Renewables	\$725,303	\$725,149	\$776,980	\$791,208	\$725,392
Total System Revenue Requirements	\$13,982,324	\$14,132,125	\$14,016,124	\$14,017,279	\$14,862,661
NPV Difference from Reference Case Plan		\$149,800	\$33,799	\$34,954	\$880,336

Summary of NPV Revenue Requirements – High Economy Scenario

Table 25 below summarizes the NPVRR for each portfolio under the High Economy scenario.

Table 25 – NPV Revenue Requirements – High Economy Scenario

Non Fuel Revenue Requirements, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Existing T&D Resources	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825
Existing Generation Resources	\$3,909,337	\$3,905,335	\$3,909,337	\$3,909,337	\$3,732,095
New Generation Resources	\$753,202	\$648,331	\$818,773	\$753,202	\$1,766,772
Storage Resources	\$144,302	\$481,654	\$144,302	\$144,302	\$151,944
New Renewable Resources	\$94,246	\$94,246	\$204,728	\$94,246	\$94,246
Total Non-Fuel Revenue Requirements	\$8,962,912	\$9,191,391	\$9,138,965	\$8,962,912	\$9,806,882
Existing Transmission Expenses	\$237,009	\$237,009	\$237,009	\$237,009	\$237,009
Total Non-Fuel Revenue Requirements	\$9,199,921	\$9,428,400	\$9,375,974	\$9,199,921	\$10,043,891
Fuel & Purchase Power, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Total PPAC Costs	\$4,677,093	\$4,563,367	\$4,457,733	\$4,635,803	\$4,840,984
Energy Efficiency and Renewables, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Energy Efficiency	\$285,450	\$285,450	\$285,450	\$351,404	\$285,450
Demand Response	\$40,167	\$39,969	\$39,904	\$40,100	\$40,305
Total Energy Efficiency	\$325,617	\$325,419	\$325,354	\$391,504	\$325,755
Total Renewables	\$299,841	\$299,841	\$382,211	\$299,841	\$299,841
Total Energy Efficiency and Renewables	\$625,458	\$625,260	\$707,565	\$691,345	\$625,596
Total System Revenue Requirements	\$14,502,472	\$14,617,027	\$14,541,272	\$14,527,069	\$15,510,471
NPV Difference from Reference Case Plan		\$114,555	\$38,800	\$24,597	\$1,007,999

Summary of NPV Revenue Requirements – High Technology Scenario

Table 26 below summarizes the NPVRR for each portfolio under the High Technology scenario.


Table 26 – NPV Revenue Requirements – High Technology Scenario

Non Fuel Revenue Requirements, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Existing T&D Resources	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825	\$4,061,825
Existing Generation Resources	\$3,909,337	\$3,905,335	\$3,909,337	\$3,909,337	\$3,732,095
New Generation Resources	\$622,882	\$525,553	\$681,195	\$622,882	\$1,620,599
Storage Resources	\$129,934	\$380,104	\$129,934	\$129,934	\$145,764
New Renewable Resources	\$62,402	\$62,402	\$104,930	\$62,402	\$62,402
Total Non-Fuel Revenue Requirements	\$8,786,380	\$8,935,219	\$8,887,221	\$8,786,380	\$9,622,685
Existing Transmission Expenses	\$237,009	\$237,009	\$237,009	\$237,009	\$237,009
Total Non-Fuel Revenue Requirements	\$9,023,389	\$9,172,228	\$9,124,230	\$9,023,389	\$9,859,694
Fuel & Purchase Power, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Total PPAC Costs	\$3,464,140	\$3,453,215	\$3,344,143	\$3,449,172	\$3,411,727
Energy Efficiency and Renewables, \$000	Reference	Expanded Storage	Expanded Renewable	High Energy Efficiency	SMR - Coal Retirement
Energy Efficiency	\$285,450	\$285,450	\$285,450	\$351,404	\$285,450
Demand Response	\$39,282	\$39,199	\$39,186	\$39,255	\$39,314
Total Energy Efficiency	\$324,732	\$324,649	\$324,636	\$390,659	\$324,764
Total Renewables	\$525,799	\$525,799	\$538,852	\$525,798	\$525,799
Total Energy Efficiency and Renewables	\$850,531	\$850,448	\$863,488	\$916,457	\$850,563
Total System Revenue Requirements	\$13,338,060	\$13,475,891	\$13,331,861	\$13,389,018	\$14,121,984
NPV Difference from Reference Case Plan		\$137,831	(\$6,199)	\$50,958	\$783,924

Distribution of NPV Revenue Requirements by Portfolio


The degree to which each portfolio is able to adequately meet future load serving requirements at a reasonable cost is measured by examining the distribution of its NPVRR outcomes for each portfolio across multiple stochastic iterations. The performance of each portfolio is summarized in the following charts. Chart 66 shows each histogram comparing the frequency of outcomes for each of the candidate portfolios. All histograms are represented on the same scale. Portfolios showing a large number of outcomes (higher bars) on the right side of the graph represent high cost options relative to the others resource portfolios. Higher risk is reflected by lower bars spread over more tranches.

Chart 66 – Distribution of NPVRR by Portfolio

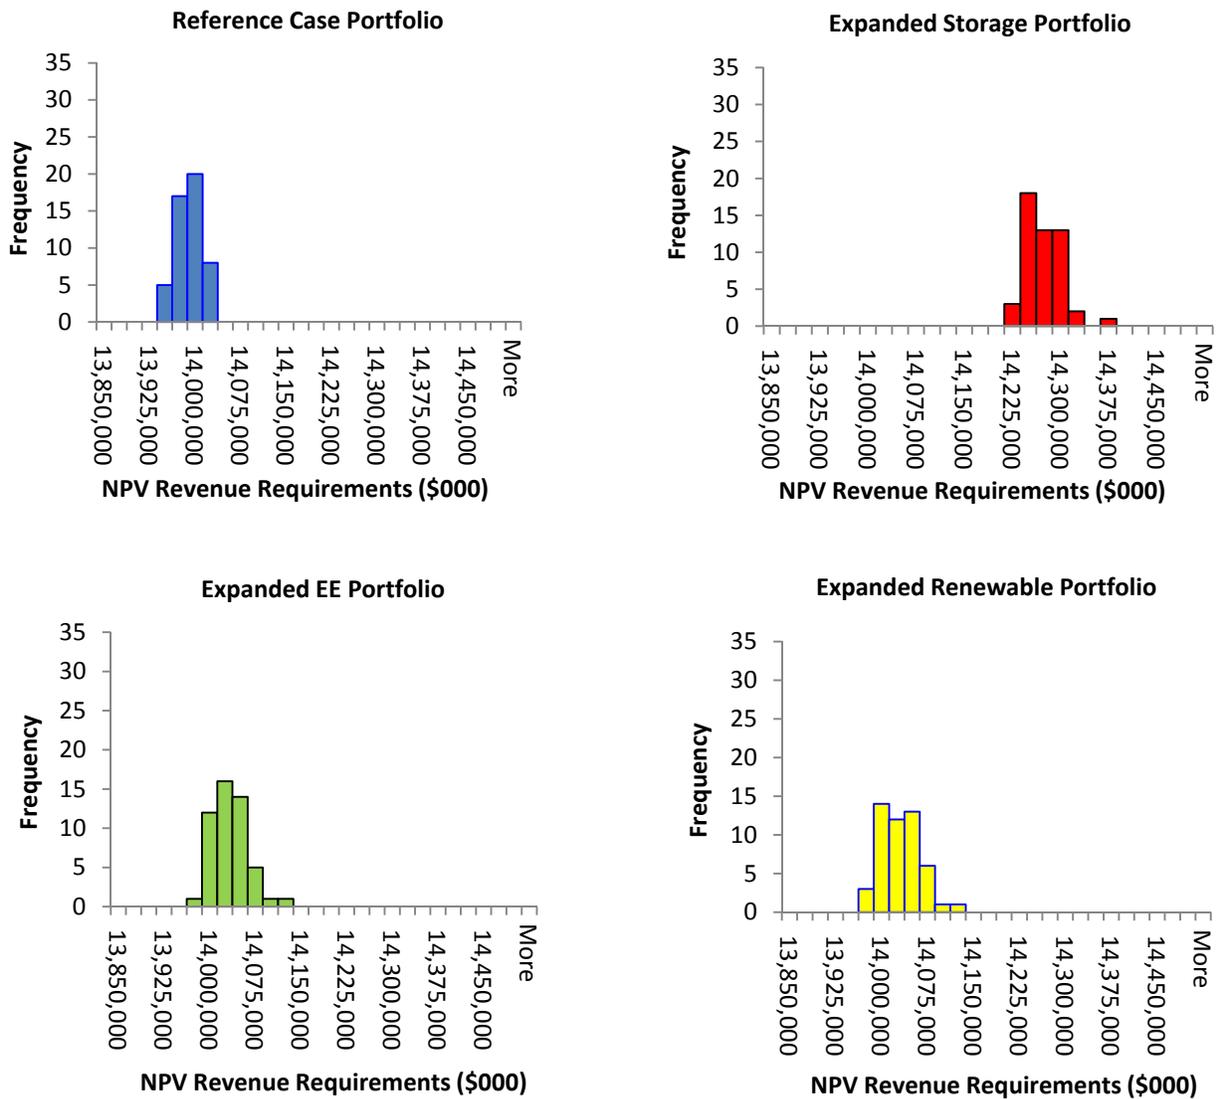

Distribution of NPV Revenue Requirements by Portfolio
 Chart 67 below shows the distribution of NPVRR on the same chart.


Chart 67 – Aggregated NPVRR by Portfolio

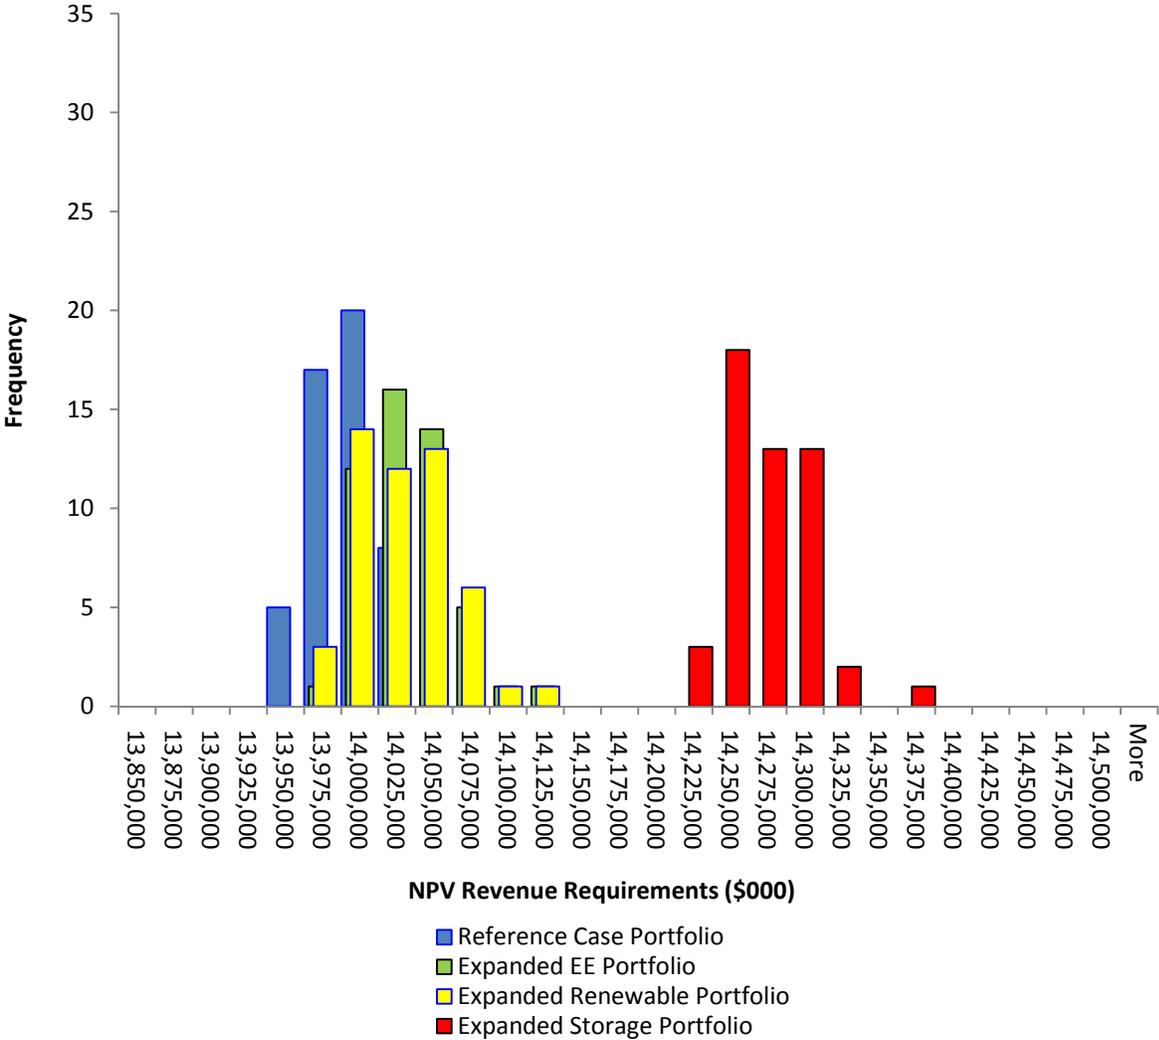

NPVRR Mean and Worst Case Risk

Chart 68 summarizes each portfolio with respect to both the expected average NPVRR and the “worst case” outcome risk as represented by the 95th percentile of its NPVRR outcomes. Values lower on the graph and farther to the left, represent lower risk and lower cost portfolios.

Chart 68 – Summary of NPVRR Mean and Risk

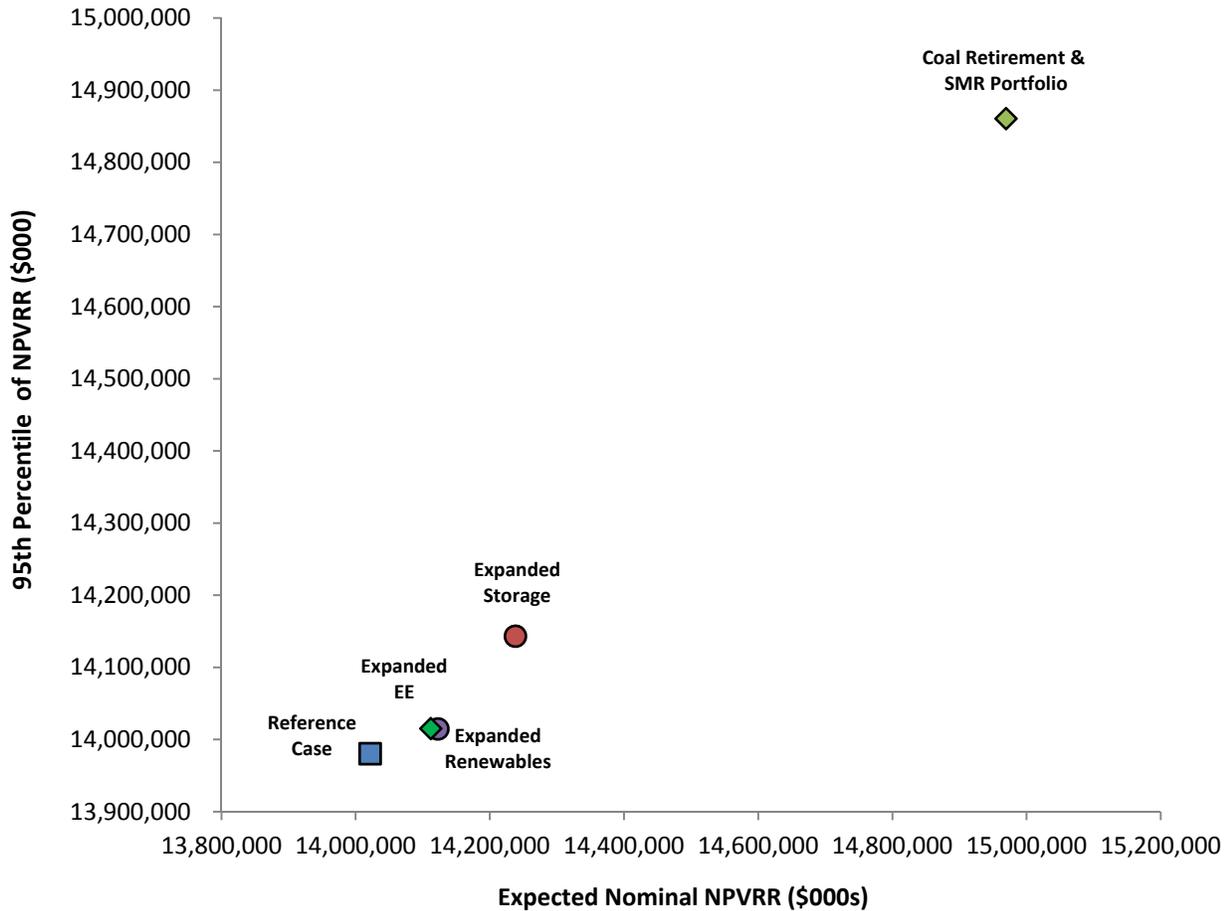

CHAPTER 14

FIVE-YEAR ACTION PLAN

The 2017 Reference Case Plan was chosen as the preferred portfolio plan based on current forecasts and assumptions. TEP has developed a five year action plan based on the resource decisions that are contemplated in this IRP. Under this action plan, additional detailed study work will be conducted to validate all technical and financial assumptions prior to any final implementation decisions. TEP's action plan includes the following:

- ▶ TEP plans to continue with its community-scale build out of renewable energy to achieve a diverse portfolio that targets 30% of retail load from renewable generation by 2030. As a result, over the next five years, TEP is targeting the addition of 100 MW of utility-scale wind and 100 MW of utility-scale solar resources.
- ▶ As part of TEP's portfolio diversification strategy, the Company is reducing its coal resource capacity by 508 MW over the next five years, which represents 36% of our current coal capacity. These planned coal retirements will enable TEP to take advantage of near-term opportunities to reduce costs and rebalance its resource portfolio over the longer-term. This reduction in coal resources will result in significant costs saving⁴⁶ for TEP customers and will result in meaningful reductions in air emissions and water consumption⁴⁷.
- ▶ In order to accommodate increased renewable energy resources, and to allow for the retirement of older gas steam units at the Sundt Generating Station, TEP plans to move forward with a generating resource modernization plan at Sundt over the next few years. As part of this current resource planning cycle, TEP conducted a Flexible Generation Technology Assessment⁴⁸ with Burns & McDonnell in 2017. The results of this study indicate that RICE technology is the preferred technology that will provide capacity and assist in mitigating renewable energy intermittency and variability. TEP plans to move forward with issuing a Request for Proposal for these fast-responding resources that will meet the 2020 and 2022 timeline.
- ▶ TEP will continue to implement cost-effective EE programs based on the Arizona EE Standard. TEP will closely monitor its EE program implementations and adjust its near-term capacity plans accordingly. TEP will continue to monitor closely and implement DR programs that are mutually beneficial to the Company and its customers.
- ▶ TEP is optimistic about the potential of energy storage systems as a technology and as an economically viable solution to provide peak capacity and renewable intermittency mitigation. The Reference Case

⁴⁶ As part of the 2014 IRP analysis, TEP avoided approximately \$165 in pollution controls with its commitment to retire San Juan Unit 2 at the end of 2017. In the 2017 IRP analysis, TEP's customers will realize an additional net present value savings of approximately \$179 million related to the retirement of TEP's ownership interest in Navajo at the end of 2019 and the retirement of TEP's ownership interest in San Juan Unit 1 at the end of June 2022.

⁴⁷ The retirement of both Navajo and San Juan Units 1 and 2 results in reductions in TEP's total system emissions of 15.8% for carbon dioxide (CO₂), 29.8% for nitrous oxides (NO_x), and 9.8% for sulfur dioxide (SO₂). In addition, the retirement of the Navajo and San Juan units show water consumption is reduced by approximately 2,599 acre feet per year, an overall savings of 16.18%.


⁴⁸ See the 2017 Flexible Generation Technology Assessment in Appendix B.

Plan includes the addition of a 50 MW battery project for 2019 and another 50 MWs for 2021. TEP will continue to monitor the advance of ESS and may opt to issue a RFP in the near future.

- ▶ TEP’s 2017 Reference Case Plan recommends the addition of 413 MW of natural gas combined cycle capacity in 2022. As part of its near-term portfolio strategy, TEP will continue to utilize the wholesale market for the purchase of short-term market based capacity products. In addition, TEP will continue to monitor the wholesale market for other resource alternatives such long-term PPAs and near-term low cost plant acquisitions. TEP will also monitor and adjust its natural gas hedging requirements as it reduces its reliance on coal based generation in favor of natural gas resources. Recommendations will be made on potential fuel hedging changes if they become necessary.
- ▶ TEP and other Arizona utilities continue to evaluate the potential benefits of in-ground natural gas storage. Local storage would improve the ability of natural gas generation units to respond to changing loads as well as the intermittency caused by renewable resource. Due to the distance of Arizona’s largest load pockets of Phoenix and Tucson from the San Juan and Permian natural gas production basins, local natural gas storage (if available and constructed) would be able to more quickly supply natural gas during shortfalls and store excess natural gas during periods when the natural gas mainlines experienced operational limitations.

As with any planning analysis, the 2017 IRP represents a snapshot in time based on known and reasonable planning assumptions. It is important to note that eventual closure of San Juan and Navajo Generating Stations is given a high probability to occur. Even after the 2017 IRP filing date, TEP anticipates that the plant participants will continue to work through the complex issues surrounding plant operating agreements, fuel contracts, land leases, economic analysis and environmental impact reviews before the final resource decisions are made. Given the confidential nature of these decisions, TEP plans to communicate any major change in its anticipated resource plan with the ACC as part of its ongoing planning activities. TEP hopes this dialog will engage the Commission on important resource planning issues while providing TEP with greater regulatory certainty with regards to future resource decisions. TEP requests that the Commission approve its 2017 Integrated Resource Plan as provided in A.A.C. R14-2-704.B. and the associated actions herein.

Figure 44 -TEP’s 2017 IRP Reference Case Plan – Milestone Timeline

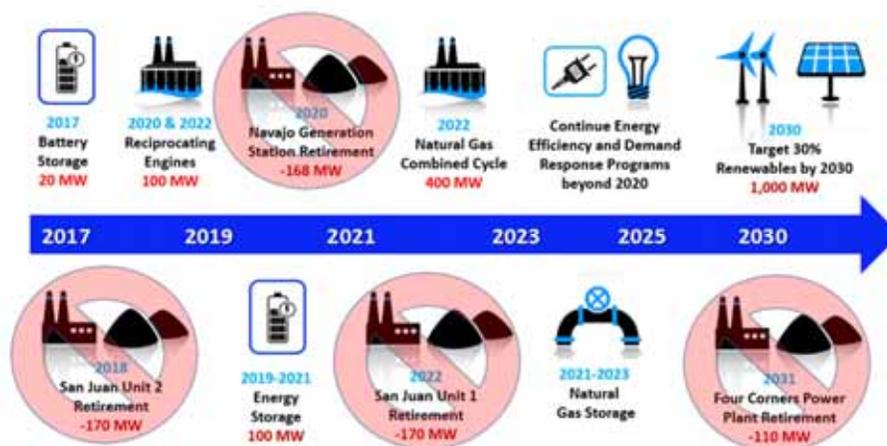

APPENDIX A

PACE GLOBAL FUTURE STATES OF THE WORLD

APPENDIX B

2017 FLEXIBLE GENERATION TECHNOLOGY ASSESSMENT